

OIL ANALYSIS REPORT



ISO

Machine Id 5646080 (S/N 3131) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011106		
Sample Date		Client Info		03 Jan 2024		
Machine Age	hrs	Client Info		16027		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	ء <1		
Vanadium	ppm	ASTM D5185m	210	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	ppin	method	limit/base	current		history2
					history1	
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	4		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	16879		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.009		
ppm Water	ppm	ASTM D6304	>500	93		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		13995		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	A 288		
Particles >21µm		ASTM D7647		<u>▲</u> 72		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	21/19/15		
FLUID DEGRADA		method	limit/base	current	history1	history2
					- HISTOLY I	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35		





OIL ANALYSIS REPORT

Built for a lifetime





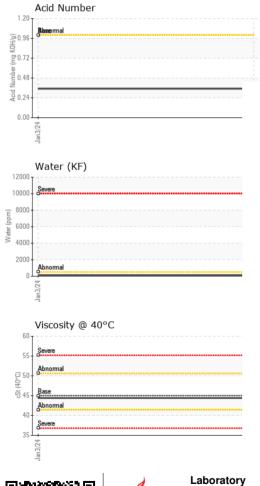

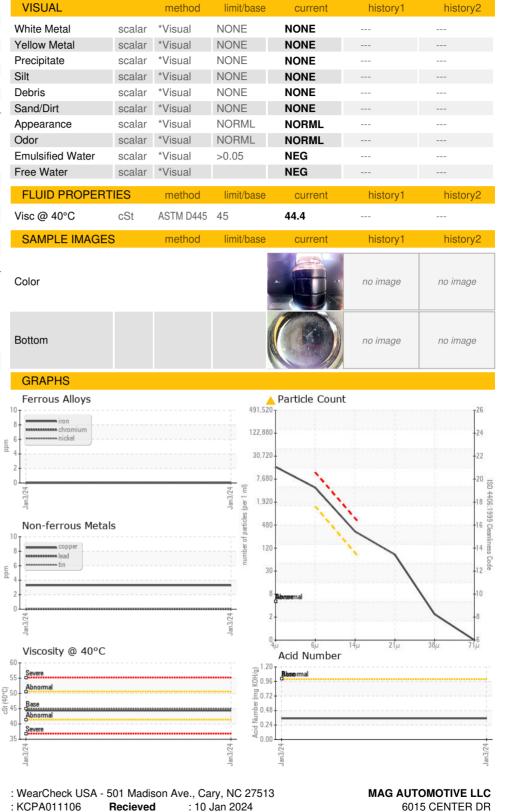



Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: 06056665

: 10822614

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

: 11 Jan 2024

Diagnostician : Don Baldridge

Sample No.

Lab Number

Unique Number

US 48312

T: F:

STERLING HEIGHTS, MI

Contact: Service Manager