




OIL ANALYSIS REPORT

Sample Rating Trend

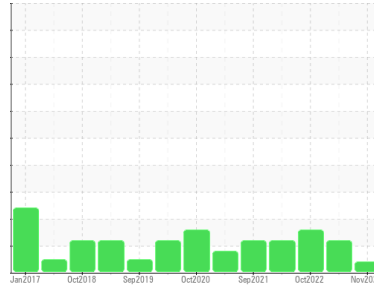

VIS DEBRIS



Machine Id
KAESER ASD 25 4906530 (S/N 1002)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info		KCPA009029	KCPA000155	KCP47288
Sample Date	Client Info		16 Nov 2023	05 May 2023	10 Oct 2022
Machine Age	hrs	Client Info	48866	41111	46562
Oil Age	hrs	Client Info	0	0	2250
Oil Changed		Client Info	N/A	N/A	Not Changd
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	1	2	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	29
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	69	90	76
Calcium	ppm	ASTM D5185m	2	<1	2	3
Phosphorus	ppm	ASTM D5185m		4	1	1
Zinc	ppm	ASTM D5185m		0	2	4
Sulfur	ppm	ASTM D5185m		17389	24200	21743

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	2	2	<1
Sodium	ppm	ASTM D5185m		26	38	25
Potassium	ppm	ASTM D5185m	>20	4	5	2
Water	%	ASTM D6304	>0.05	0.022	0.025	0.021
ppm Water	ppm	ASTM D6304	>500	228	258.7	215.7




FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm		ASTM D7647		---	8129	8130
Particles >6µm		ASTM D7647	>1300	---	▲ 2364	▲ 2085
Particles >14µm		ASTM D7647	>80	---	▲ 100	▲ 208
Particles >21µm		ASTM D7647	>20	---	19	▲ 64
Particles >38µm		ASTM D7647	>4	---	0	2
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	▲ 20/18/14	▲ 20/18/15

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30	0.35	0.41
------------------	----------	------------	-----	-------------	------	------


OIL ANALYSIS REPORT

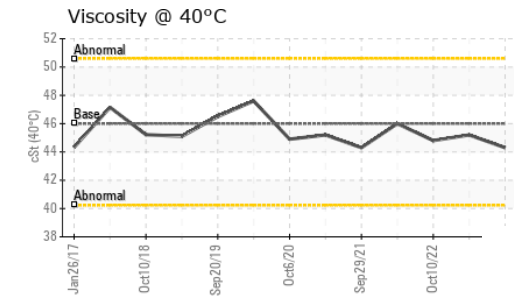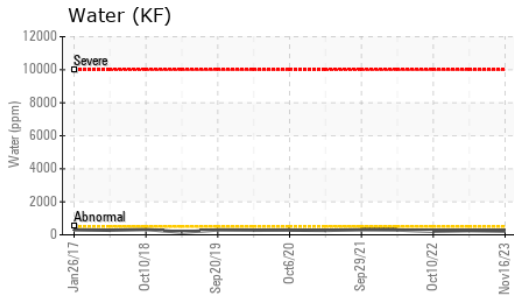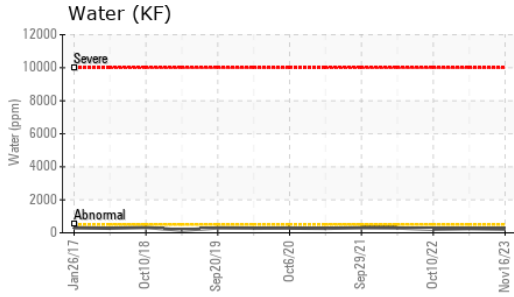





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.3	45.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

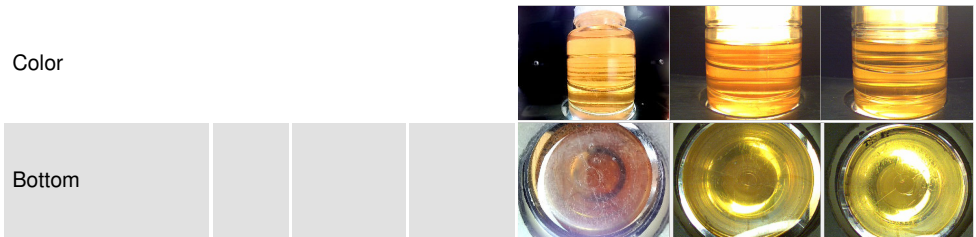

GRAPHS

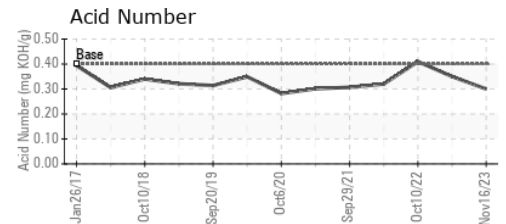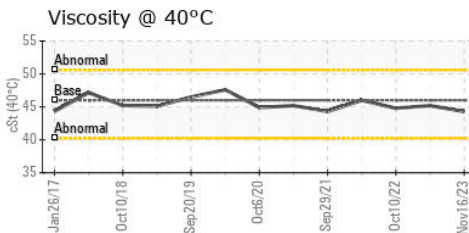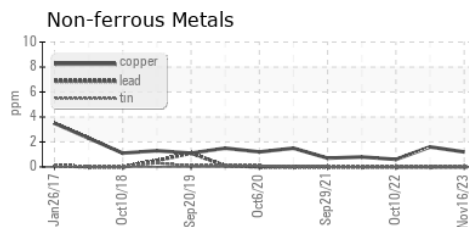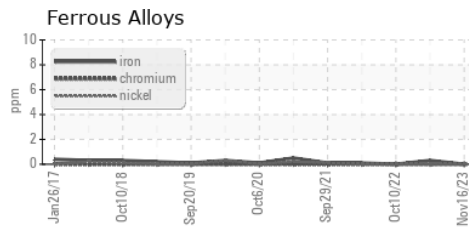

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009029 **Recieved** : 10 Jan 2024
Lab Number : 06056680 **Diagnosed** : 11 Jan 2024
Unique Number : 10822629 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HERBALIFE INTERNATIONAL OF AMERICA INC
 5025 CRUMPLER RD
 MEMPHIS, TN
 US 38141
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: