



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
KAESER AS 30T 286445 (S/N 1064)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA007702	---	---
Sample Date	Client Info	27 Dec 2023	---	---
Machine Age	hrs Client Info	7156	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ATTENTION	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	7	---	---
Chromium ppm	ASTM D5185m >10	0	---	---
Nickel ppm	ASTM D5185m >3	0	---	---
Titanium ppm	ASTM D5185m >3	0	---	---
Silver ppm	ASTM D5185m >2	0	---	---
Aluminum ppm	ASTM D5185m >10	2	---	---
Lead ppm	ASTM D5185m >10	0	---	---
Copper ppm	ASTM D5185m >50	7	---	---
Tin ppm	ASTM D5185m >10	<1	---	---
Vanadium ppm	ASTM D5185m	0	---	---
Cadmium ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	---	---
Barium ppm	ASTM D5185m 90	0	---	---
Molybdenum ppm	ASTM D5185m	0	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m 90	0	---	---
Calcium ppm	ASTM D5185m 2	0	---	---
Phosphorus ppm	ASTM D5185m	470	---	---
Zinc ppm	ASTM D5185m	383	---	---
Sulfur ppm	ASTM D5185m	2152	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<1	---	---
Sodium ppm	ASTM D5185m	<1	---	---
Potassium ppm	ASTM D5185m >20	<1	---	---
Water %	ASTM D6304 >0.05	0.005	---	---
ppm Water	ASTM D6304 >500	58	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	8320	---	---
Particles >6µm	ASTM D7647 >1300	▲ 2056	---	---
Particles >14µm	ASTM D7647 >80	▲ 125	---	---
Particles >21µm	ASTM D7647 >20	▲ 26	---	---
Particles >38µm	ASTM D7647 >4	0	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >17/13	▲ 18/14	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 0.4	1.31	---	---

OIL ANALYSIS REPORT

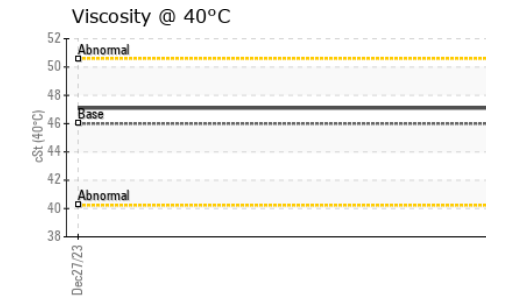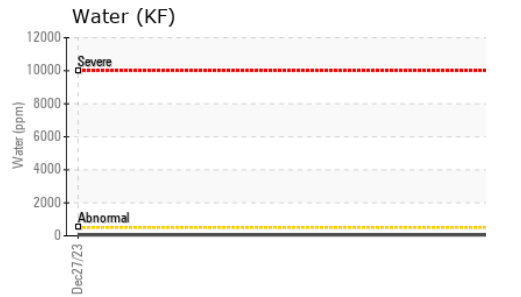
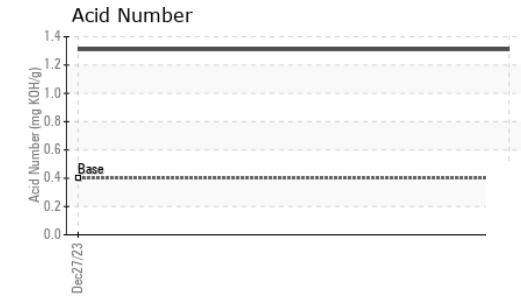
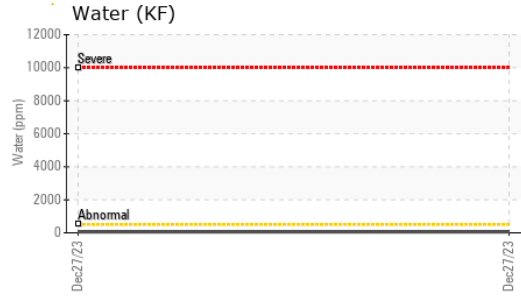
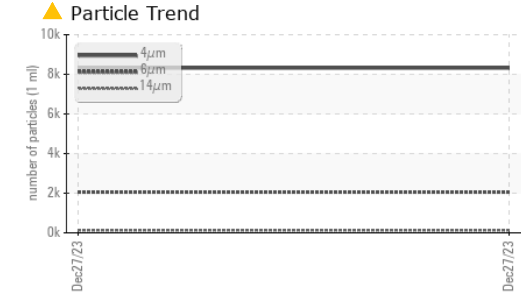


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

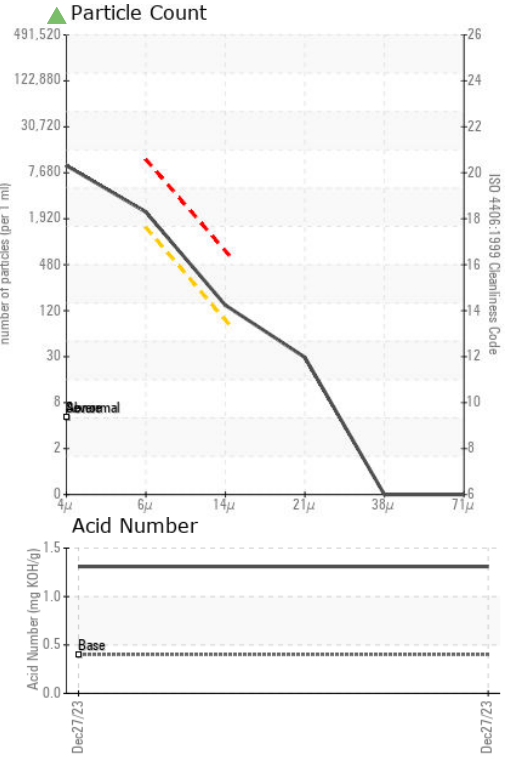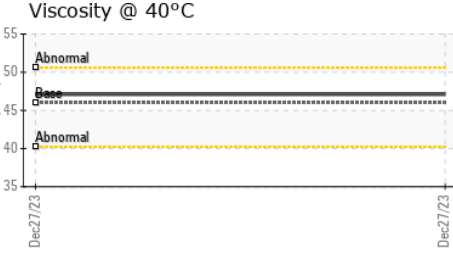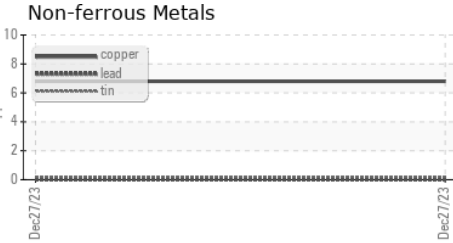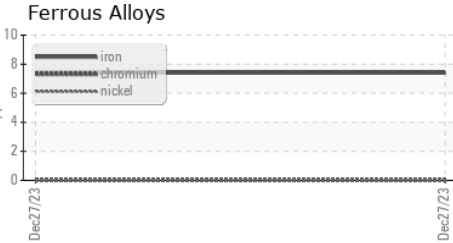

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007702 **Recieved** : 10 Jan 2024
Lab Number : 06056693 **Diagnosed** : 11 Jan 2024
Unique Number : 10822642 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

Kaeser Compressor - Denver Ops
 4665 PARIS ST, UNIT C350
 DENVER, CO
 US 80239
 Contact: Jack beyers
 renny.kroge@kaeser.com;
 T: (303)371-2500
 F: (888)368-0838

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)