


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

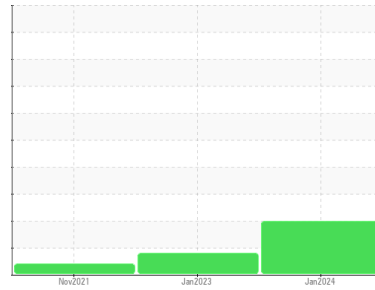

Machine Id  
**KAESER AS 30T 7416472 (S/N 1528)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA010667</b>	KCP40477D	KCP37612
Sample Date	Client Info		<b>03 Jan 2024</b>	16 Jan 2023	08 Nov 2021
Machine Age	hrs	Client Info	<b>13280</b>	9135	4231
Oil Age	hrs	Client Info	<b>0</b>	6486	4231
Oil Changed	Client Info		<b>N/A</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	2
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>8</b>	15	12
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	4
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 100	<b>9</b>	5	16
Calcium	ppm	ASTM D5185m 0	<b>0</b>	6	<1
Phosphorus	ppm	ASTM D5185m 0	<b>4</b>	7	21
Zinc	ppm	ASTM D5185m 0	<b>0</b>	24	54
Sulfur	ppm	ASTM D5185m 23500	<b>18187</b>	19425	14307

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	2	2
Sodium	ppm	ASTM D5185m	<b>6</b>	0	4
Potassium	ppm	ASTM D5185m >20	<b>2</b>	2	6
Water	%	ASTM D6304 >0.05	<b>0.007</b>	0.003	0.006
ppm Water	ppm	ASTM D6304 >500	<b>76</b>	33.3	62.0






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>30056</b>	8940	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 10640</b>	▲ 1731	---
Particles >14µm	ASTM D7647	>80	<b>▲ 1039</b>	27	---
Particles >21µm	ASTM D7647	>20	<b>▲ 279</b>	2	---
Particles >38µm	ASTM D7647	>4	<b>▲ 7</b>	0	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 22/21/17</b>	▲ 20/18/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.41</b>	0.45	0.412


# OIL ANALYSIS REPORT

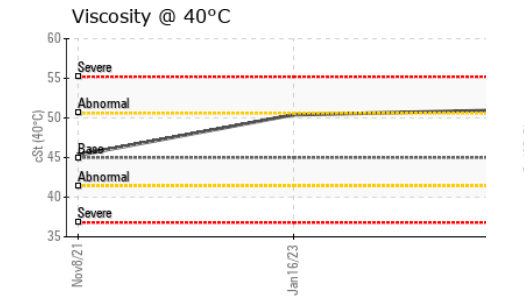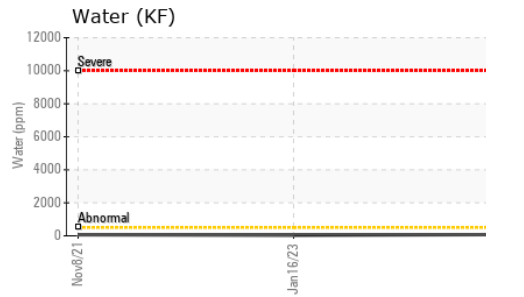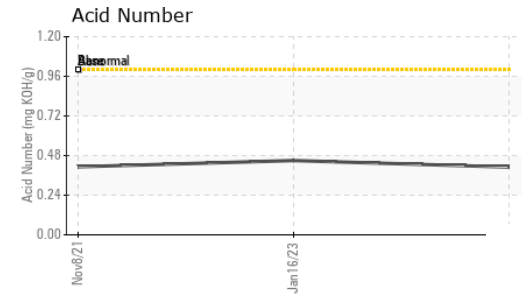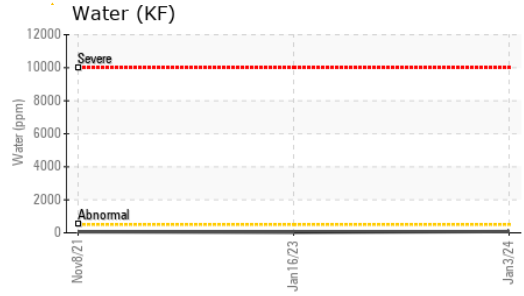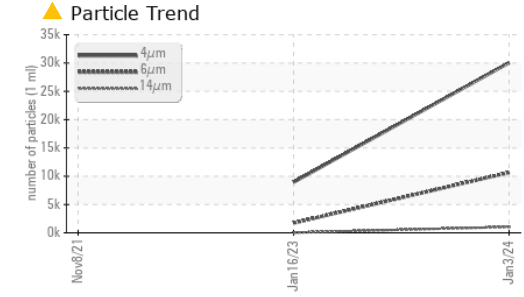





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	51.0	50.4	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

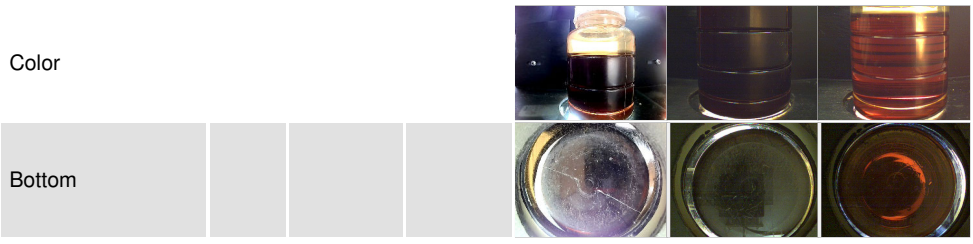

## GRAPHS

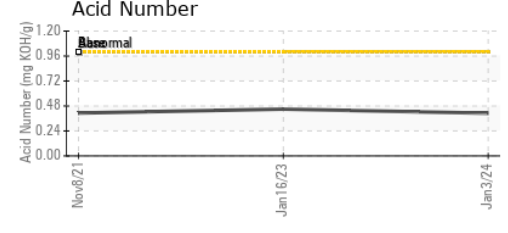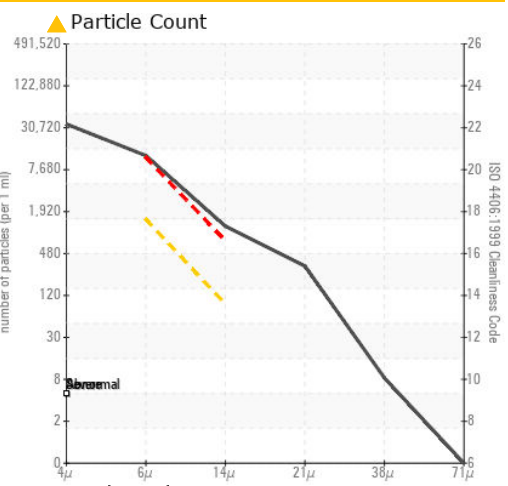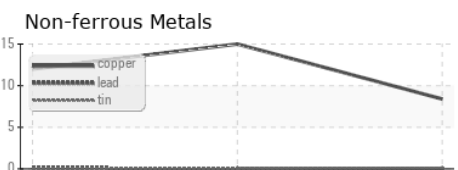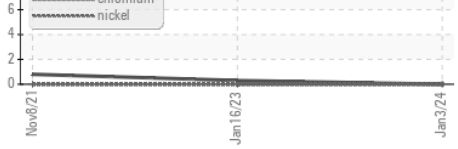

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA010667 **Received** : 10 Jan 2024  
**Lab Number** : 06056696 **Diagnosed** : 11 Jan 2024  
**Unique Number** : 10822645 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NATIONAL WOOD PRODUCTS**  
 4350 KEARNEY ST #J  
 DENVER, CO  
 US 80216  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: