




# OIL ANALYSIS REPORT

Sample Rating Trend

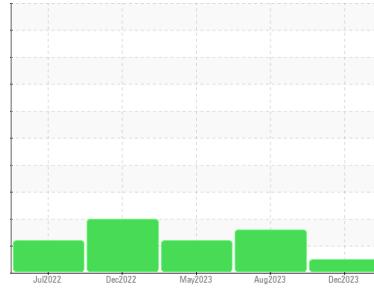

**NORMAL**



Machine Id  
**KAESER 7907156**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA011279</b>	KCPA003599	KCP53436
Sample Date	Client Info	<b>28 Dec 2023</b>	22 Aug 2023	01 May 2023
Machine Age	hrs	<b>6531</b>	0	4340
Oil Age	hrs	<b>0</b>	0	1301
Oil Changed	Client Info	<b>N/A</b>	Changed	Changed
Sample Status		<b>NORMAL</b>	ATTENTION	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>36</b>	12	76
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 100	<b>81</b>	75	89
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>4</b>	<1	1
Zinc	ppm	ASTM D5185m 0	<b>0</b>	2	2
Sulfur	ppm	ASTM D5185m 23500	<b>18789</b>	19834	21437

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>11</b>	6	7
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	1
Water	%	ASTM D6304 >0.05	<b>0.015</b>	0.025	0.012
ppm Water	ppm	ASTM D6304 >500	<b>152</b>	258.2	128.0






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>2304</b>	5542	3781
Particles >6µm	ASTM D7647 >1300	<b>666</b>	▲ 2345	▲ 1732
Particles >14µm	ASTM D7647 >80	<b>30</b>	▲ 155	▲ 85
Particles >21µm	ASTM D7647 >20	<b>5</b>	▲ 21	9
Particles >38µm	ASTM D7647 >4	<b>0</b>	1	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>18/17/12</b>	▲ 20/18/14	▲ 19/18/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.31</b>	0.39	0.42


# OIL ANALYSIS REPORT

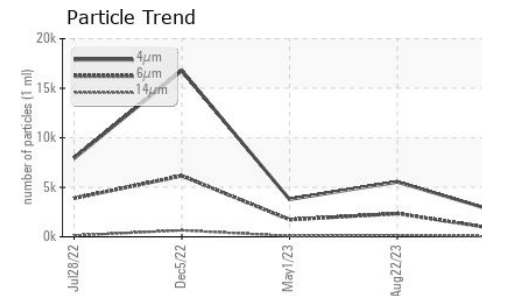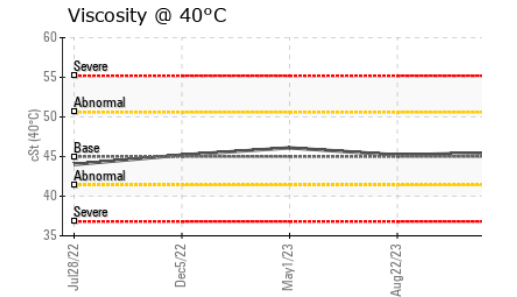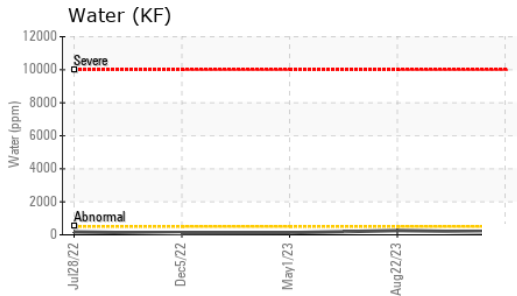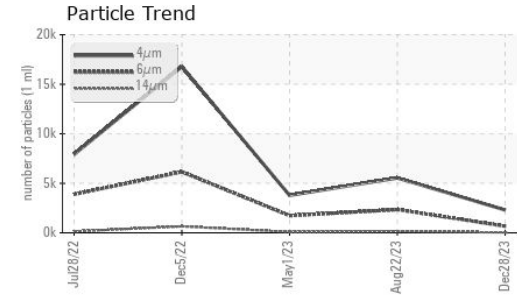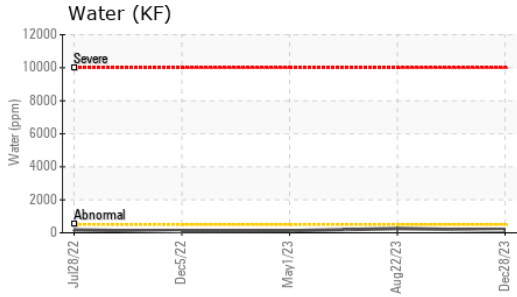






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	45.5	45.2	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

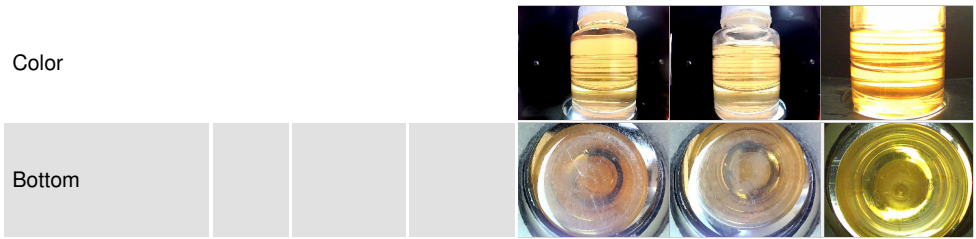

## GRAPHS

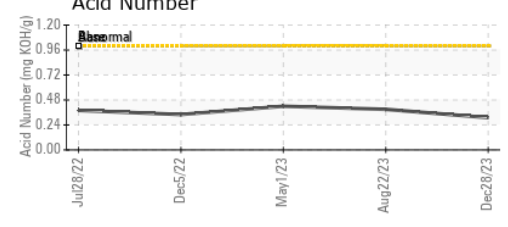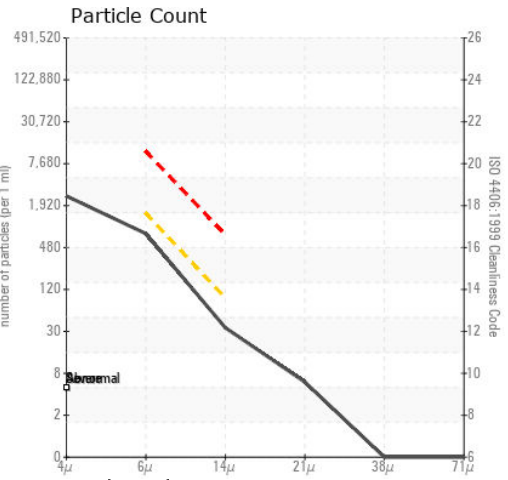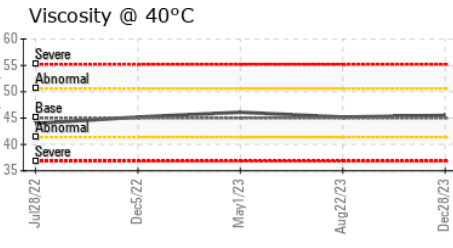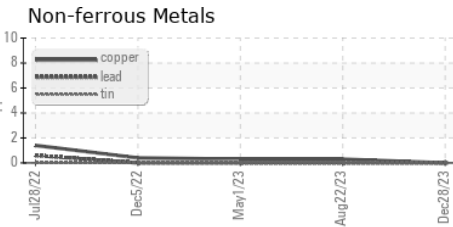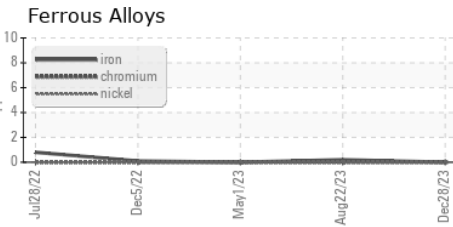

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA011279 **Received** : 10 Jan 2024  
**Lab Number** : 06056711 **Diagnosed** : 11 Jan 2024  
**Unique Number** : 10822660 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON.COM SERVICES**  
 4222 INTERGRATIONS LOOP  
 COLORADO SPRINGS, CO  
 US 80916  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: