


OIL ANALYSIS REPORT

Sample Rating Trend

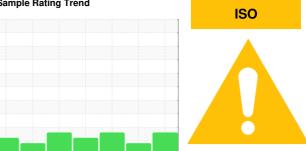

KAESER AS25 6950570 (S/N 1261)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2021	Aug2021 Mar2022	Aug2022 Dec2022 Aug2023	Dec2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121105	KC124465	KC100781
Sample Date		Client Info		27 Dec 2023	15 Aug 2023	01 Dec 2022
Machine Age	hrs	Client Info		8453	7310	5030
Oil Age	hrs	Client Info		0	0	819
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ABNORMAL	MARGINAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	2	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	17	4 0	3
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	24
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	43	24	79
Calcium	ppm	ASTM D5185m	2	0	0	1
Phosphorus	ppm	ASTM D5185m		4	4	4
Zinc	ppm	ASTM D5185m		105	73	10
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		13	5	26
Potassium	ppm	ASTM D5185m	>20	2	3	2
Water	%	ASTM D6304	>0.05	0.015	0.015	0.048
ppm Water	ppm	ASTM D6304	>500	153	153.9	480.9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		27453	249	27906
Particles >6µm		ASTM D7647	>1300	<u> </u>	104	△ 9268
Particles >14μm		ASTM D7647	>80	<u>▲</u> 626	18	<u>400</u>
Particles >21µm		ASTM D7647	>20	<u> </u>	7	4 6
Particles >38μm		ASTM D7647	>4	4	0	3
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	22/20/16	15/14/11	<u>22/20/16</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.34

0.453

0.39



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: KC121105

: 06056718 : 10822667 Test Package : IND 2

Recieved : 10 Jan 2024 Diagnosed : 12 Jan 2024 Diagnostician

: Doug Bogart

15799 MILTON RD GRAND RAPIDS, OH US 43522

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: