

## **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER CSD 75 6756565 (S/N 1575)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

#### Wear

All component wear rates are normal.

#### Contamination

High concentration of visible dirt/debris present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		ug2019 Feb2	020 Jul2020 Feb2021	Oct2021 May2022 Nov2022 May	2023 Nov202	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124820	KC124466	KC111618
Sample Date		Client Info		21 Nov 2023	09 Aug 2023	16 May 2023
Machine Age	hrs	Client Info		29622	26482	26503
Oil Age	hrs	Client Info		0	0	4400
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	7	10
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	0	0	1
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		4	0	1
Zinc	ppm	ASTM D5185m		2	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		<1	2	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.010	0.006	0.005
ppm Water	ppm	ASTM D6304	>500	103	67.3	55.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			572	
Particles >6µm		ASTM D7647	>1300		184	
Particles >14μm		ASTM D7647	>80		24	
Particles >21µm		ASTM D7647	>20		10	
Particles >38µm		ASTM D7647	>4		1	
Particles >71μm		ASTM D7647	>3		0	
Oil Cleanliness		ISO 4406 (c)	>/17/13		16/15/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.35

0.39

0.35



## OIL ANALYSIS REPORT

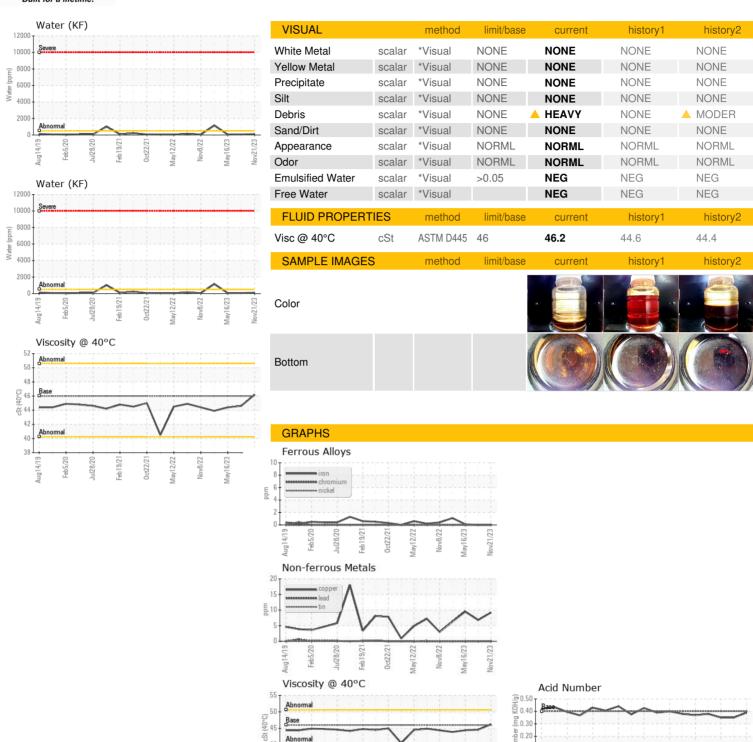





Certificate L2367

Laboratory Sample No. Lab Number Test Package

**Unique Number** 

: KC124820 : 06056722 : 10822671 : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved : 10 Jan 2024 Diagnosed : 11 Jan 2024

May12/22

≥ 0.10 0.00 kg

Nov21/23

Diagnostician : Doug Bogart **POWERS AND SONS LLC** 

1613 MAGDA DR MONTPELIER, OH US 43543

Contact: CAR SERVICE

CARSERVICE@TEAMAIRCENTER.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Feb19/21

T: F: