


OIL ANALYSIS REPORT



ISO



KAESER 1573

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005150		
Sample Date		Client Info		07 Nov 2023		
Machine Age	hrs	Client Info		6160		
Oil Age	hrs	Client Info		0		
Oil Changed	1110	Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	1-1-	method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m	mmobase	0		
Barium	ppm	ASTM D5185m	90	13		
Molybdenum	ppm	ASTM D5185m	90	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	50		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m	_	4		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		17168		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	<i>></i> 20	16		
Potassium		ASTM D5185m	>20	_		
Water	ppm %	ASTM D5165111	>20 >0.05	3 0.015		
ppm Water	ppm	ASTM D6304	>50.03	156		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8782		
Particles >6µm		ASTM D7647	>1300	▲ 2106		
Particles >14µm		ASTM D7647	>80	72		
Particles >21µm		ASTM D7647	>20	13		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	▲ 20/18/13		
FLUID DEGRADA	TION					hiotory?
PLUID DEGRADA	HION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.35



OIL ANALYSIS REPORT

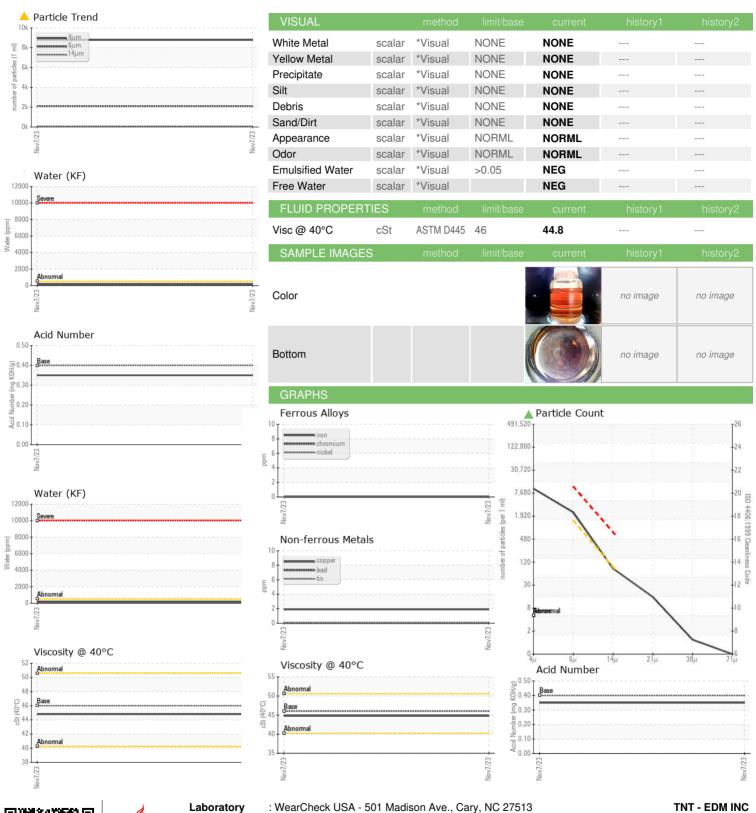



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: KCPA005150 : 06056723

Recieved Diagnosed

: 10822672 Diagnostician : Doug Bogart Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 10 Jan 2024

: 11 Jan 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

47689 E ANCHOR COURT PLYMOUTH, MI

US 48170

Contact: Service Manager

T:

F: