

OIL ANALYSIS REPORT

7947111 (S/N 1164)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Apr2022 May2023 Aug2023 Nov2023					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC120250	KC101215	KC102371
Sample Date		Client Info		29 Nov 2023	24 Aug 2023	01 May 2023
Machine Age	hrs	Client Info		20086	17762	15003
Oil Age	hrs	Client Info		0	2759	6000
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	7	7
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	0	0	<1
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		4	0	1
Zinc	ppm	ASTM D5185m		0	10	0
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	0
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.006	0.010	0.004
ppm Water	ppm	ASTM D6304	>500	67	100.1	43.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		69319	20974	5598
Particles >6µm		ASTM D7647	>1300	10683	△ 6890	1282
Particles >14µm		ASTM D7647	>80	255	▲ 343	64
Particles >21µm		ASTM D7647	>20	43	▲ 76	17
Particles >38µm		ASTM D7647	>4	1	2	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/21/15	<u>22/20/16</u>	20/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42	0.37	0.45



OIL ANALYSIS REPORT

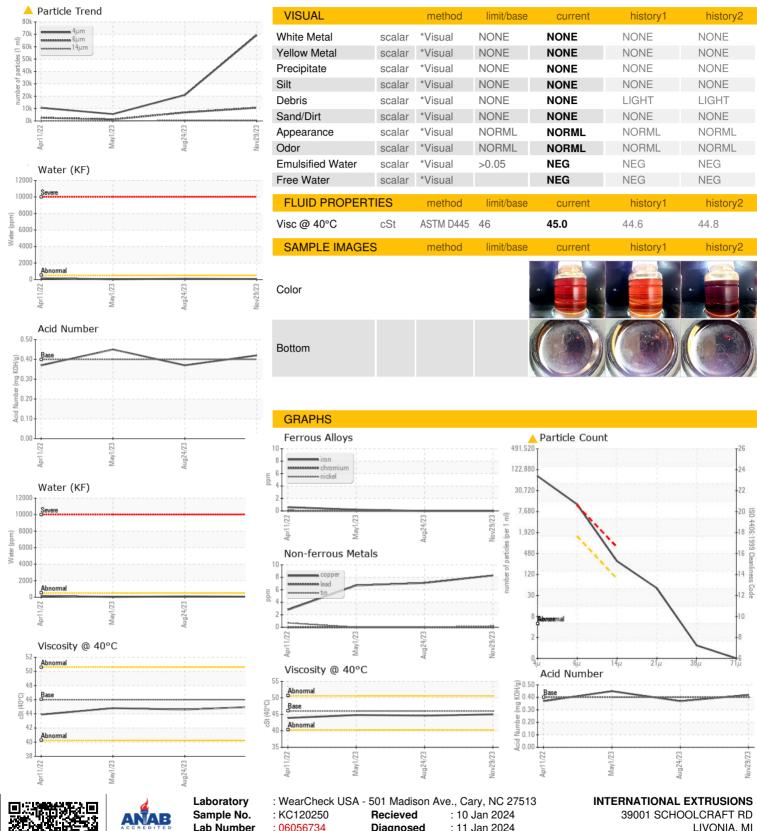





Certificate L2367

Lab Number **Unique Number**

Test Package

: 06056734

: 10822683 : IND 2

Diagnosed

Diagnostician : Doug Bogart LIVONIA, MI US 48150

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: