

OIL ANALYSIS REPORT

Sample Rating Trend



KAESER AS 25 6948816 (S/N 1259)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory data updates to AN results.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2021 A	ug2021 Mar2022 Aug20	22 Dec2022 Apr2023 Aug2023	Dec2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121111	KC124470	KC111777
Sample Date		Client Info		27 Dec 2023	15 Aug 2023	18 Apr 2023
Machine Age	hrs	Client Info		9081	8791	8598
Oil Age	hrs	Client Info		0	0	700
Oil Changed		Client Info		N/A	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	13	6	6
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	4	22
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	55	52	69
Calcium	ppm	ASTM D5185m	2	0	6	<1
Phosphorus	ppm	ASTM D5185m		4	6	0
Zinc	ppm	ASTM D5185m		79	19	22
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	0
Sodium	ppm	ASTM D5185m		14	13	21
Potassium	ppm	ASTM D5185m	>20	3	7	6
Water	%	ASTM D6304	>0.05	0.016	△ 0.246	0.037
ppm Water	ppm	ASTM D6304	>500	163	<u>^</u> 2460	371.6
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		42944	2962	
Particles >6µm		ASTM D7647	>1300	<u> </u>	270	
Particles >14μm		ASTM D7647	>80	<u> </u>	12	
Particles >21µm		ASTM D7647	>20	△ 324	3	
Particles >38µm		ASTM D7647	>4	<u> </u>	0	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 23/21/17	19/15/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.32

0.463

0.40



OIL ANALYSIS REPORT

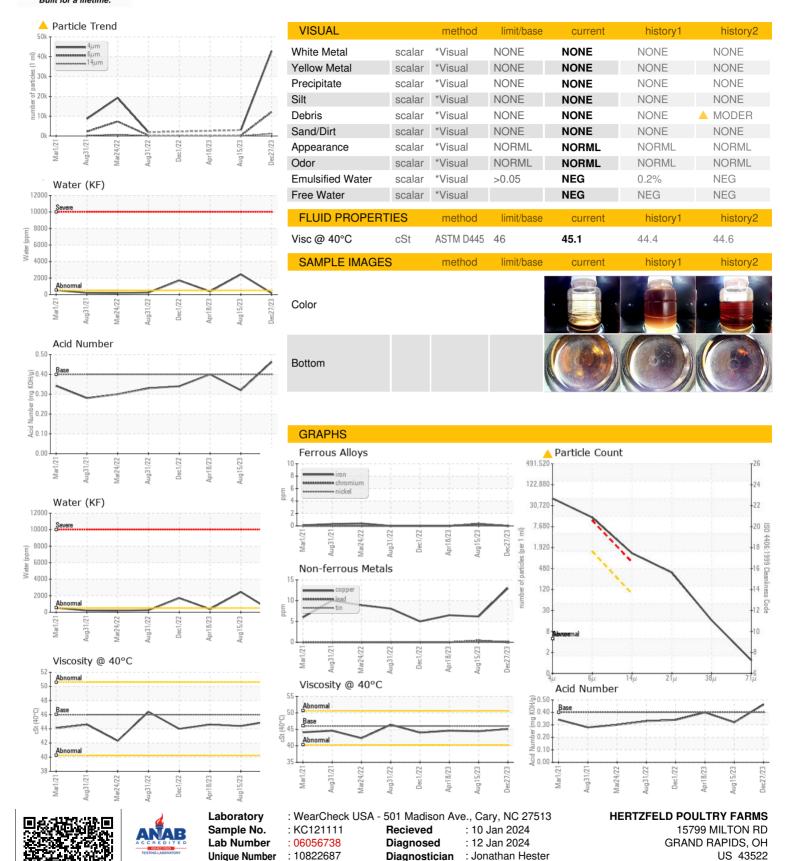

Certificate L2367

Test Package

: IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Contact: Service Manager