


OIL ANALYSIS REPORT

ROTO XTEND Machine Id ATLAS COPCO API337749 - PRECISION WALL

Component

Compressor



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Janzuza		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCS06056806		
Sample Date		Client Info		02 Jan 2024		
Machine Age	hrs	Client Info		8955		
Oil Age	hrs	Client Info		1413		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		30		
Zinc	ppm	ASTM D5185m		57		
Sulfur	ppm	ASTM D5185m		48		
CONTAMINANTS	8	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.14		

Sullivan

OIL ANALYSIS REPORT

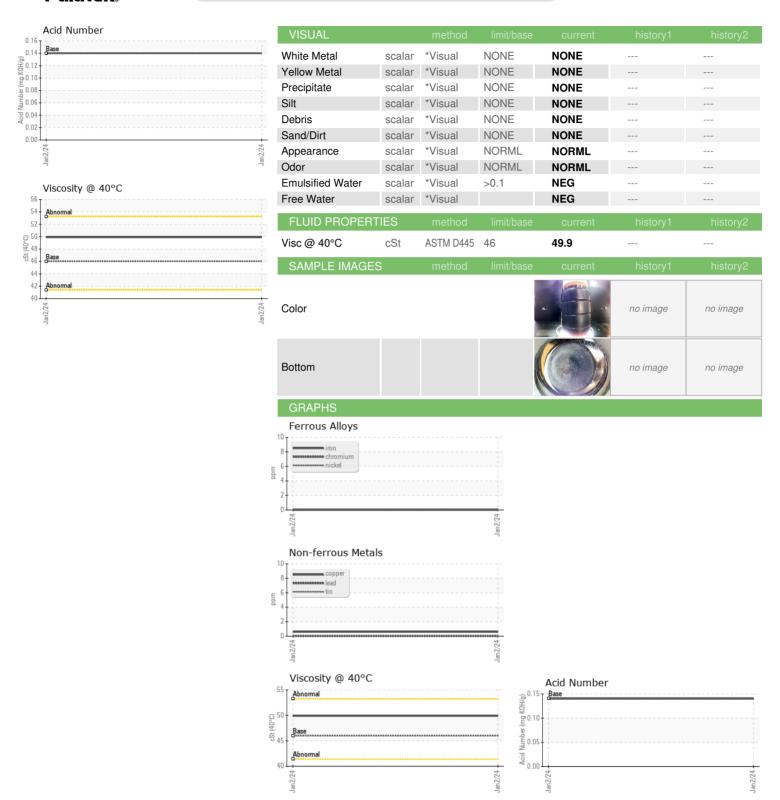





Certificate L2367

Unique Number

Laboratory Sample No. Lab Number

: 06056806 : 10822755 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 10 Jan 2024 : UCS06056806 Recieved Diagnosed : 11 Jan 2024

: Don Baldridge Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **JEMCO-MAXAIR**

WEST FARGO, ND US 58078 Contact: DALE K

dalek@jemco-maxair.com

T: (701)281-0362 F: x: