


Area
AC3
Machine Id
QUINCY UTY105071 - FARGO VA
Component
Compressor

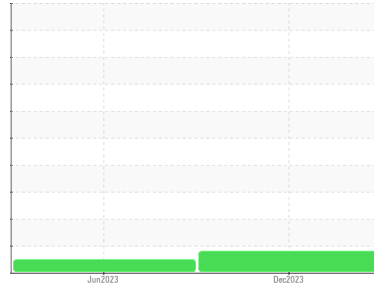

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The lead level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	UCS06056813	UCS05887921	---
Sample Date	Client Info	27 Dec 2023	23 Jun 2023	---
Machine Age	mths	Client Info	0	0
Oil Age	mths	Client Info	12	0
Oil Changed	Client Info	Changed	Changed	---
Sample Status		ATTENTION	NORMAL	---

CONTAMINATION method limit/base current history1 history2

Water	WC Method	>0.1	NEG	NEG	---
-------	-----------	------	------------	-----	-----

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<1	2	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	<1	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	<1	---
Lead	ppm	ASTM D5185m	>25	▲ 78	3	---
Copper	ppm	ASTM D5185m	>50	1	2	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	14	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	13	---
Calcium	ppm	ASTM D5185m		100	45	---
Phosphorus	ppm	ASTM D5185m		1689	887	---
Zinc	ppm	ASTM D5185m		1887	1019	---
Sulfur	ppm	ASTM D5185m		4120	3477	---

CONTAMINANTS method limit/base current history1 history2


Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		0	<1	---
Potassium	ppm	ASTM D5185m	>20	0	0	---

FLUID DEGRADATION method limit/base current history1 history2


Acid Number (AN)	mg KOH/g	ASTM D8045		2.15	1.37	---
------------------	----------	------------	--	-------------	------	-----

OIL ANALYSIS REPORT


▲ Non-ferrous Metals

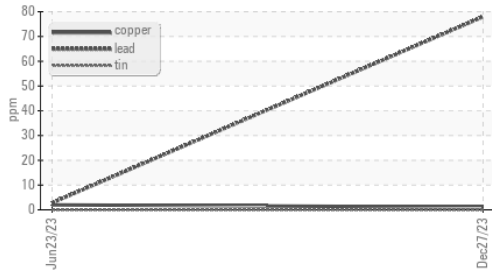

Acid Number

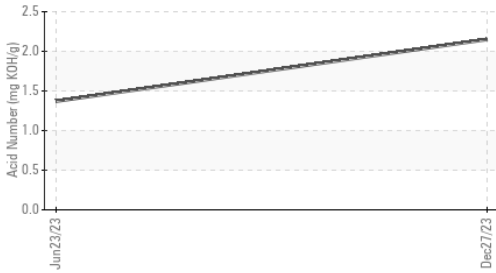


Viscosity @ 40°C

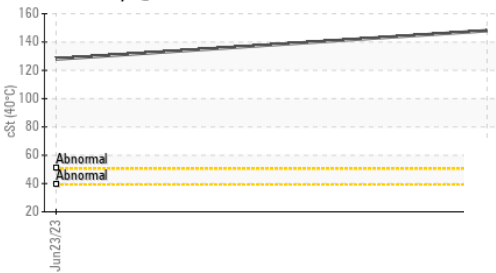

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	148	128	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

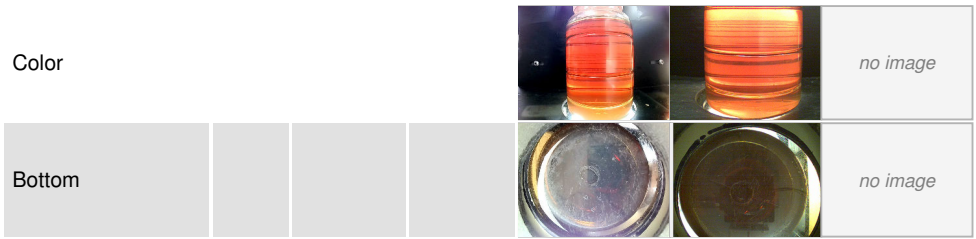


GRAPHS


▲ Ferrous Alloys

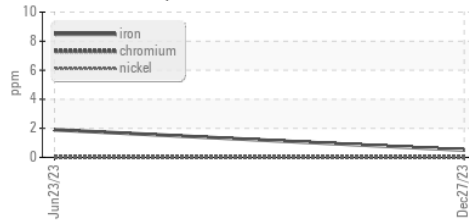


▲ Non-ferrous Metals

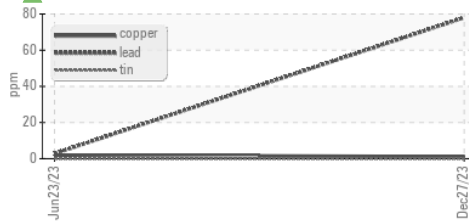

Viscosity @ 40°C

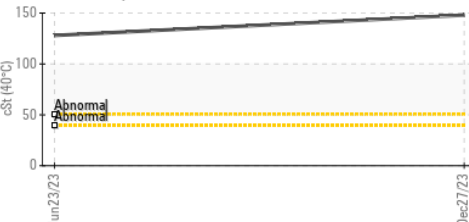

Acid Number

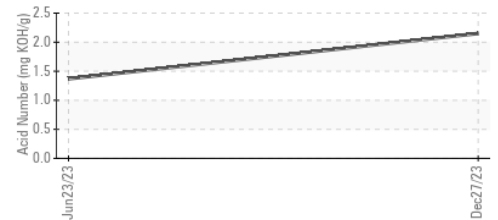

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06056813 **Recieved** : 10 Jan 2024
Lab Number : **06056813** **Diagnosed** : 11 Jan 2024
Unique Number : 10822762 **Diagnostician** : Don Baldrige
Test Package : IND 2

JEMCO-MAXAIR

WEST FARGO, ND
 US 58078
 Contact: DALE K
 dalek@jemco-maxair.com
 T: (701)281-0362
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)