




# OIL ANALYSIS REPORT

Sample Rating Trend

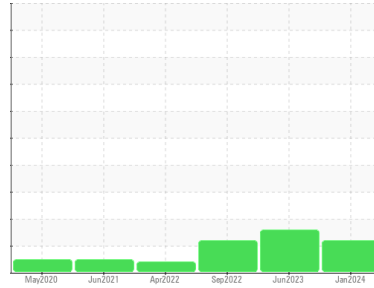

ISO



Machine Id  
**6458789 (S/N 1244)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA010090</b>	KCP53204	KCP46300
Sample Date	Client Info			<b>04 Jan 2024</b>	21 Jun 2023	15 Sep 2022
Machine Age	hrs	Client Info		<b>24849</b>	22211	18348
Oil Age	hrs	Client Info		<b>0</b>	3000	6000
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	2	4
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>32</b>	62	37
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>84</b>	79	61
Calcium	ppm	ASTM D5185m	2	<b>3</b>	0	3
Phosphorus	ppm	ASTM D5185m		<b>28</b>	0	1
Zinc	ppm	ASTM D5185m		<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m		<b>20202</b>	25825	19408

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>24</b>	12	36
Potassium	ppm	ASTM D5185m	>20	<b>8</b>	2	12
Water	%	ASTM D6304	>0.05	<b>0.021</b>	0.025	0.028
ppm Water	ppm	ASTM D6304	>500	<b>212</b>	250.5	286.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5050</b>	14189	14143
Particles >6µm		ASTM D7647	>1300	<b>▲ 1762</b>	▲ 3553	▲ 3546
Particles >14µm		ASTM D7647	>80	<b>▲ 85</b>	▲ 208	▲ 131
Particles >21µm		ASTM D7647	>20	<b>11</b>	▲ 56	18
Particles >38µm		ASTM D7647	>4	<b>1</b>	3	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	▲ 21/19/15	▲ 21/19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.30</b>	0.40	0.39

# OIL ANALYSIS REPORT

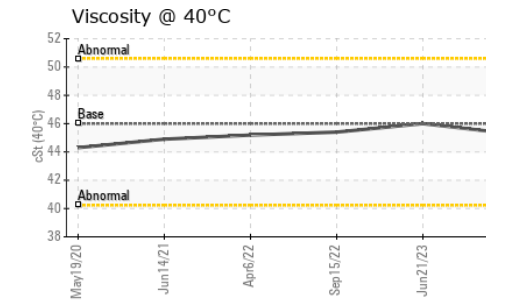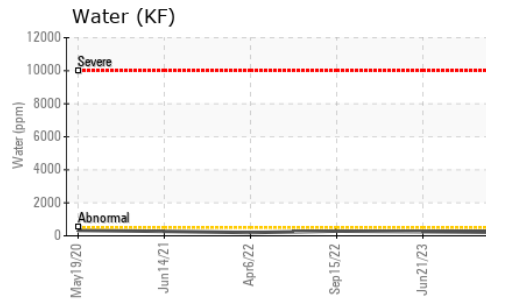
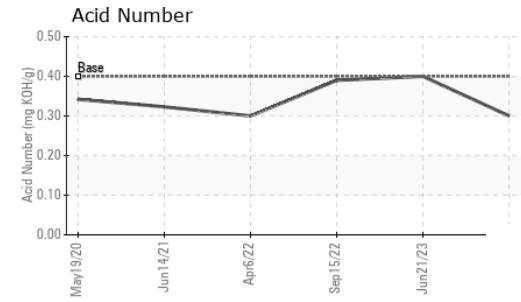
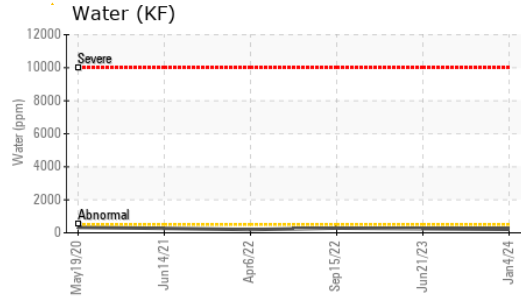
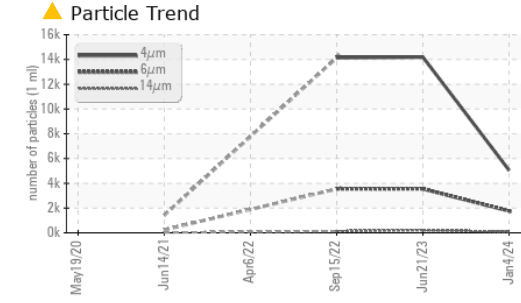


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.3	46.0	45.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

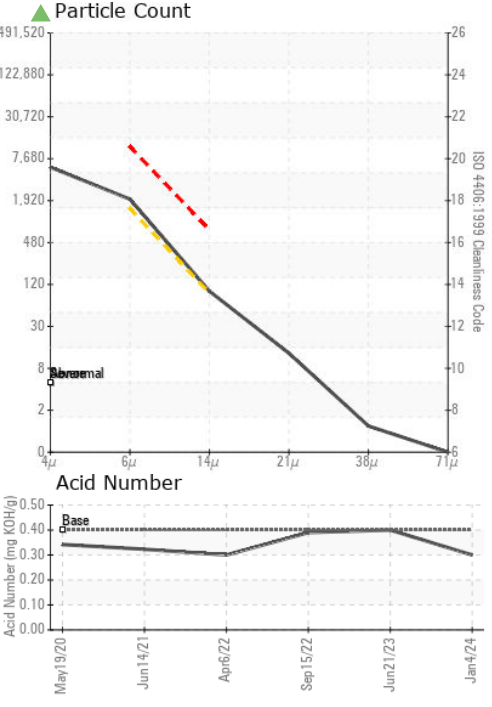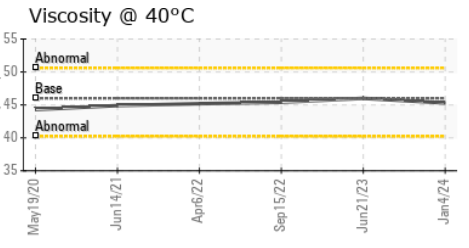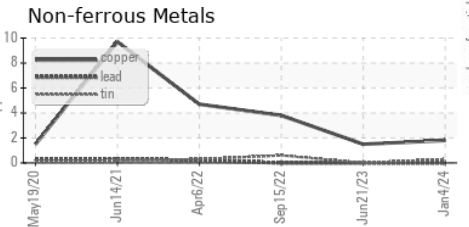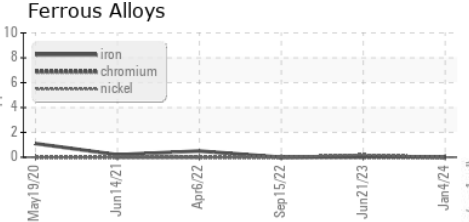

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA010090 **Received** : 10 Jan 2024  
**Lab Number** : 06057358 **Diagnosed** : 12 Jan 2024  
**Unique Number** : 10823307 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON**  
 8000 TUCKASEEGEE RD  
 CHARLOTTE, NC  
 US 28214  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: