


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



8804449 (S/N 1081)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun2023	Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126698	KC107732	
Sample Date		Client Info		05 Jan 2024	13 Jun 2023	
Machine Age	hrs	Client Info		7475	3578	
Oil Age	hrs	Client Info		0	3578	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	3	3	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	56	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	39	48	
Calcium	ppm	ASTM D5185m	2	0	2	
Phosphorus	ppm	ASTM D5185m		27	<1	
Zinc	ppm	ASTM D5185m		0	5	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6	0	
Sodium	ppm	ASTM D5185m		8	8	
Potassium	ppm	ASTM D5185m	>20	6	7	
Water	%	ASTM D6304	>0.05	0.010	0.014	
ppm Water	ppm	ASTM D6304	>500	105	145.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2484	1530	
Particles >6µm		ASTM D7647	>1300	518	506	
Particles >14μm		ASTM D7647	>80	17	55	
Particles >21µm		ASTM D7647	>20	3	19	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/11	18/16/13	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.41

0.38



## **OIL ANALYSIS REPORT**

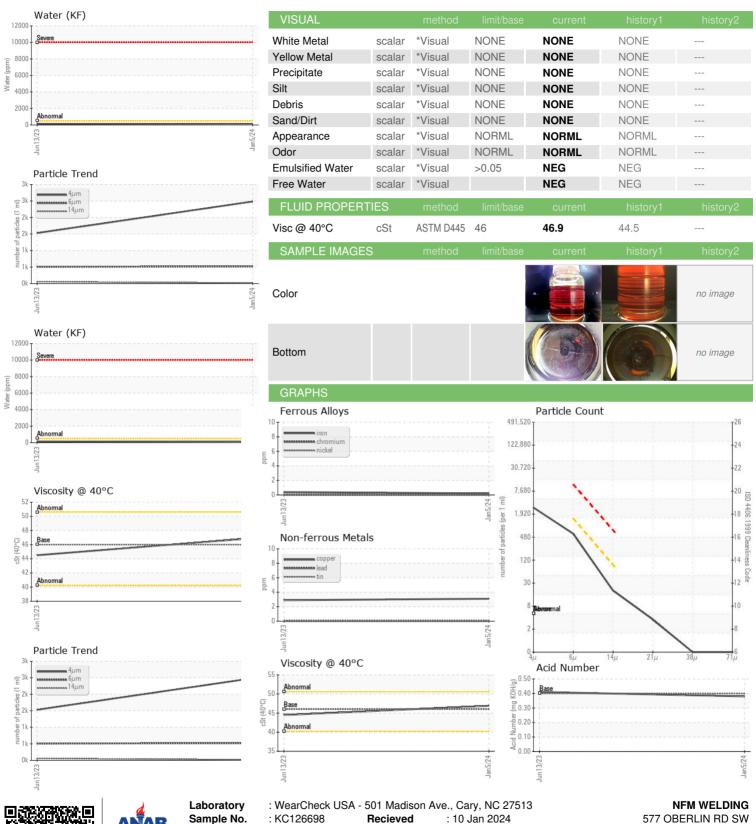



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC126698 : 06057359 : 10823308

: IND 2

Recieved Diagnosed

: 12 Jan 2024 Diagnostician : Don Baldridge 577 OBERLIN RD SW MASSILLON, OH US 44647

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: