



OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area

[203921]

Machine Id

MYCOM BLAST FREEZE (S/N 2515090)

Component

Refrigeration Compressor

Fluid

ISEL NXT 717 (110 GAL)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. OIL FILTERS NEED TO CHANGED EVERY 100 HOURS

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP230231	---	---
Sample Date	Client Info	06 Jan 2024	---	---
Machine Age	hrs Client Info	9352	---	---
Oil Age	hrs Client Info	500	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>8	<1	---	---
Chromium ppm ASTM D5185m	>2	0	---	---
Nickel ppm ASTM D5185m		0	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>3	0	---	---
Lead ppm ASTM D5185m	>2	0	---	---
Copper ppm ASTM D5185m	>8	0	---	---
Tin ppm ASTM D5185m	>4	0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m		<1	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m		0	---	---
Zinc ppm ASTM D5185m		0	---	---
Sulfur ppm ASTM D5185m		0	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	0	---	---
Sodium ppm ASTM D5185m		0	---	---
Potassium ppm ASTM D5185m	>20	<1	---	---
Water % ASTM D6304	>0.01	0.003	---	---
ppm Water ppm ASTM D6304	>100	31	---	---

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	▲ 25387	---	---
Particles >6µm ASTM D7647	>2500	▲ 6610	---	---
Particles >14µm ASTM D7647	>320	271	---	---
Particles >21µm ASTM D7647	>80	41	---	---
Particles >38µm ASTM D7647	>20	0	---	---
Particles >71µm ASTM D7647	>4	0	---	---
Oil Cleanliness ISO 4406 (c)	>20/18/15	▲ 22/20/15	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D974		0.014	---	---



OIL ANALYSIS REPORT

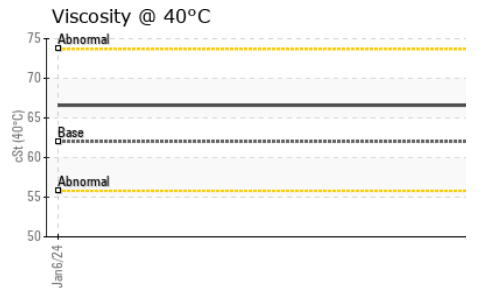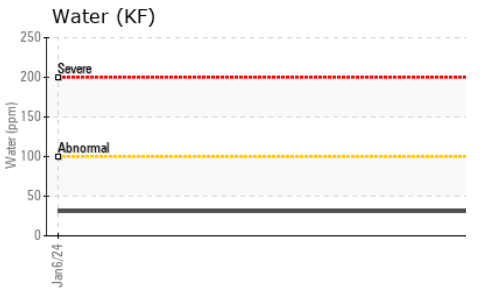
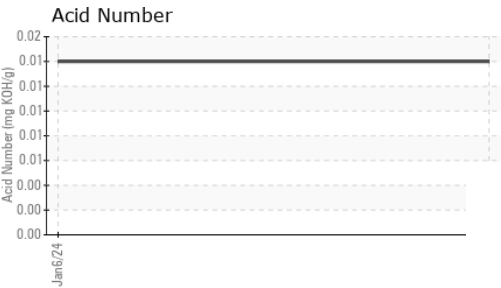
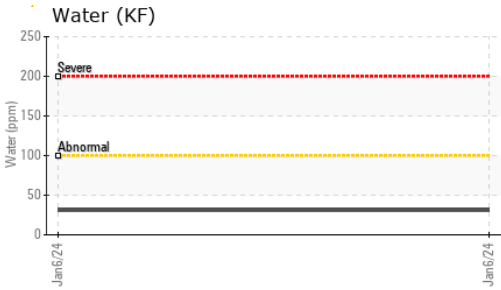
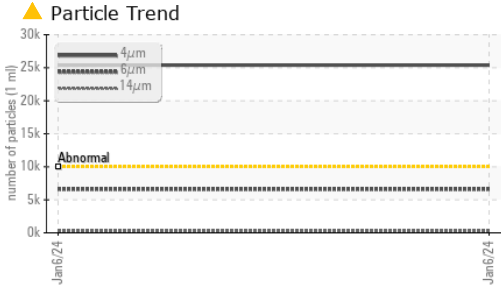


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	62	66.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

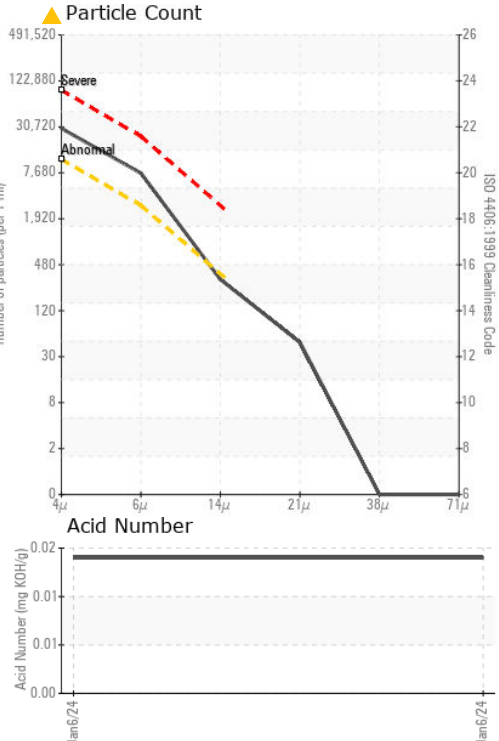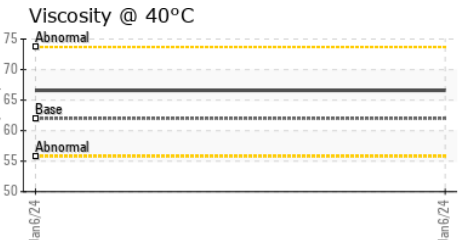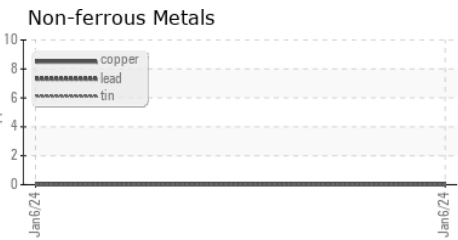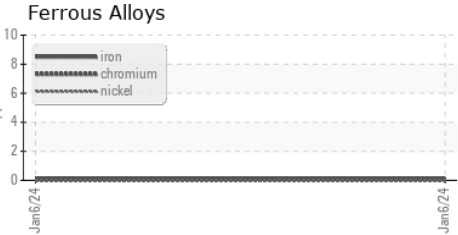

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP230231 **Received** : 10 Jan 2024
Lab Number : 06057375 **Diagnosed** : 11 Jan 2024
Unique Number : 10823324 **Diagnostician** : Doug Bogart
Test Package : IND 2

ICEBERG AIR CONDITIONING AND HEATING
 1101 NW 42ND ST NW
 WINTER HAVEN, FL
 US 33881
 Contact: MIKE BREWNER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)