




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

Area
CSC SOUTH [FA-8706]
 Machine Id
MYCOM COMPRESSOR 1 - CSC SOUTH (S/N 11795)
 Component
Screw Compressor
 Fluid
SUMMIT RHT-68 (--- GAL)

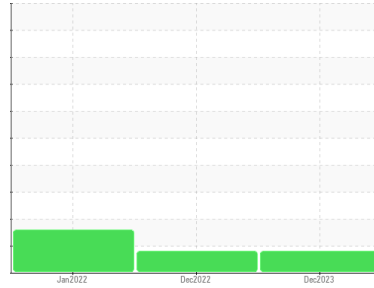

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0807637	WC0712676	WC0578675
Sample Date	Client Info		28 Dec 2023	16 Dec 2022	05 Jan 2022
Machine Age	hrs	Client Info	7651	5395	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	MARGINAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	19	12	22
Chromium	ppm	ASTM D5185m >4	<1	<1	1
Nickel	ppm	ASTM D5185m	<1	0	<1
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	▲ 25	▲ 12	▲ 27
Lead	ppm	ASTM D5185m >10	<1	<1	1
Copper	ppm	ASTM D5185m >30	15	9	18
Tin	ppm	ASTM D5185m >15	5	7	13
Antimony	ppm	ASTM D5185m	---	---	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	2	0	1
Calcium	ppm	ASTM D5185m	22	13	30
Phosphorus	ppm	ASTM D5185m	27	2	2
Zinc	ppm	ASTM D5185m	0	6	3
Sulfur	ppm	ASTM D5185m	0	90	11

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	6	3	5
Sodium	ppm	ASTM D5185m	0	1	0
Potassium	ppm	ASTM D5185m >20	1	0	0
Water	%	ASTM D6304 >0.1	0.006	0.007	0.002
ppm Water	ppm	ASTM D6304 >1000	69	72.3	21.2

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.095	0.03	0.059




OIL ANALYSIS REPORT

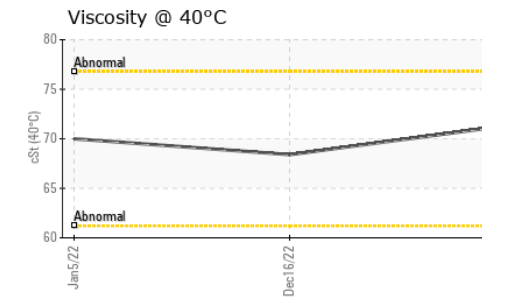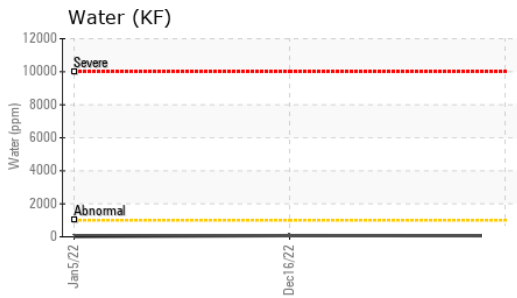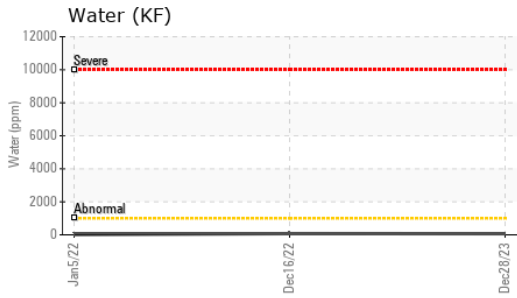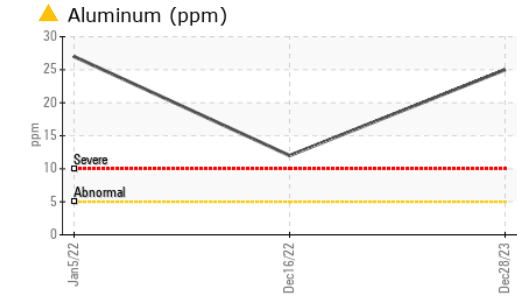






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	71.3	68.4	70.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

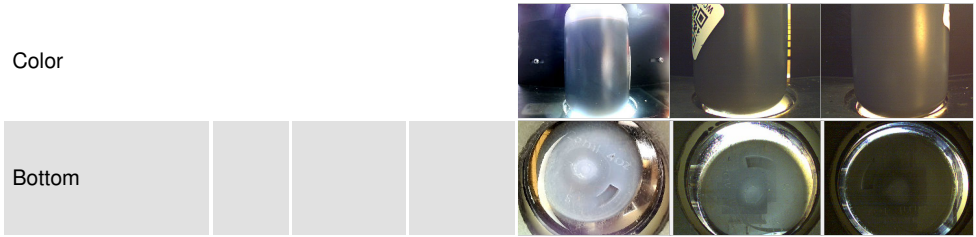

GRAPHS

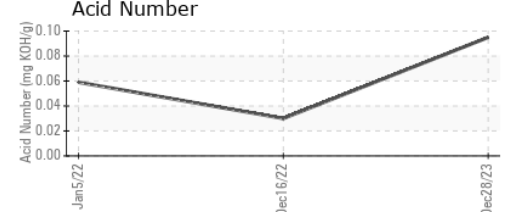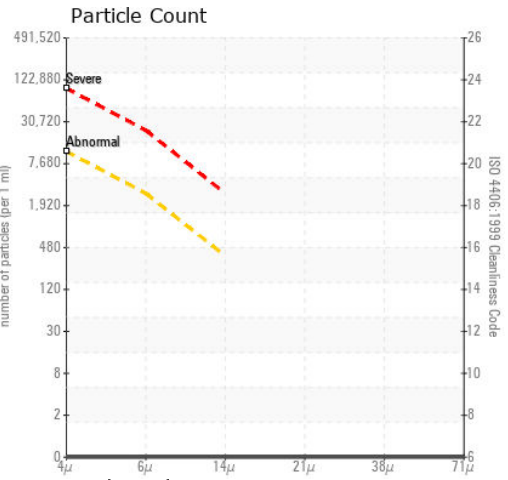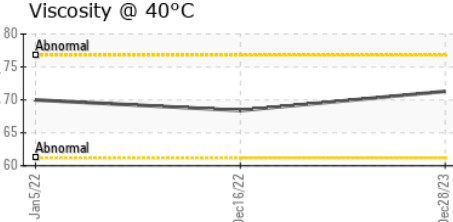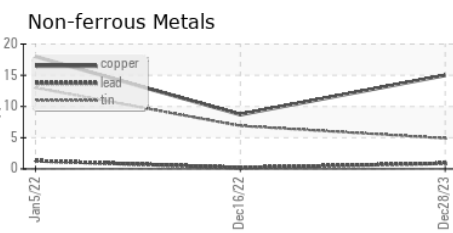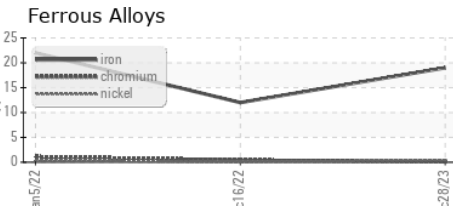

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807637 **Received** : 10 Jan 2024
Lab Number : 06057384 **Diagnosed** : 15 Jan 2024
Unique Number : 10823333 **Diagnostician** : Jonathan Hester
Test Package : PLANT

SCHRADER MECHANICAL
 1015 BLACK DIAMOND WAY
 LODI PROVINCE, CA
 US 95240
 Contact: Schrader Mechanical
 amanda.h@smiwest.com
 T: (209)369-6888
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)