




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

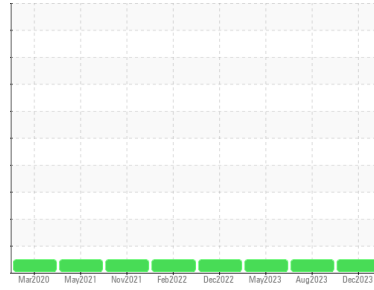

Area  
**SYNOIL 8K**  
 Machine Id  
**QUINCY 94810H - JOHN CRANE INC**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ06057425</b>	UCZ05943730	UCZ05880262
Sample Date	Client Info			<b>28 Dec 2023</b>	24 Aug 2023	05 May 2023
Machine Age	hrs	Client Info		<b>43127</b>	141796	143127
Oil Age	hrs	Client Info		<b>2000</b>	1000	2000
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>7</b>	2	4
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	0	2
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>3</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.8	<b>0</b>	5	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.9	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	409	<b>437</b>	356	393
Zinc	ppm	ASTM D5185m	0	<b>0</b>	8	0
Sulfur	ppm	ASTM D5185m	1290	<b>1059</b>	1154	1209

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	2	<1
Sodium	ppm	ASTM D5185m		<b>1</b>	0	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	<b>0.74</b>	0.50	0.70




# OIL ANALYSIS REPORT

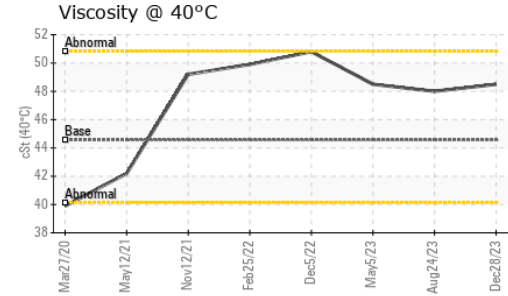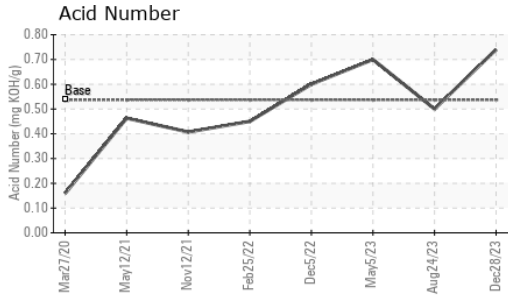





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>MODER</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.56	<b>48.5</b>	48.0	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

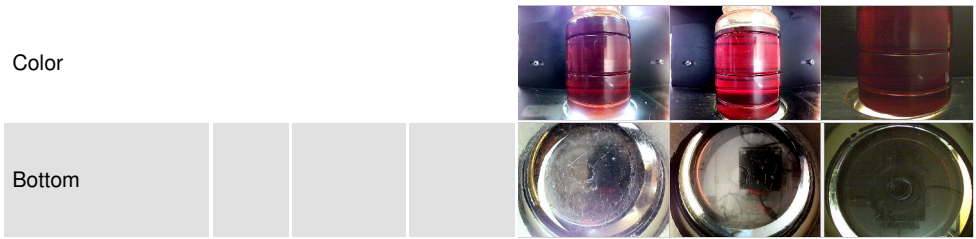

## GRAPHS

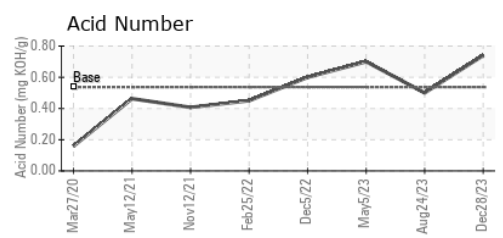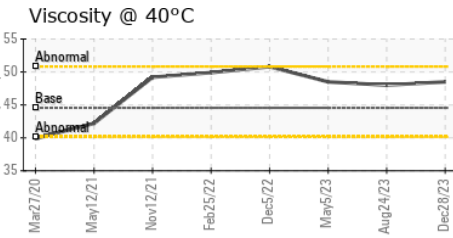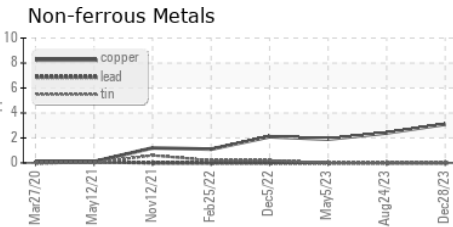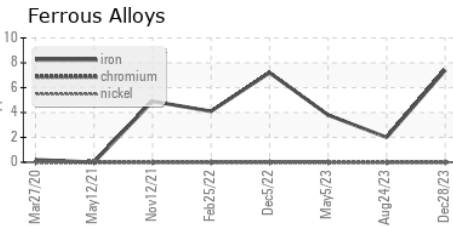

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06057425 **Recieved** : 10 Jan 2024  
**Lab Number** : 06057425 **Diagnosed** : 12 Jan 2024  
**Unique Number** : 10823374 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ZORN COMPRESSOR EQUIPMENT**  
 227 AMBROSIO DR, SUITE A  
 GURNEE, IL  
 US 60031  
 Contact: Rachel Pesnikov  
 rachel.pesnikov@zornair.com  
 T: (847)599-1333  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)