




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

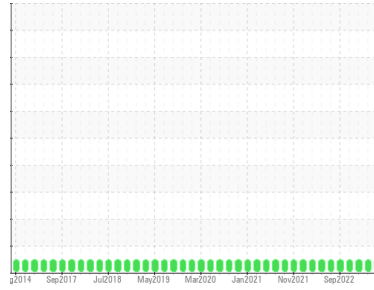

Machine Id  
**TURBINE-2**

Component  
**Turbine**

Fluid  
**MOBIL SHC 824 (275 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0745744</b>	WC0745738	WC0745732
Sample Date	Client Info			<b>18 May 2023</b>	02 Mar 2023	05 Jan 2023
Machine Age	hrs	Client Info		<b>43949</b>	42118	174111
Oil Age	hrs	Client Info		<b>43949</b>	42118	40774
Oil Changed	Client Info			<b>Not Changed</b>	N/A	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.03	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m		<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	4	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>0</b>	6	0
Phosphorus	ppm	ASTM D5185m		<b>811</b>	823	750
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	70	80

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>3</b>	0	1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>280</b>	86	235
Particles >6µm		ASTM D7647	>1300	<b>105</b>	27	85
Particles >14µm		ASTM D7647	>160	<b>17</b>	3	14
Particles >21µm		ASTM D7647	>40	<b>5</b>	1	4
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/17/14	<b>15/14/11</b>	14/12/9	15/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	<b>0.23</b>	0.22	0.19




# OIL ANALYSIS REPORT


**Particle Trend**

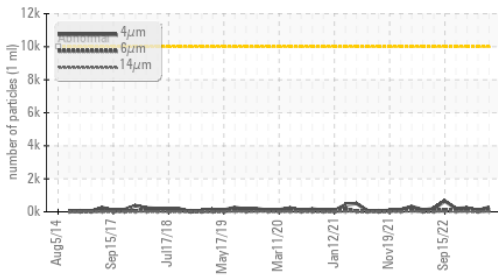


**Acid Number**

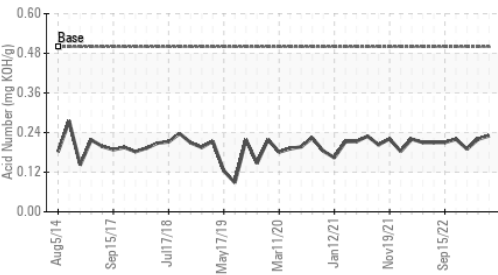

**Viscosity @ 40°C**

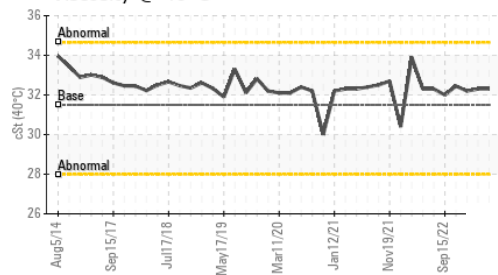


**Particle Trend**

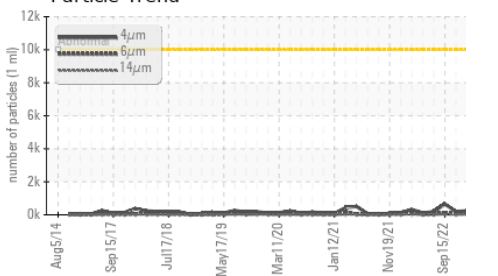






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	31.5	<b>32.3</b>	32.3	32.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

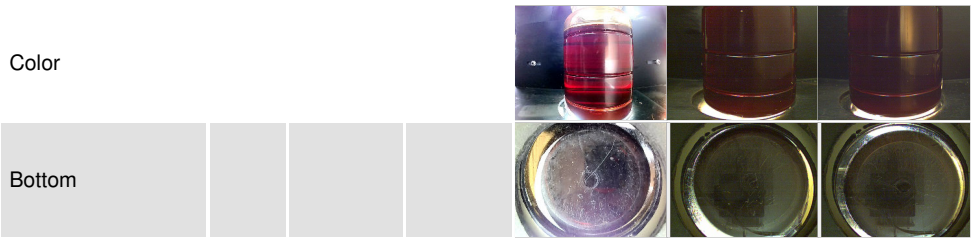

## GRAPHS

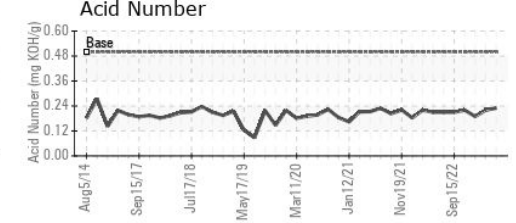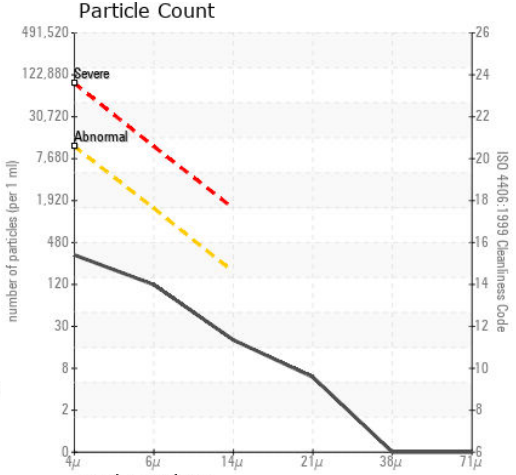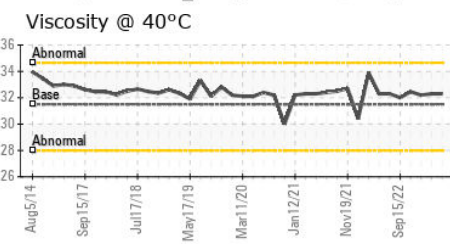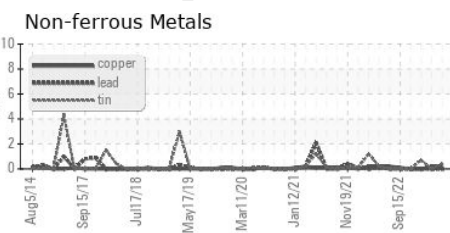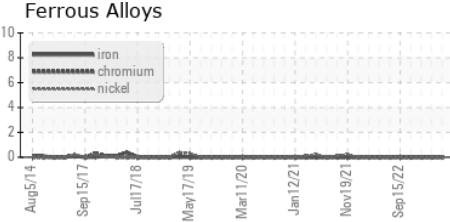

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0745744 **Received** : 11 Jan 2024  
**Lab Number** : 06058074 **Diagnosed** : 12 Jan 2024  
**Unique Number** : 10829456 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**GREENE VALLEY LANDFILL**  
 9 SOUTH 610 GREENE ROAD  
 NAPERVILLE, IL  
 US 60565  
 Contact: CHRIS ADEN  
 caden@wm.com  
 T: (630)743-4479  
 F: (630)983-1535

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)