



OIL ANALYSIS REPORT

Sample Rating Trend


ISO



Machine Id
ROOTS-2

Component
Compressor

Fluid
MOBIL SHC 629 (20 GAL)

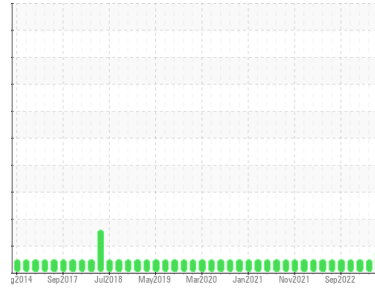

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0745747	WC0745741	WC0745735
Sample Date	Client Info		18 May 2023	02 Mar 2023	05 Jan 2023
Machine Age	hrs	Client Info	41258	39427	38093
Oil Age	hrs	Client Info	41258	39427	38093
Oil Changed		Client Info	Not Chngd	Not Chngd	Not Chngd
Sample Status			ATTENTION	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0
Chromium	ppm	ASTM D5185m	>10	0	0
Nickel	ppm	ASTM D5185m		0	0
Titanium	ppm	ASTM D5185m		<1	0
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>25	2	<1
Lead	ppm	ASTM D5185m	>25	0	0
Copper	ppm	ASTM D5185m	>50	<1	0
Tin	ppm	ASTM D5185m	>15	<1	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		0	0
Molybdenum	ppm	ASTM D5185m		<1	0
Manganese	ppm	ASTM D5185m		0	0
Magnesium	ppm	ASTM D5185m		0	<1
Calcium	ppm	ASTM D5185m		0	1
Phosphorus	ppm	ASTM D5185m		524	490
Zinc	ppm	ASTM D5185m		0	5
Sulfur	ppm	ASTM D5185m		0	1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	20	21
Sodium	ppm	ASTM D5185m		0	0
Potassium	ppm	ASTM D5185m	>20	1	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	5252	342	332
Particles >6µm	ASTM D7647	>2500	▲ 2772	82	85
Particles >14µm	ASTM D7647	>320	33	4	8
Particles >21µm	ASTM D7647	>80	10	1	2
Particles >38µm	ASTM D7647	>20	1	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/18/15	▲ 20/19/12	16/14/9	16/14/10


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.54	0.56




OIL ANALYSIS REPORT


▲ Particle Trend

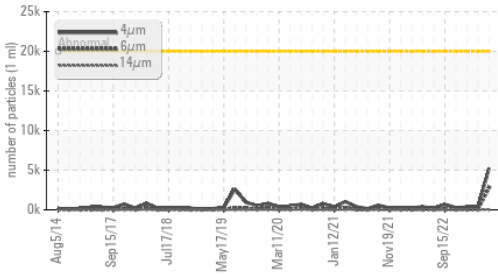


▲ Particle Trend

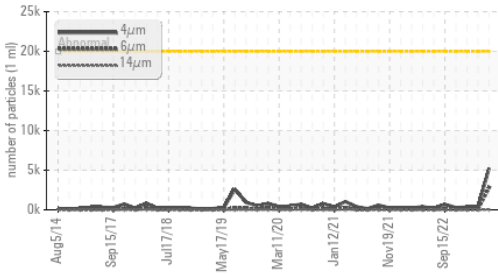

Acid Number

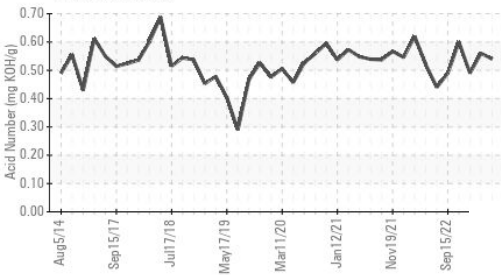

Viscosity @ 40°C

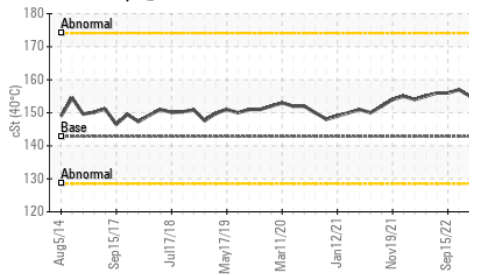


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	142.8	156	155

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

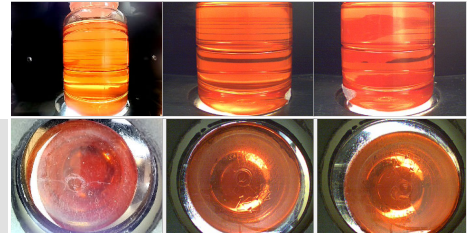


Bottom

GRAPHS


Ferrous Alloys

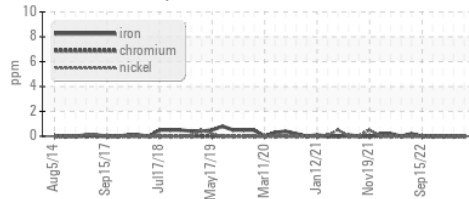


Non-ferrous Metals

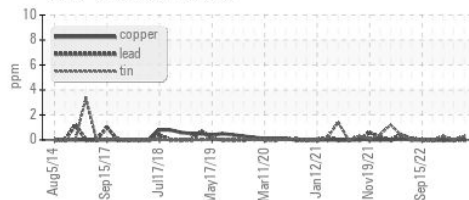


Viscosity @ 40°C

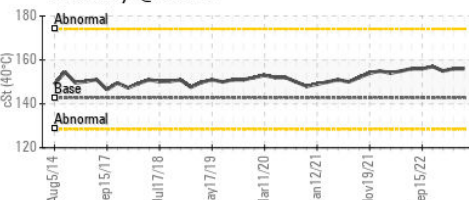

▲ Particle Count

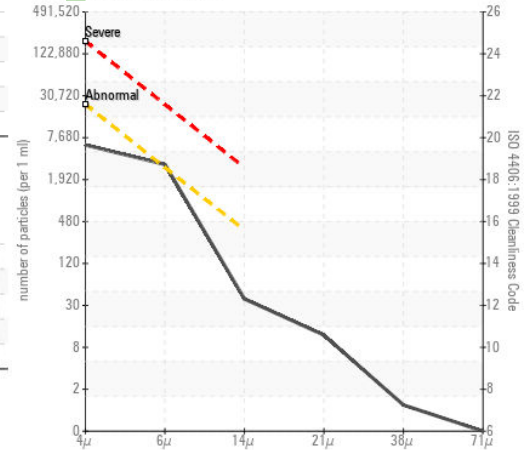

Acid Number

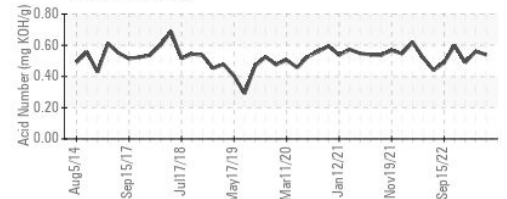

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0745747 Recieved : 11 Jan 2024
 Lab Number : 06058076 Diagnosed : 12 Jan 2024
 Unique Number : 10829458 Diagnostician : Don Baldrige
 Test Package : IND 2 (Additional Tests: PrtCount)

GREENE VALLEY LANDFILL
 9 SOUTH 610 GREENE ROAD
 NAPERVILLE, IL
 US 60565
 Contact: CHRIS ADEN
 caden@wm.com
 T: (630)743-4479
 F: (630)983-1535

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)