


**OIL ANALYSIS REPORT** 

4302434 (S/N 1729)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

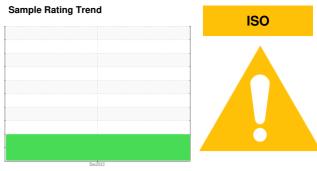

# **DIAGNOSIS**

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

# Contamination

There is a high amount of particulates present in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2023		
SAMPLE INFORT	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010154		
Sample Date		Client Info		23 Dec 2023		
Machine Age	hrs	Client Info		32827		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	-	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	<1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	25		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	23500	16504		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.006		
opm Water	ppm	ASTM D6304	>500	63		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9544		
Particles >6µm		ASTM D7647	>1300	<b>4</b> 3974		
Particles >14µm		ASTM D7647	>80	<b>481</b>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<u>^</u> 5		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma K∩U/a	VSTM D804E	1.0	0.31		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.31



# **OIL ANALYSIS REPORT**

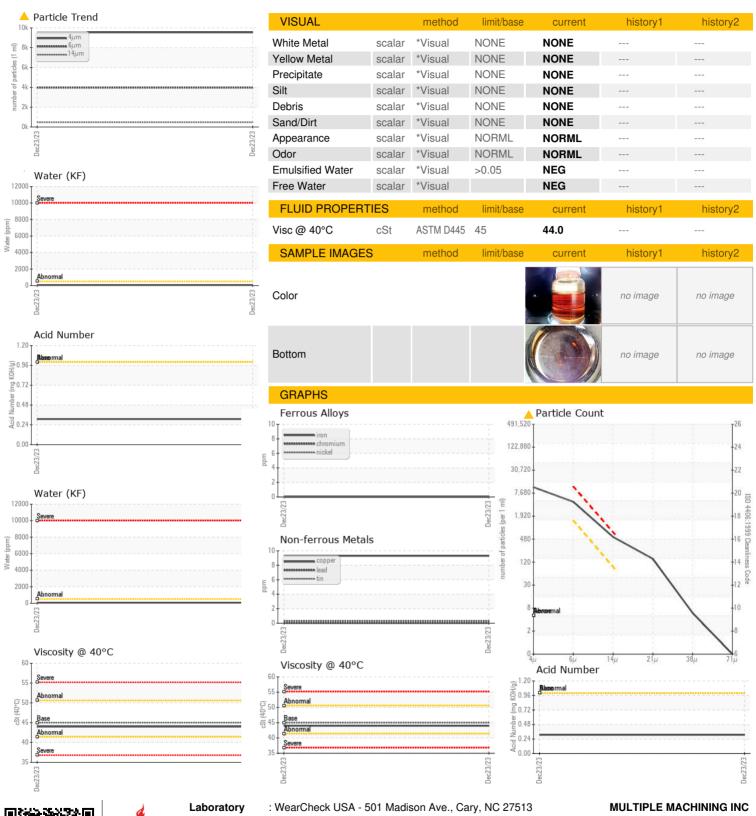



Sample No. Lab Number **Unique Number** 

: KCPA010154

: 06058091 : 10829473

Recieved : 11 Jan 2024 Diagnosed : 12 Jan 2024 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

10150 LENOVER ST VEVAY, IN US 47089

Contact: Service Manager

T: F: