


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

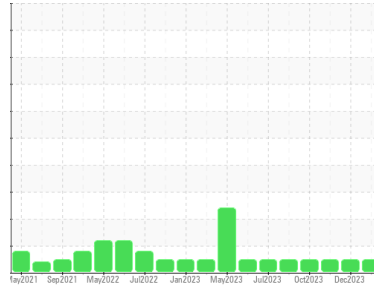

Area
C-4001B
Machine Id
C-4001B
Component
Compressor
Fluid
{not provided} (--- LTR)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO60000700	TO60000698	TO60000701
Sample Date	Client Info		08 Jan 2024	06 Dec 2023	21 Nov 2023
Machine Age	hrs	Client Info	18123	17383	17018
Oil Age	hrs	Client Info	18123	17383	17018
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	3	5
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	0	1
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	<1	<1	<1
Tin	ppm	ASTM D5185m >15	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	4	1	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m	0	3	2
Calcium	ppm	ASTM D5185m	0	2	1
Phosphorus	ppm	ASTM D5185m	520	586	640
Zinc	ppm	ASTM D5185m	11	6	2
Sulfur	ppm	ASTM D5185m	495	584	520

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	2	1
Sodium	ppm	ASTM D5185m	2	4	0
Potassium	ppm	ASTM D5185m >20	0	2	1
Water	%	ASTM D6304 >0.1	0.003	0.006	0.006
ppm Water	ppm	ASTM D6304 >1000	37	61	61






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	4445	3509	5587
Particles >6µm	ASTM D7647	>2500	926	439	712
Particles >14µm	ASTM D7647	>320	27	53	35
Particles >21µm	ASTM D7647	>80	6	29	10
Particles >38µm	ASTM D7647	>20	1	1	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/17/12	19/16/13	20/17/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.797	0.825	0.80


OIL ANALYSIS REPORT

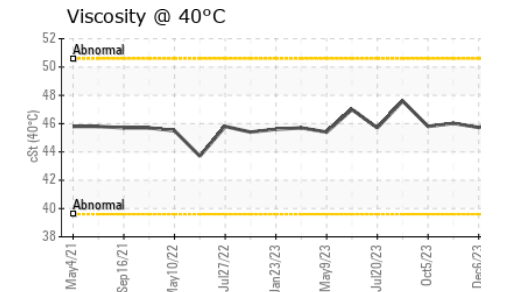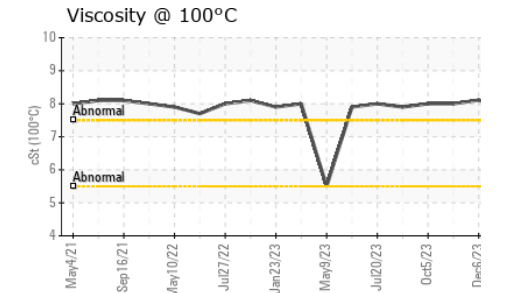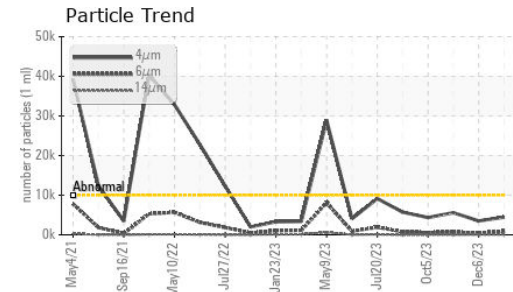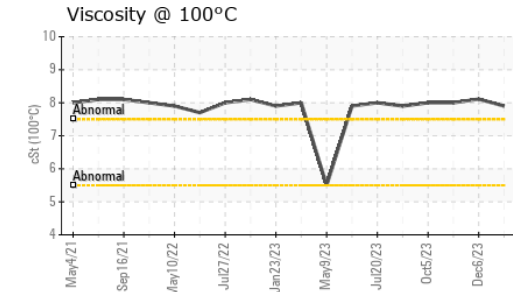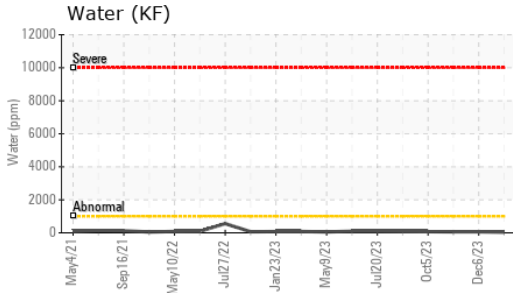






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.2	45.73	46.02
Visc @ 100°C	cSt	ASTM D445	7.9	8.11	8
Viscosity Index (VI)	Scale	ASTM D2270	141	151	146

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

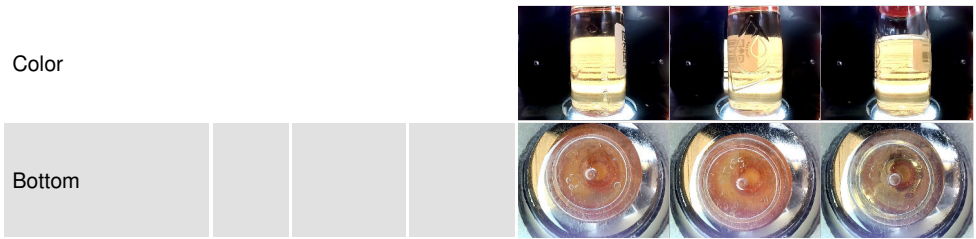

GRAPHS

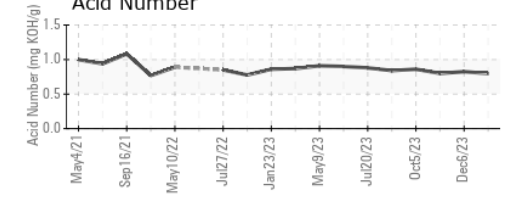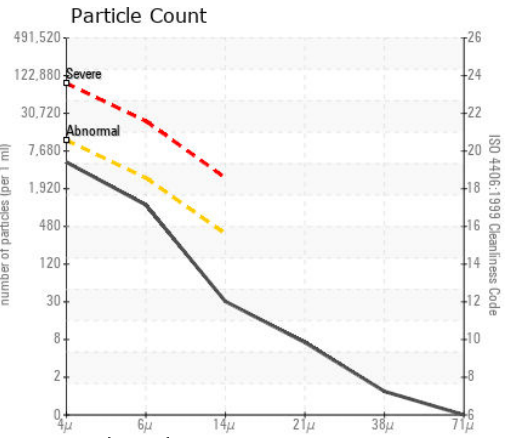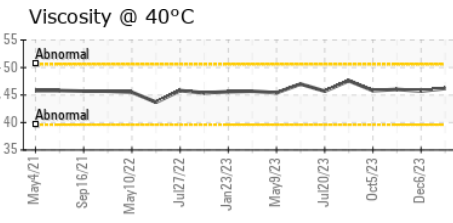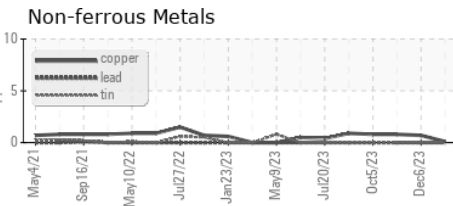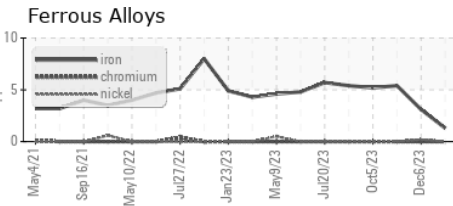

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60000700 **Received** : 11 Jan 2024
Lab Number : 06058170 **Diagnosed** : 12 Jan 2024
Unique Number : 10829552 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

TRANSCONTINENTAL GAS PIPELINE - CARLSTADT
 718 PATTERSON PLANK RD
 CARLSTADT, NJ
 US 07072
 Contact: RICHIE GUIMOND
 richie.guimond@williams.com
 T: (830)267-1263
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)