

Machine Id
ARIEL AGI 9300
Component
Reciprocating Compressor
Fluid
TULCO (30 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO60000641	TO60000637	TO60000635
Sample Date	Client Info			21 Dec 2023	15 Nov 2023	26 Jun 2023
Machine Age	hrs	Client Info		48832	0	47493
Oil Age	hrs	Client Info		1200	0	0
Oil Changed	Client Info			Changed	N/A	Not Chngd
Sample Status				ATTENTION	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	2	0	0
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	<1	1
Calcium	ppm	ASTM D5185m		0	5	<1
Phosphorus	ppm	ASTM D5185m		59	79	74
Zinc	ppm	ASTM D5185m		3	9	0
Sulfur	ppm	ASTM D5185m		1098	1016	1287


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.1	0.028	0.042	0.005
ppm Water	ppm	ASTM D6304	>1000	281	427	59.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 16922	▲ 32688	753
Particles >6µm		ASTM D7647	>2500	1402	▲ 7057	250
Particles >14µm		ASTM D7647	>320	17	111	33
Particles >21µm		ASTM D7647	>80	4	14	11
Particles >38µm		ASTM D7647	>20	0	0	2
Particles >71µm		ASTM D7647	>4	0	0	1
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 21/18/11	▲ 22/20/14	17/15/12


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.06	0.054	0.102

OIL ANALYSIS REPORT


Particle Trend

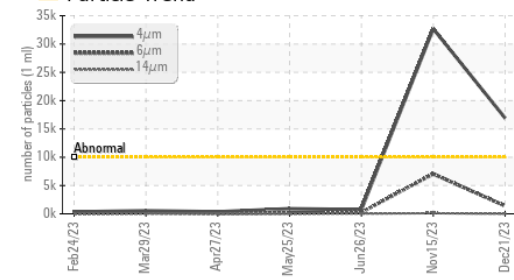


Water (KF)

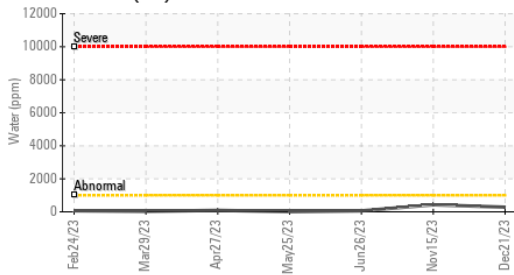


Viscosity @ 100°C

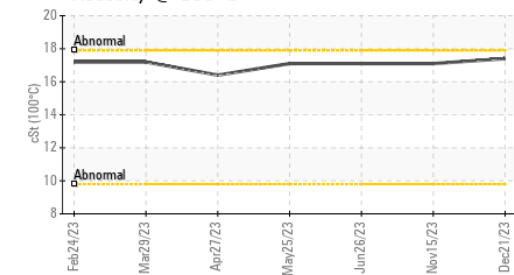

Water (KF)

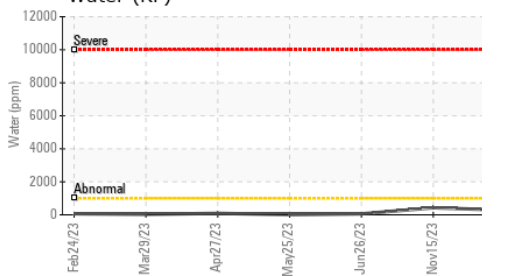

Viscosity @ 100°C

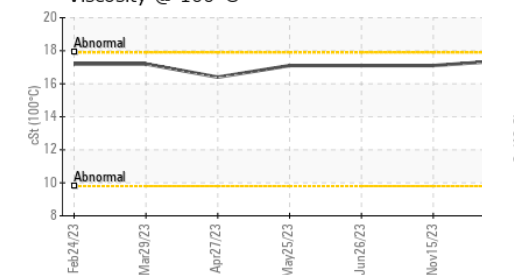






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	152	144	146
Visc @ 100°C	cSt	ASTM D445	17.4	17.1	17.1
Viscosity Index (VI)	Scale	ASTM D2270	125	129	127

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

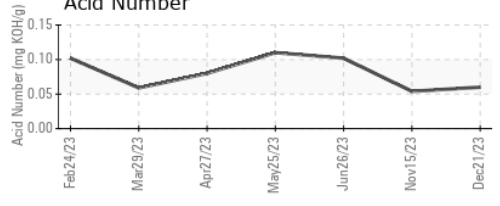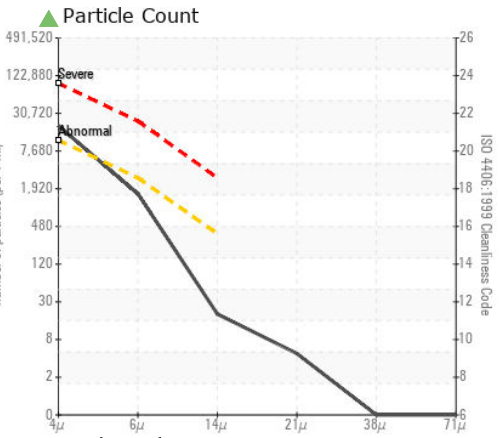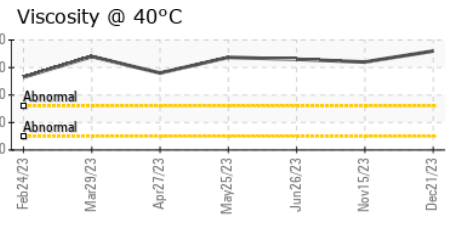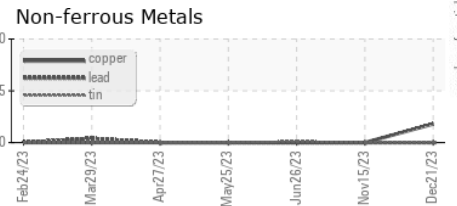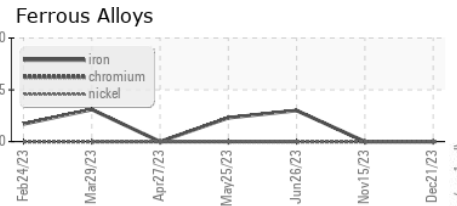

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60000641 **Received** : 11 Jan 2024
Lab Number : 06058173 **Diagnosed** : 12 Jan 2024
Unique Number : 10829555 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

CF STRAIT-DIMMIT
 9013 N I-35
 PEARSALL, TX
 US 78061
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)