




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

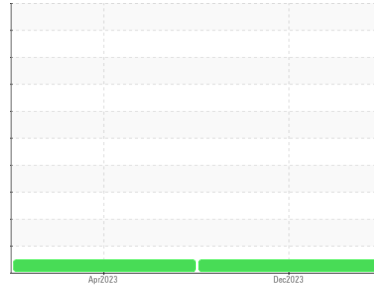

Area  
**ROTO XTEND [1354]**  
 Machine Id  
**ATLAS COPCO API838660 - QUANTIX**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06058185</b>	UCH05826379	---
Sample Date	Client Info		<b>26 Dec 2023</b>	23 Apr 2023	---
Machine Age	hrs	Client Info	<b>8016</b>	7087	---
Oil Age	hrs	Client Info	<b>0</b>	1457	---
Oil Changed	Client Info		<b>N/A</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >15	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >65	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	4	---
Calcium	ppm	ASTM D5185m	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>42</b>	35	---
Zinc	ppm	ASTM D5185m	<b>70</b>	26	---
Sulfur	ppm	ASTM D5185m	<b>81</b>	0	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>0</b>	5	---
Sodium	ppm	ASTM D5185m	<b>3</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.14	<b>0.17</b>	0.11	---



# OIL ANALYSIS REPORT

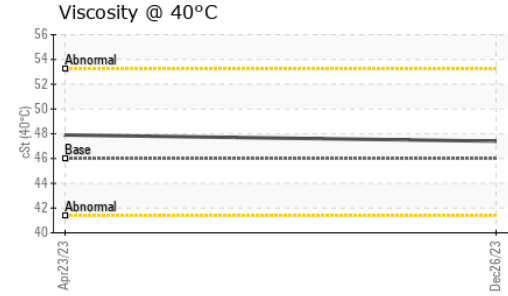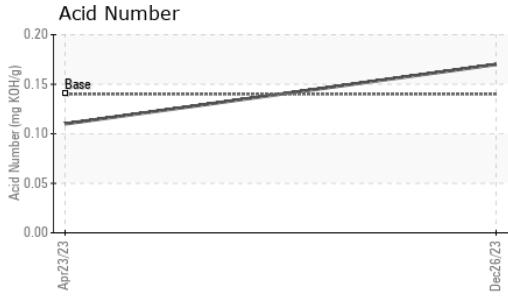





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.4	47.9	---

### SAMPLE IMAGES

PARAMETER	method	limit/base	current	history1	history2
Color					
Bottom					

### GRAPHS

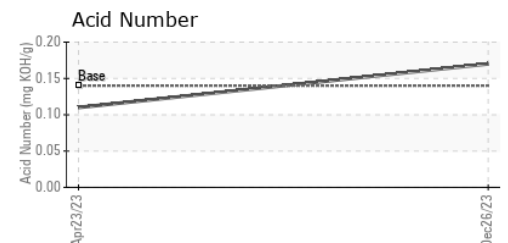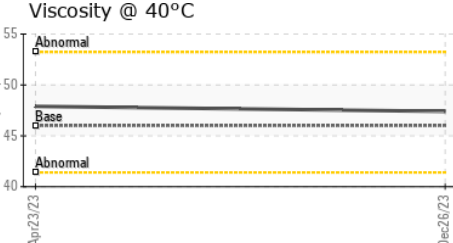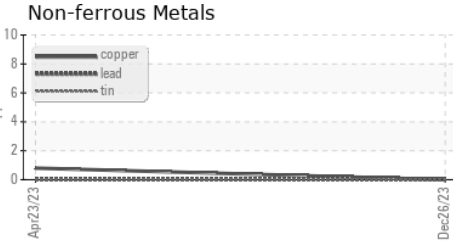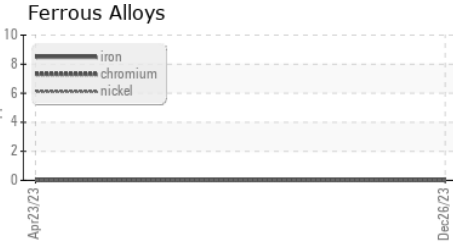

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06058185 **Received** : 11 Jan 2024  
**Lab Number** : 06058185 **Diagnosed** : 12 Jan 2024  
**Unique Number** : 10829567 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**AIR SPECIALTY & EQUIPMENT COMPANY**  
 2814 EAST P ST  
 DEER PARK, TX  
 US 77536  
 Contact: AARON RIOS  
 oilsamples@airspecialty.com  
 T: (281)884-2335  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)