


OIL ANALYSIS REPORT

NOT GIVEN [PM12-3176939*] Machine Id ATLAS COPCO ITJ418757 - KROEGER EQUIPMENT AND SUPPLY

Component

Compressor





DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06058204		
Sample Date		Client Info		27 Dec 2023		
Machine Age	hrs	Client Info		5253		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	3		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	5	0		
Phosphorus	ppm	ASTM D5185m	150	112		
Zinc	ppm	ASTM D5185m	5	0		
Sulfur	ppm	ASTM D5185m	5000	4570		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	6		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.1	0.075		
ppm Water	ppm	ASTM D6304	>1000	750		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


mg KOH/g ASTM D8045 0.51

Acid Number (AN)

0.24



OIL ANALYSIS REPORT

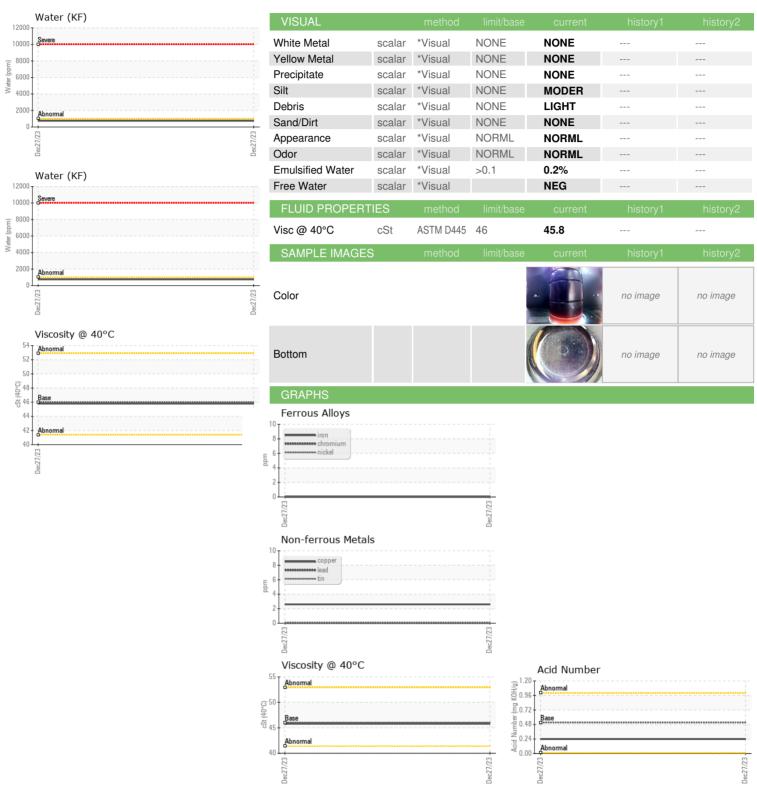



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06058204

: 06058204 : 10829586

Recieved Diagnosed Diagnostician : Don Baldridge

: 11 Jan 2024

: 12 Jan 2024

Test Package : IND 2 (Additional Tests: KF) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **CISCO AIR SYSTEMS**

214 27TH ST SACRAMENTO, CA

US 95816 Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com

T: (916)444-2525

F: x: