

# **OIL ANALYSIS REPORT**

# NOT GIVEN [SO-267097] **SULLAIR 003-73522**

Component

Compressor

COMPRESSOR OIL (PAG) ISO 46 (--- GAL)

# Sample Rating Trend **NORMAL**

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000209		
Sample Date		Client Info		21 Dec 2023		
Machine Age	hrs	Client Info		103648		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	678		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	10	0		
Phosphorus	ppm	ASTM D5185m	250	1		
Zinc	ppm	ASTM D5185m	100	12		
Sulfur	ppm	ASTM D5185m	400	199		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		31		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.45		



# **OIL ANALYSIS REPORT**

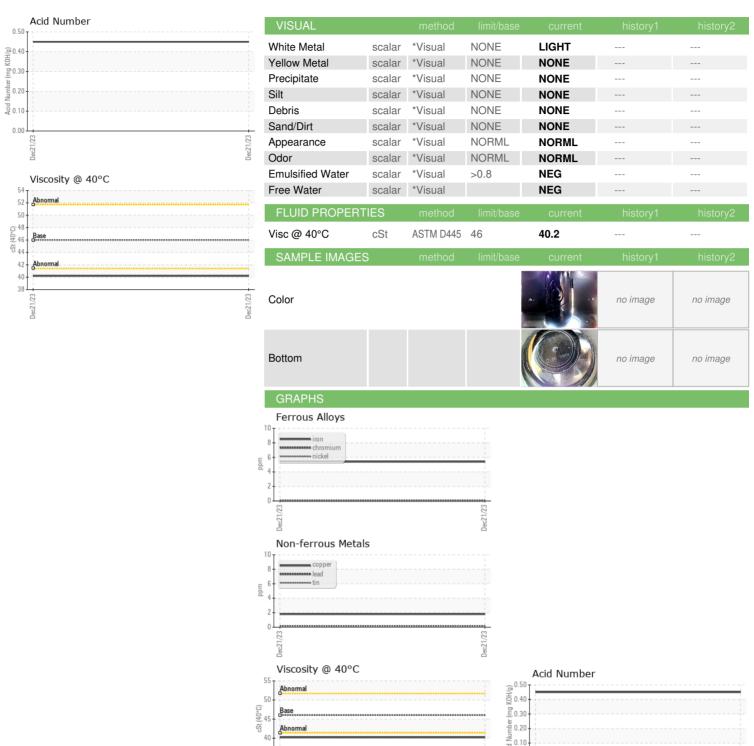





Certificate L2367

Laboratory Sample No. Lab Number

: 06058238 Unique Number : 10829620 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0000209 Recieved Diagnosed

: 11 Jan 2024 : 14 Jan 2024 : Don Baldridge Diagnostician

0.00

**FLUID-AIRE DYNAMICS** 550 ALBION AVE SCHAUMBURG, IL US 60193 Contact: ED DIENER

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. ed.diener@fluidairedynamics.com T: (847)678-8388

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ED DIENER - UCFLUSCH

F: