

OIL ANALYSIS REPORT

Compressor

{not provided} (--- GAL)

5010160 [SO-271600] SULLIVAN PALATEK 1311060003 Component

Sample Rating Trend



				Dec2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000213		
Sample Date		Client Info		11 Dec 2023		
Machine Age	hrs	Client Info		71264		
Oil Age	hrs	Client Info		1872		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		4		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
n		10T11 DE10-				

	1-1-					
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		223		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		68		
CONTAMINANTS	;	method	limit/base	current	history1	history2
CONTAMINANTS	ppm	method ASTM D5185m	limit/base >25	current 0	history1	history2
					,	,
Silicon	ppm	ASTM D5185m		0		
Silicon Sodium	ppm ppm ppm	ASTM D5185m ASTM D5185m	>25	0 15		

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination


There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



OIL ANALYSIS REPORT

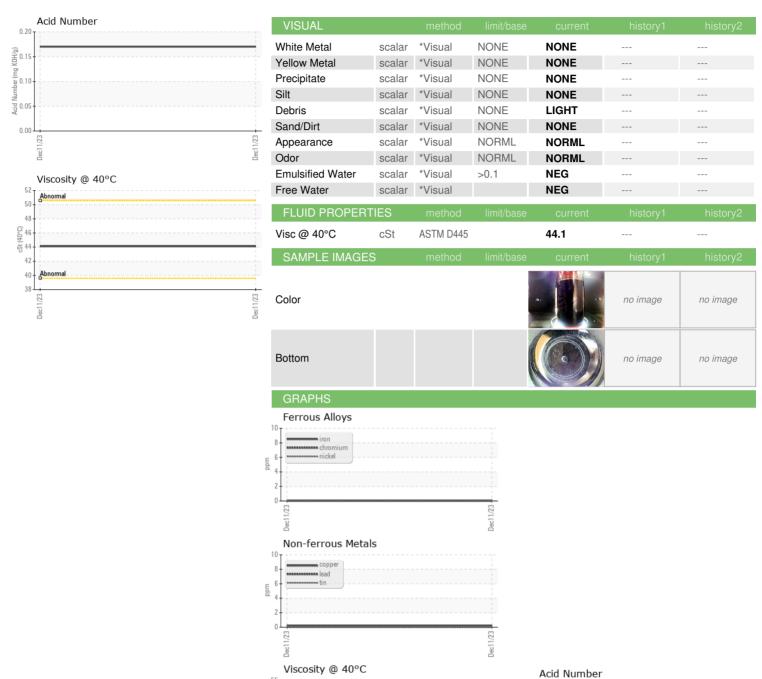





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: 06058243 : 10829625 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0000213 Recieved : 11 Jan 2024 Diagnosed : 14 Jan 2024 : Don Baldridge

Diagnostician

MO 0.1

Dec11/23

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

FLUID-AIRE DYNAMICS

550 ALBION AVE

US 60193

F:

SCHAUMBURG, IL

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ED DIENER - UCFLUSCH