


OIL ANALYSIS REPORT

NOT GIVEN [SO-273689] **SULLAIR EG98608400 - LONSDALE PACK**

Component

Compressor

COMPRESSOR OIL (PAG) ISO 46 (--- GAL)





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000241		
Sample Date		Client Info		28 Dec 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	303		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	10	0		
Phosphorus	ppm	ASTM D5185m	250	2		
Zinc	ppm	ASTM D5185m	100	36		
Sulfur	ppm	ASTM D5185m	400	199		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		134		
Potassium	ppm	ASTM D5185m	>20	22		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.17		



OIL ANALYSIS REPORT

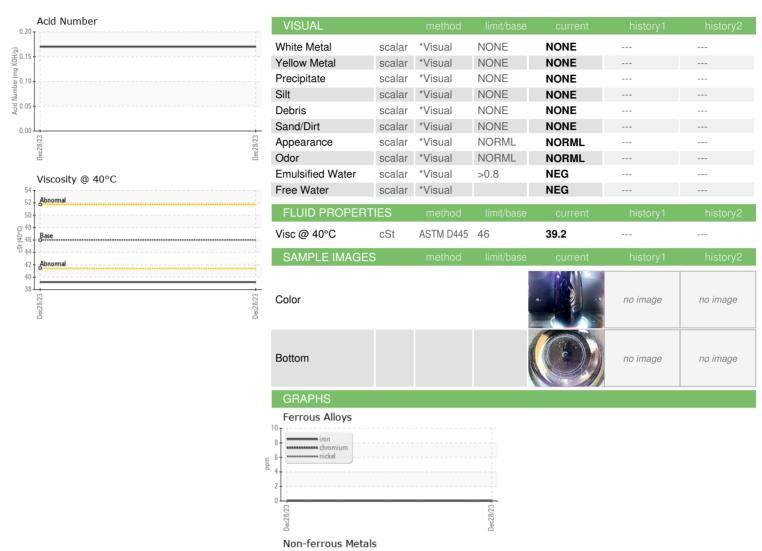





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0000241 Recieved : 11 Jan 2024 : 06058248 Diagnosed : 10829630 Diagnostician

: 14 Jan 2024 : Don Baldridge **FLUID-AIRE DYNAMICS** 550 ALBION AVE SCHAUMBURG, IL

US 60193 Contact: ED DIENER

ed.diener@fluidairedynamics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

T: (847)678-8388

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Viscosity @ 40°C

F:

Acid Number

(mg KOH/