

OIL ANALYSIS REPORT

Area NOT GIVEN [SO-274380] Machine Id PNEUTECH AK100019789 - PRECISION FIBERGLASS Component

Compressor Fluid

COMPRESSOR OIL (PAO) ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000207		
Sample Date		Client Info		20 Dec 2023		
Machine Age	hrs	Client Info		11351		
Oil Age	hrs	Client Info		1351		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0		
Barium	ppm	ASTM D5185m	1	0		
Molybdenum	ppm	ASTM D5185m	1	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	1	0		
Calcium	ppm	ASTM D5185m	1	0		
Phosphorus	ppm	ASTM D5185m	800	494		
Zinc	ppm	ASTM D5185m	20	29		
Sulfur	ppm	ASTM D5185m	37	64		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	11		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.24	0.12		



OIL ANALYSIS REPORT

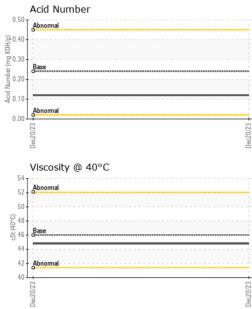

			method		current		riistory2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
Dec20/23	Appearance	scalar	*Visual	NORML	NORML		
Deci	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
	Free Water	scalar	*Visual		NEG		
-	FLUID PROPER	TIES	method	limit/base	current	history1	history2
						Thistory I	THSTOLA
	Visc @ 40°C	cSt	ASTM D445	46	44.8		
	SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Dec20/23	Color					no image	no image
	Bottom					no image	no image
	Non-ferrous Meta	ls		Dec20/23			
	Viscosity @ 40°C			Dec20/23 4	Acid Number		
	SS Abnormal SS SO SS SS			(0.50 ()) ()) ()) ()) ()) ()) ()) ()	Base		
	Abnormal			F 0.1	0 - Abnormal		
	40				10		ŝ
	Dec20/23			Dec20/23	Dec20/23		
	· WearCheck USA	501 Madis	son Ave., Ca	3	FLUID-AIRE DYNAMIC 550 ALBION AV SCHAUMBURG, US 6019 Contact: ED DIENE ed.diener@fluidairedynamics.col		

Contact/Location: ED DIENER - UCFLUSCH