FUEL REPORT

Sample Rating Trend

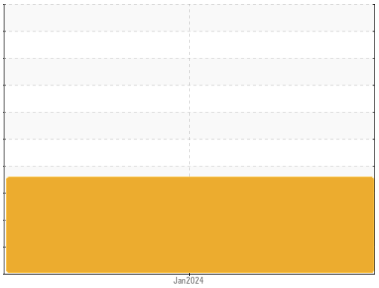

WATER

Area
[R23531]
Machine Id
C006169
Component
Diesel Fuel
Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

We advise that you filter this fluid before use. We advise that you follow the water drain-off procedure for this component.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. Free water present. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0897005**	---	---
Sample Date		Client Info		**08 Jan 2024**	---	---
Machine Age	hrs	Client Info		**0**	---	---
Sample Status				**ABNORMAL**	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		**0.840**	---	---
Fuel Color	text	*Visual Screen		**Red**	---	---
ASTM Color	scalar	*ASTM D1500		**L4.5**	---	---
Visc @ 40°C	cSt	ASTM D445		**2.44**	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		**58**	---	---
Cloud Point	°C	ASTM D5771		**-11**	---	---
Pour Point	°C	ASTM D5950		**-36**	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		**0**	---	---
Sulfur (UVF)	ppm	ASTM D5453		**9**	---	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		**162**	---	---
5% Distillation Point	°C	ASTM D86		**189**	---	---
10% Distill Point	°C	ASTM D86		**200**	---	---
15% Distillation Point	°C	ASTM D86		**209**	---	---
20% Distill Point	°C	ASTM D86		**218**	---	---
30% Distill Point	°C	ASTM D86		**231**	---	---
40% Distill Point	°C	ASTM D86		**245**	---	---
50% Distill Point	°C	ASTM D86		**259**	---	---
60% Distill Point	°C	ASTM D86		**273**	---	---
70% Distill Point	°C	ASTM D86		**287**	---	---
80% Distill Point	°C	ASTM D86		**304**	---	---
85% Distillation Point	°C	ASTM D86		**313**	---	---
90% Distill Point	°C	ASTM D86		**325**	---	---
95% Distillation Point	°C	ASTM D86		**342**	---	---
Final Boiling Point	°C	ASTM D86		**351**	---	---
Distillation Residue	%	ASTM D86		**1.4**	---	---
Distillation Loss	%	ASTM D86		**0.7**	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		**37.0**	---	---
Cetane Index		ASTM D4737	<40.0	**48.2**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	**0**	---	---
Sodium	ppm	ASTM D5185m	<0.1	**0**	---	---
Potassium	ppm	ASTM D5185m	<0.1	**0**	---	---
Water	%	ASTM D6304	<0.05	**0.007**	---	---
ppm Water	ppm	ASTM D6304	<500	**79**	---	---
% Gasoline	%	*In-House	<0.50	**0.0**	---	---
% Biodiesel	%	*In-House	<20.0	**0.0**	---	---

FUEL REPORT

Particle Count

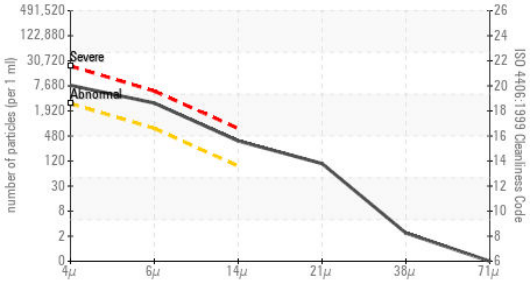

Particle Trend

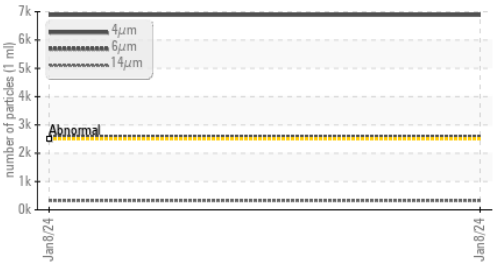

Water (KF)

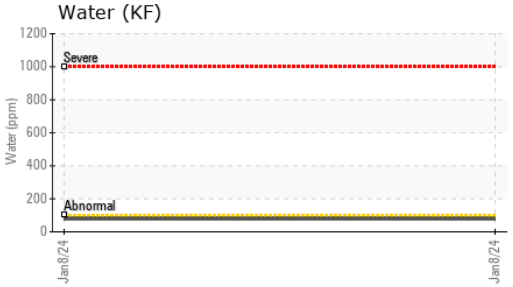

Viscosity @ 40°C

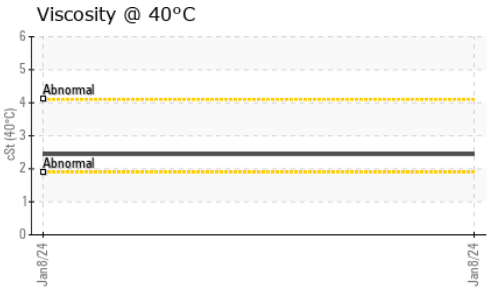

Fuel Distillation Curve

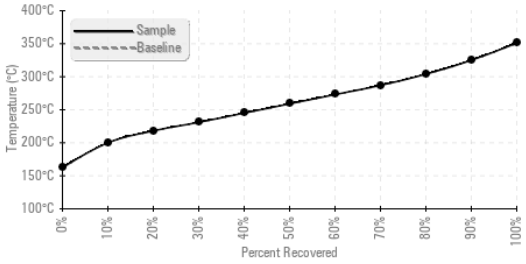

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ **6882**	---	---
Particles >6µm		ASTM D7647	>640	▲ **2588**	---	---
Particles >14µm		ASTM D7647	>80	▲ **321**	---	---
Particles >21µm		ASTM D7647	>20	▲ **92**	---	---
Particles >38µm		ASTM D7647	>4	**2**	---	---
Particles >71µm		ASTM D7647	>3	**0**	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ **20/19/16**	---	---

MICROBIAL		method	limit/base	current	history1	history2
Bacteria	CFU/ml	WC-Method	>=100000	**0**	---	---
Yeast	CFU/ml	WC-Method	>=100000	**0**	---	---
Mold	Colonies	WC-Method	MODER	**---**	---	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	**0**	---	---
Nickel	ppm	ASTM D5185m	<0.1	**0**	---	---
Lead	ppm	ASTM D5185m	<0.1	**0**	---	---
Vanadium	ppm	ASTM D5185m	<0.1	**0**	---	---
Iron	ppm	ASTM D5185m	<0.1	**0**	---	---
Calcium	ppm	ASTM D5185m	<0.1	**0**	---	---
Magnesium	ppm	ASTM D5185m	<0.1	**0**	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	**0**	---	---
Zinc	ppm	ASTM D5185m	<0.1	**0**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0897005 **Recieved** : 11 Jan 2024
Lab Number : 06058567 **Diagnosed** : 29 Jan 2024
Unique Number : 10829949 **Diagnostician** : Doug Bogart
Test Package : DF-3 (Additional Tests: Bacteria, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HOFFMAN EQUIPMENT INC
300 S RANDOLPHVILLE RD
PISCATAWAY, NJ
US 08854
Contact: ANTHONY NALEWAJKO
anthony.nalewajko@hoffmanequip.com
T: (732)752-3600
F: (732)968-8371