


# **OIL ANALYSIS REPORT**

# Machine Id KAESER ASD 30 8386237 (S/N 1253)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)





## **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Dec2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP53566	KCP48068D	
Sample Date		Client Info		19 Dec 2023	02 Apr 2023	
Machine Age	hrs	Client Info		5995	3995	
Oil Age	hrs	Client Info		2993	990	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	25	11	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	<1	49	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		21	6	
Zinc	ppm	ASTM D5185m		76	99	
Sulfur	ppm	ASTM D5185m		19662	22492	
CONTAMINANTS	}	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		0	4	
Potassium	ppm	ASTM D5185m	>20	1	2	
Water	%	ASTM D6304	>0.05	0.009	0.011	
ppm Water	ppm	ASTM D6304	>500	90	110.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		16511		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2566		
Particles >14μm		ASTM D7647	>80	<u>^</u> 78		
Particles >21μm		ASTM D7647	>20	<u>^</u> 23		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.41	



## **OIL ANALYSIS REPORT**

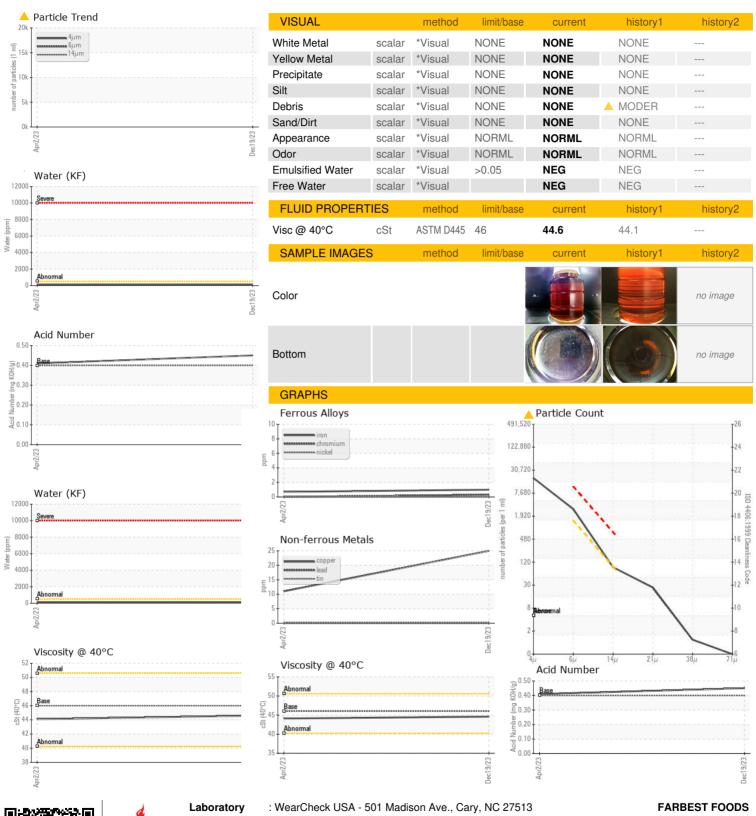



Certificate L2367

Sample No. Lab Number **Unique Number** 

: KCP53566 : 06058742 : 10830124

Recieved : 11 Jan 2024 Diagnosed : 14 Jan 2024

Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

4689 S 400 W HUNTINGBURG, IN

US 47542

Contact:

T: F:

Contact/Location: ? ? - FARHUN