




OIL ANALYSIS REPORT

Sample Rating Trend

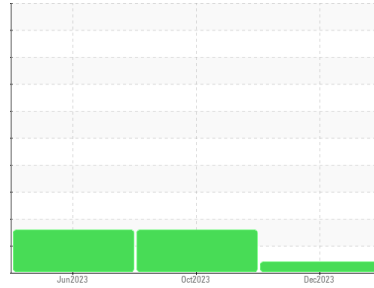

VIS DEBRIS



Machine Id
KAESER SK 15T 8687556 (S/N 1513)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

High concentration of visible dirt/debris present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC121977	KC107041	KC100939
Sample Date	Client Info	28 Dec 2023	10 Oct 2023	06 Jun 2023
Machine Age	hrs	4090	3454	2169
Oil Age	hrs	0	3454	2169
Oil Changed	Client Info	N/A	Changed	Not Chngd
Sample Status		ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	4	10	8
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	15	0	3
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	72	20	47
Calcium	ppm	ASTM D5185m 2	<1	1	2
Phosphorus	ppm	ASTM D5185m	21	<1	5
Zinc	ppm	ASTM D5185m	0	23	17

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	2	<1
Sodium	ppm	ASTM D5185m	15	2	8
Potassium	ppm	ASTM D5185m >20	10	6	14
Water	%	ASTM D6304 >0.05	0.028	0.013	0.019
ppm Water	ppm	ASTM D6304 >500	286	138.7	193.0






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1528	25166	2925
Particles >6µm	ASTM D7647 >1300	408	▲ 12500	▲ 1364
Particles >14µm	ASTM D7647 >80	28	▲ 481	▲ 160
Particles >21µm	ASTM D7647 >20	9	▲ 56	▲ 42
Particles >38µm	ASTM D7647 >4	0	2	4
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	18/16/12	▲ 22/21/16	▲ 19/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.31	0.31


OIL ANALYSIS REPORT

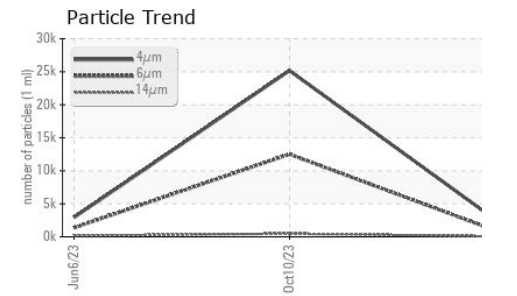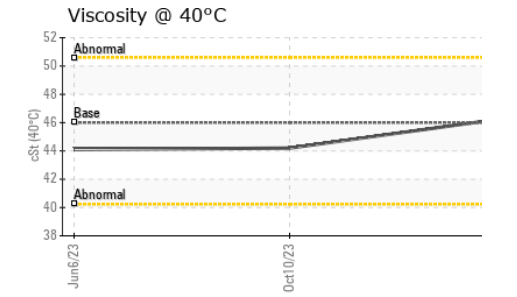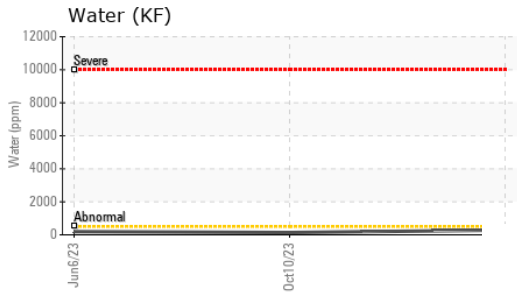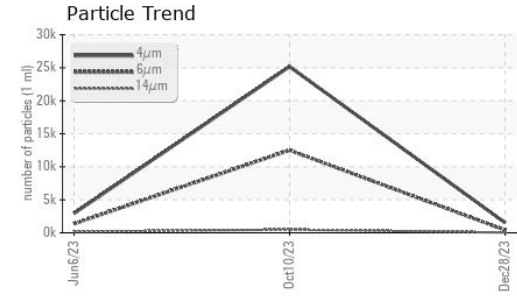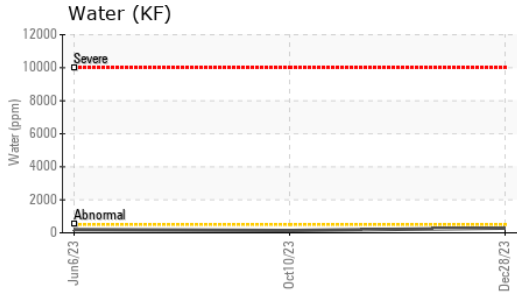






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	▲ HEAVY	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.3	44.2	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

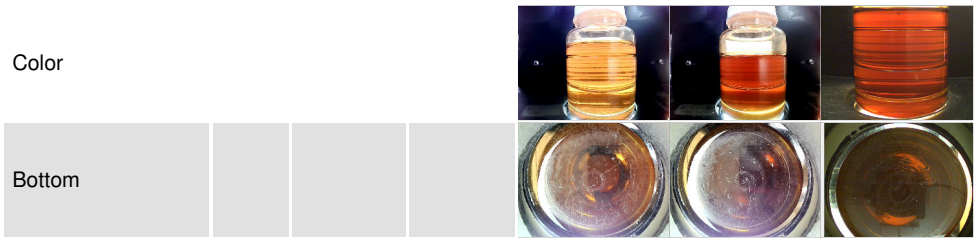

GRAPHS

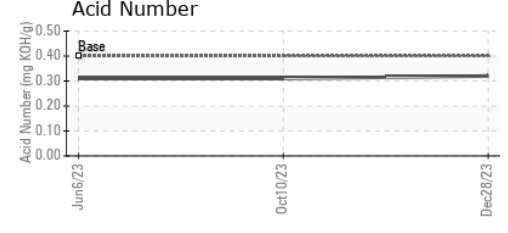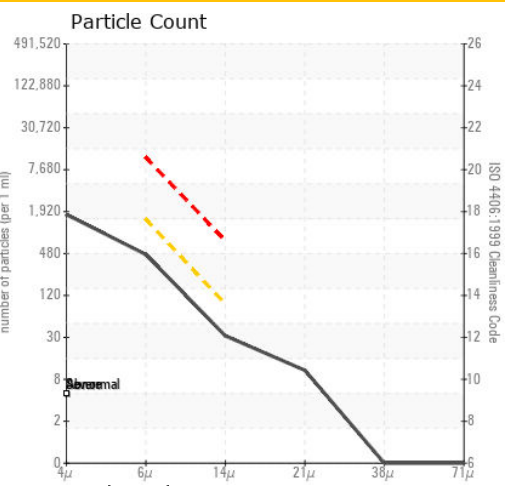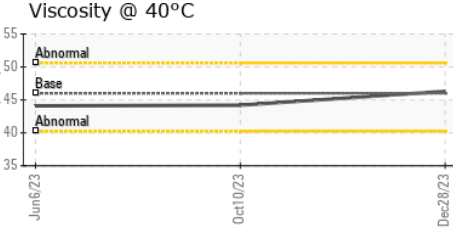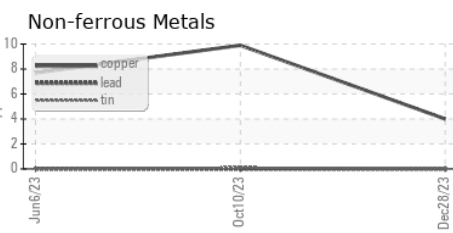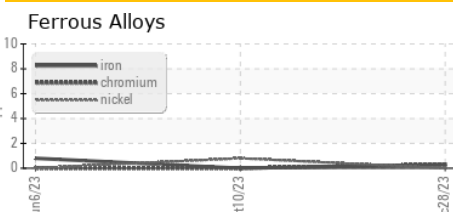

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC121977 **Received** : 11 Jan 2024
Lab Number : 06058757 **Diagnosed** : 14 Jan 2024
Unique Number : 10830139 **Diagnostician** : Don Baldrige
Test Package : IND 2

SAWSTREET
 6450 KINGSPOINTE PKWY
 ORLANDO, FL
 US 32819
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: