

# **OIL ANALYSIS REPORT**



ISO

Machine Id **4252533 (S/N 1043)** 

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar202	2 Dec2022	Jul2023 Ja	n2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011590	KCP35051	KCP53370
Sample Date		Client Info		04 Jan 2024	08 Jul 2023	14 Dec 2022
Machine Age	hrs	Client Info		35516	34477	33444
Oil Age	hrs	Client Info		0	1000	0
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	2	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	6	5	12
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	27	29	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	21	2	2
Zinc	ppm	ASTM D5185m	0	27	29	0
Sulfur	ppm	ASTM D5185m	23500	22208	25282	17151
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	4	1
Sodium	ppm	ASTM D5185m		3	8	0
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Water	%	ASTM D6304	>0.05	0.017	0.021	0.005
ppm Water	ppm	ASTM D6304	>500	172	218.4	52.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		230538	2576	23742
Particles >6µm		ASTM D7647	>1300	<b>92674</b>	905	<b>△</b> 9328
Particles >14µm		ASTM D7647	>80	<u></u> 6551	76	<b>△</b> 605
Particles >21µm		ASTM D7647	>20	<u> </u>	17	<b>▲</b> 133
Particles >38µm		ASTM D7647	>4	<b>29</b>	0	<u></u> 5
Particles >71µm		ASTM D7647	>3	2	0	1
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>25/24/20</b>	19/17/13	<b>22/20/16</b>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.37	0.36



## **OIL ANALYSIS REPORT**

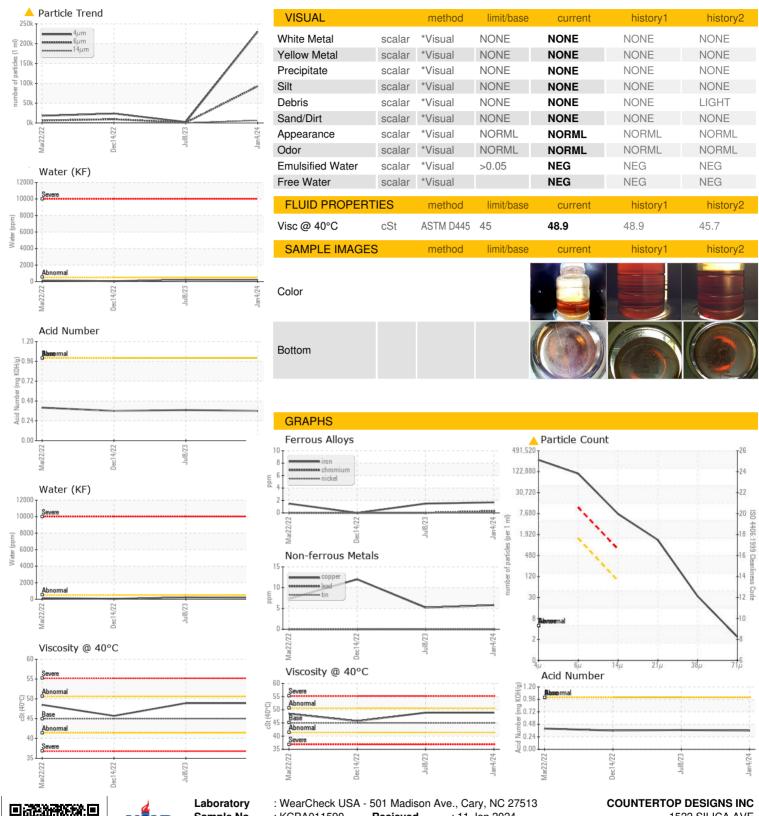





Certificate L2367

Sample No. Lab Number **Unique Number** 

: 06058761

: KCPA011590 : 10830143

Recieved : 11 Jan 2024 Diagnosed : 17 Jan 2024 Diagnostician : Jonathan Hester

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1522 SILICA AVE SACRAMENTO, CA US 95815

Contact: Service Manager ctd1971@sbcglobal.net

T:

F: