




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

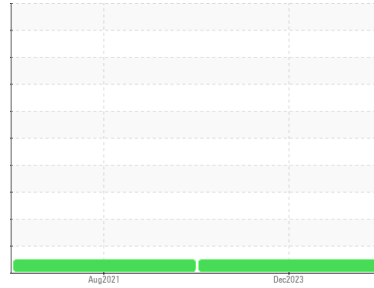

Area  
**GCCS XTEND**  
 Machine Id  
**ATLAS COPCO ITJ064813 - TROBINSON GLASS**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06058787</b>	UCH05342086	---
Sample Date	Client Info		<b>21 Dec 2023</b>	11 Aug 2021	---
Machine Age	hrs	Client Info	<b>8805</b>	4229	---
Oil Age	hrs	Client Info	<b>4000</b>	4229	---
Oil Changed	Client Info		<b>Not Chngd</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	1	---
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	1	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >15	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >65	<b>1</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m	<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>333</b>	372	---
Zinc	ppm	ASTM D5185m	<b>29</b>	75	---
Sulfur	ppm	ASTM D5185m	<b>939</b>	628	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>9</b>	15	---
Sodium	ppm	ASTM D5185m	<b>0</b>	1	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.22</b>	0.177	---



# OIL ANALYSIS REPORT

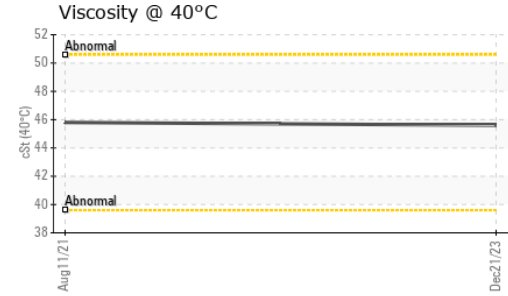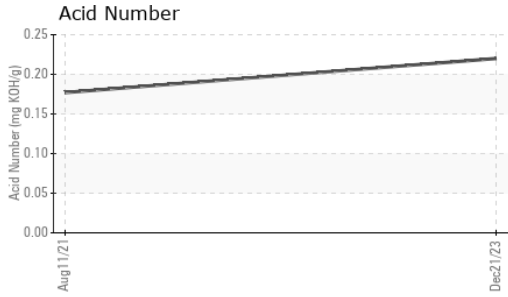

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG





FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.6	45.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

## GRAPHS

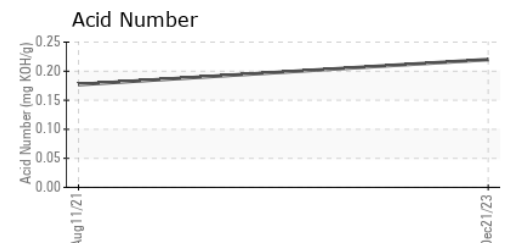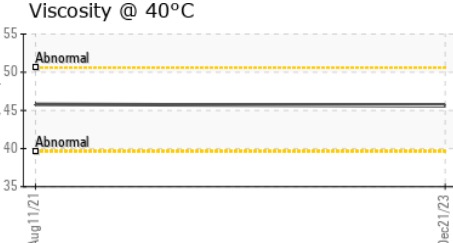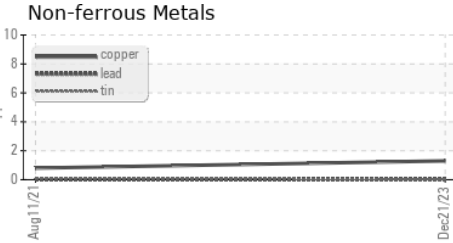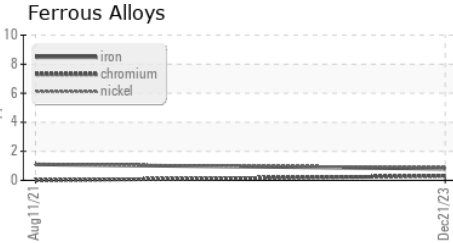

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : UCH06058787  
 Lab Number : 06058787  
 Unique Number : 10830169  
 Test Package : IND 2

**GREEN COUNTY COMPRESSOR SERVICE**  
 11974 E 530 RD  
 CLAREMORE, OK  
 US 74019  
 Contact: ASHLEY PIGUET  
 ashley@gccs.us.com  
 T: (918)906-6343  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)