




# OIL ANALYSIS REPORT

Sample Rating Trend

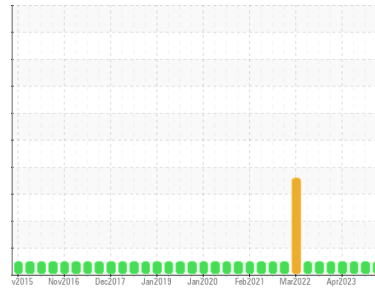

**NORMAL**



Machine Id  
**C-9101 AC 1 (S/N U101502562)**

Component  
**Air Compressor**

Fluid  
**USPI MAX FG AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM28665</b>	USPM28666	USPM28668
Sample Date	Client Info		<b>09 Jan 2024</b>	18 Oct 2023	19 Jul 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >70	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >6	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >80	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	1	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>10</b>	6	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >12	<b>0</b>	3	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	4	0
Water	%	ASTM D6304 >0.1	<b>0.011</b>	0.009	0.007
ppm Water	ppm	ASTM D6304 >1000	<b>118</b>	90.1	70.6






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>1087</b>	545	211
Particles >6µm	ASTM D7647	>2500	<b>194</b>	117	40
Particles >14µm	ASTM D7647	>320	<b>13</b>	21	5
Particles >21µm	ASTM D7647	>80	<b>5</b>	7	2
Particles >38µm	ASTM D7647	>20	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>17/15/11</b>	16/14/12	15/12/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	<b>0.07</b>	0.12	0.086


# OIL ANALYSIS REPORT

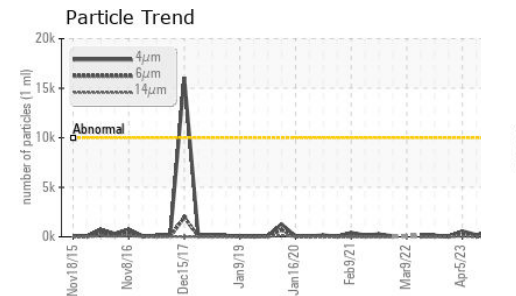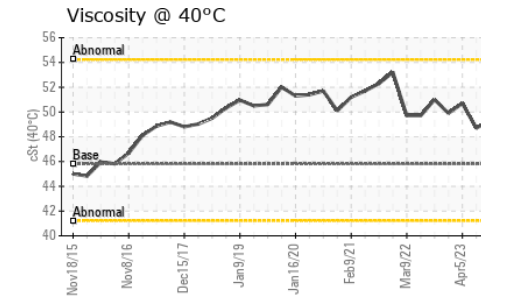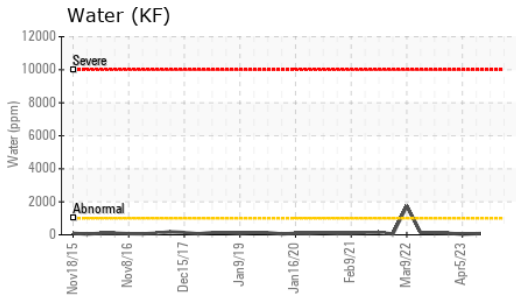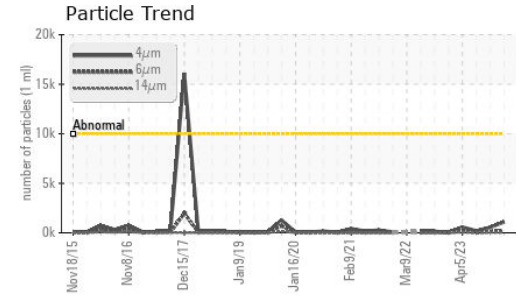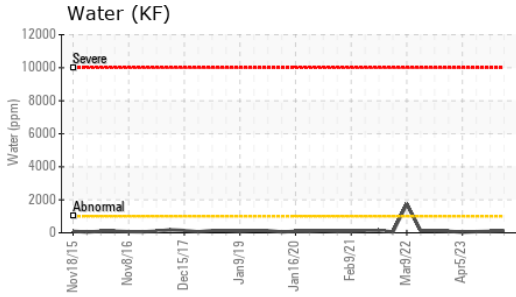






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	48.7	49.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

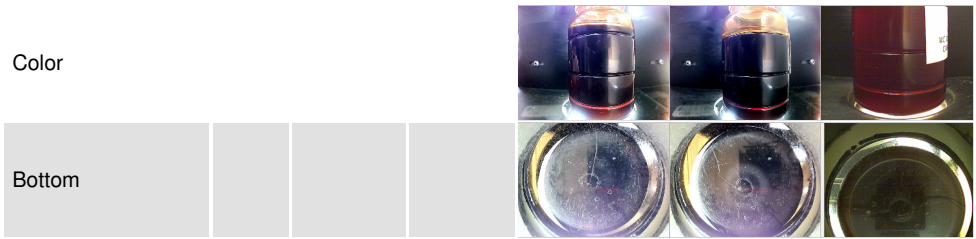

## GRAPHS

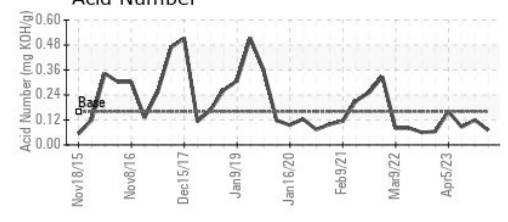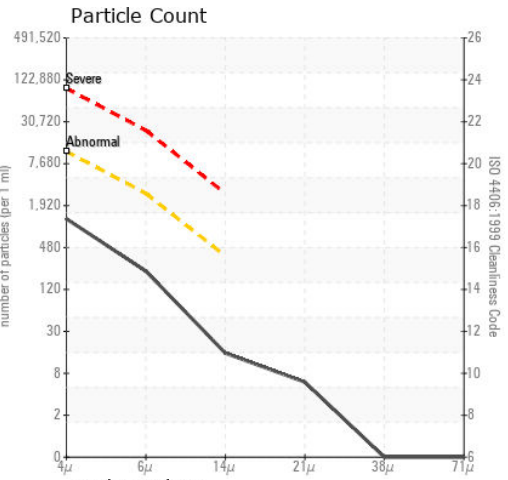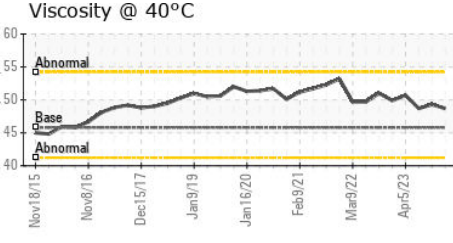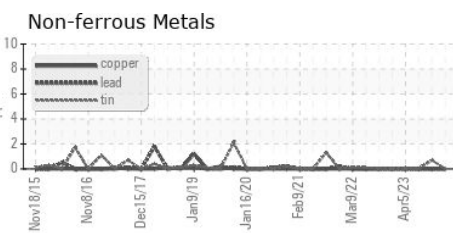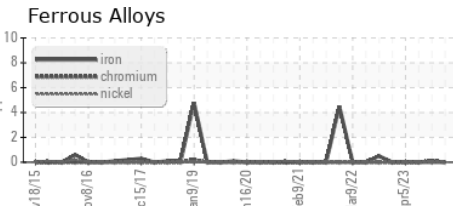

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM28665 **Received** : 12 Jan 2024  
**Lab Number** : 06059308 **Diagnosed** : 15 Jan 2024  
**Unique Number** : 10830690 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CARGILL OIL SEEDS**  
 5000 SOUTH BLVD  
 CHARLOTTE, NC  
 US 28217  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: