


# **OIL ANALYSIS REPORT**



**NORMAL** 



# TYSALB B-3

Component

**Refrigeration Compressor** 

USPI ALT-68 SC (--- GAL)

ΙΛ.		10	0	10
IΑ	G١	ИC.	5	5
100	$\sim$	~		$\cdot$

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L		Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM27940		
Sample Date		Client Info		09 Jan 2024		
Machine Age	days	Client Info		0		
Oil Age	days	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.01	0.017		
ppm Water	ppm	ASTM D6304	>100	176		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4077		
Particles >6µm		ASTM D7647	>2500	968		
Particles >14μm		ASTM D7647	>320	36		
Particles >21µm		ASTM D7647	>80	7		
Particles >38μm		ASTM D7647	>20	0		
Particles >71μm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>/18/15	19/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

0.014

mg KOH/g ASTM D974 0.005



## **OIL ANALYSIS REPORT**

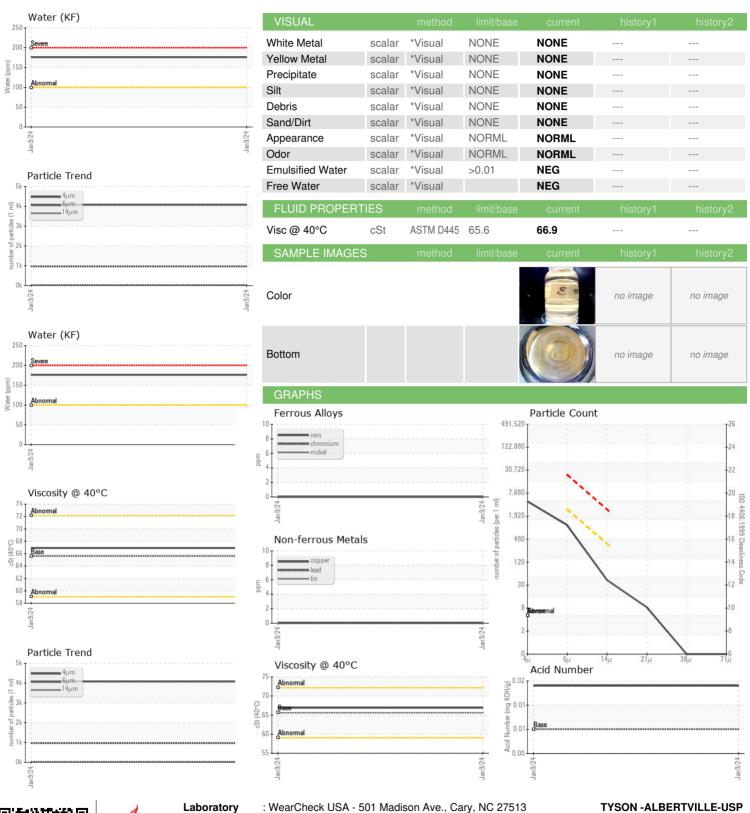



Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package

: USPM27940

: 06059339 : 10830721

: 12 Jan 2024 Recieved Diagnosed : 15 Jan 2024

Diagnostician : Doug Bogart

ALBERTVILLE, AL

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: