



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area


**JBS 258-46**

Machine Id

**GARDNER DENVER U70967 - 2 - SUMITOMO**

Component

**Compressor**

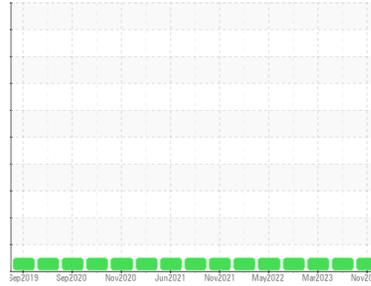

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>UCH06059379</b> | UCH05977735 | UCH05804093 |
| Sample Date   | Client Info |             | <b>27 Nov 2023</b> | 04 Sep 2023 | 05 Mar 2023 |
| Machine Age   | hrs         | Client Info | <b>72152</b>       | 71716       | 71447       |
| Oil Age       | hrs         | Client Info | <b>2500</b>        | 500         | 200         |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

## CONTAMINATION

|       | method    | limit/base | current    | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1       | <b>NEG</b> | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base      | current      | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b>     | <1       | 0        |
| Chromium | ppm    | ASTM D5185m >10 | <b>0</b>     | 0        | 0        |
| Nickel   | ppm    | ASTM D5185m     | <b>1</b>     | <1       | 0        |
| Titanium | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Silver   | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | 0        | 0        |
| Lead     | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | 0        | 0        |
| Copper   | ppm    | ASTM D5185m >50 | <b>&lt;1</b> | <1       | <1       |
| Tin      | ppm    | ASTM D5185m >15 | <b>0</b>     | <1       | 0        |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |

## ADDITIVES

|            | method | limit/base       | current      | history1 | history2 |
|------------|--------|------------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m 0.0  | <b>0</b>     | 0        | 0        |
| Barium     | ppm    | ASTM D5185m 0.0  | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm    | ASTM D5185m 0    | <b>0</b>     | 0        | 0        |
| Manganese  | ppm    | ASTM D5185m 0    | <b>&lt;1</b> | 0        | 0        |
| Magnesium  | ppm    | ASTM D5185m 0.0  | <b>&lt;1</b> | 0        | <1       |
| Calcium    | ppm    | ASTM D5185m 0.0  | <b>0</b>     | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m 966  | <b>200</b>   | 198      | 207      |
| Zinc       | ppm    | ASTM D5185m 0    | <b>0</b>     | 0        | 0        |
| Sulfur     | ppm    | ASTM D5185m 1309 | <b>1999</b>  | 2179     | 2379     |

## CONTAMINANTS



|           | method | limit/base      | current      | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | 2        | <1       |
| Sodium    | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Potassium | ppm    | ASTM D5185m >20 | <b>0</b>     | <1       | <1       |

## FLUID DEGRADATION

|                  | method   | limit/base       | current     | history1 | history2 |
|------------------|----------|------------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.172 | <b>0.12</b> | 0.08     | 0.10     |



# OIL ANALYSIS REPORT

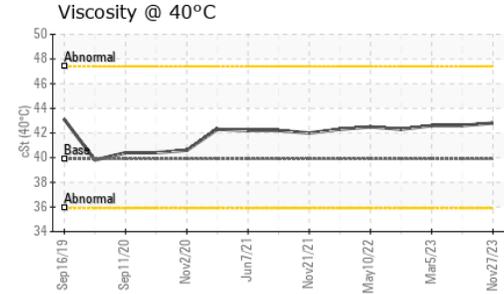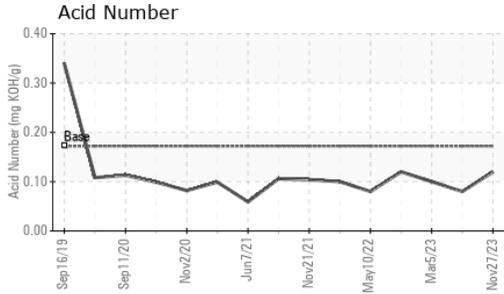

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |





| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |      |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 40°C      | cSt    | ASTM D445  | 39.9    | <b>42.8</b> | 42.6     | 42.6 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color

Bottom

## GRAPHS

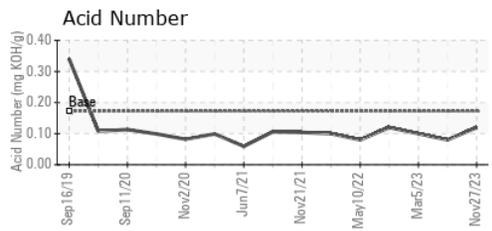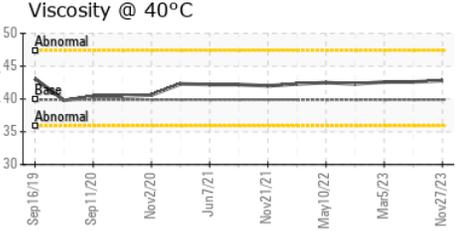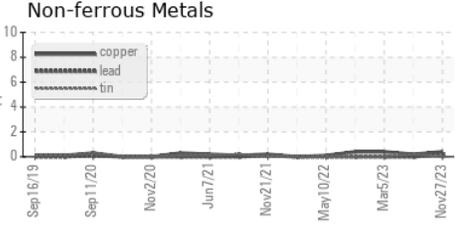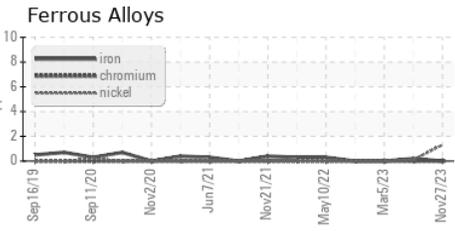

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06059379 **Recieved** : 12 Jan 2024  
**Lab Number** : **06059379** **Diagnosed** : 15 Jan 2024  
**Unique Number** : 10830761 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)