




Machine Id
CHILLER PUMP 2 (S/N A738F120-2)

Component
Pump
 Fluid
MOBIL DTE 26 (40 Oz)

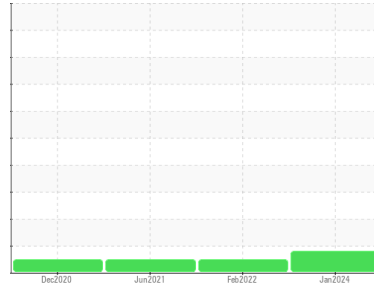

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		ST43818	ST36948	ST39584
Sample Date	Client Info		08 Jan 2024	05 Feb 2022	01 Jun 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	3700	3100	2000
Oil Changed		Client Info	N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<1	<1	<1
Chromium	ppm	ASTM D5185m >5	<1	0	0
Nickel	ppm	ASTM D5185m >5	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	<1
Aluminum	ppm	ASTM D5185m >7	2	0	0
Lead	ppm	ASTM D5185m >12	0	<1	0
Copper	ppm	ASTM D5185m >30	<1	<1	<1
Tin	ppm	ASTM D5185m >9	0	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	6
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	<1	0	0
Calcium	ppm	ASTM D5185m	61	132	130
Phosphorus	ppm	ASTM D5185m	383	490	480
Zinc	ppm	ASTM D5185m	536	690	727
Sulfur	ppm	ASTM D5185m	1392	6918	7831

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	2	2	2
Sodium	ppm	ASTM D5185m	0	0	<1
Potassium	ppm	ASTM D5185m >20	1	<1	0
Water	%	ASTM D6304 >.1	0.004	0.007	0.011
ppm Water	ppm	ASTM D6304 >1000	47	79.0	112.1

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 5549	820	1179
Particles >6µm	ASTM D7647	>1300	799	98	189
Particles >14µm	ASTM D7647	>160	15	6	11
Particles >21µm	ASTM D7647	>40	4	0	4
Particles >38µm	ASTM D7647	>10	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 20/17/11	17/14/10	17/15/11

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.35	0.699	0.797

OIL ANALYSIS REPORT


▲ Particle Trend

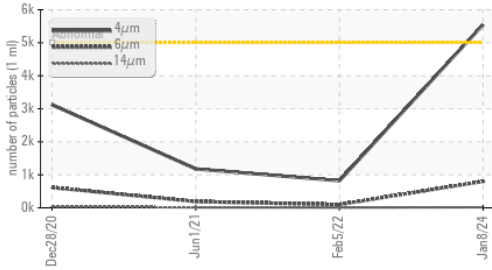


Water (KF)

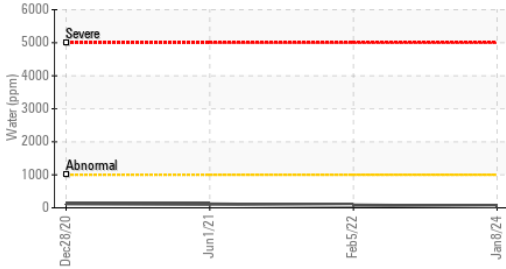


Acid Number

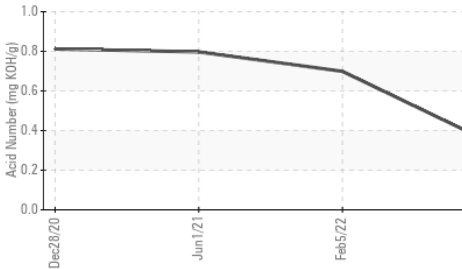

Water (KF)

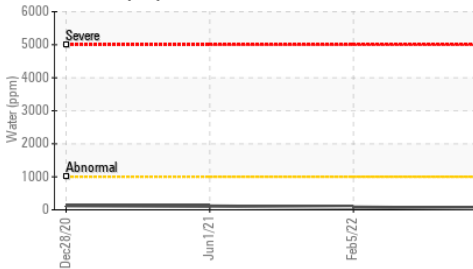

Viscosity @ 40°C

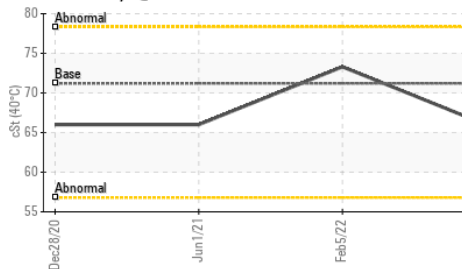


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	71.2	66.0	73.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

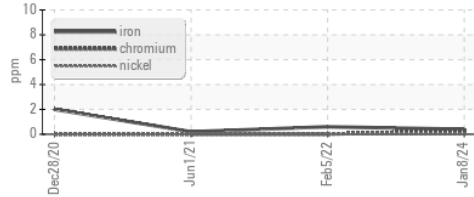


Non-ferrous Metals

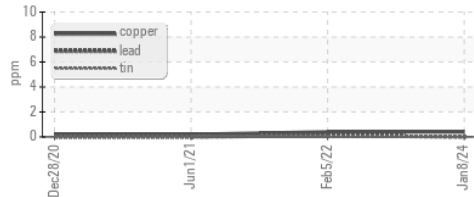


Viscosity @ 40°C

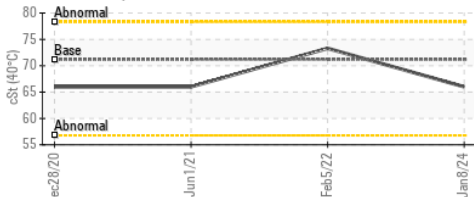

▲ Particle Count

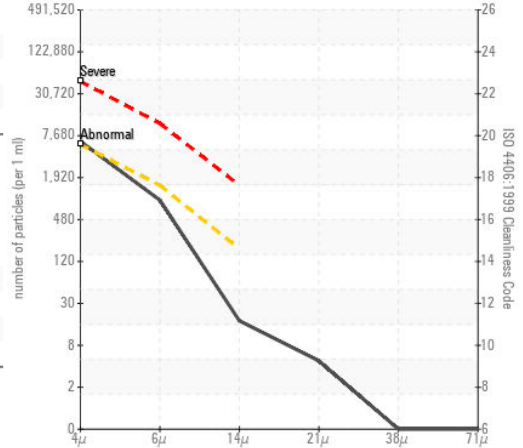

Acid Number

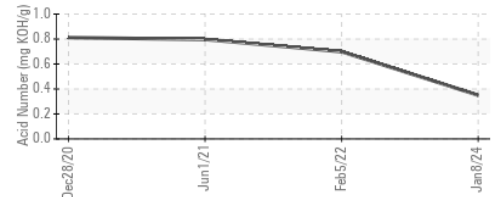

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : ST43818 **Received** : 12 Jan 2024
Lab Number : 06060231 **Diagnosed** : 16 Jan 2024
Unique Number : 10831613 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WINDSHEAR - JACOBS
 1050 IVEY CLINE RD
 CONCORD, NC
 US 28027

Contact: SAWSON SAMIMY
 sawson.samimy@jacobs.com

T: (704)920-7647

F: