




Machine Id
MAIN GLYCOL PUMP 1 (S/N 4738F119)

Component
Pump
 Fluid
MOBIL DTE 26 (96 Oz)

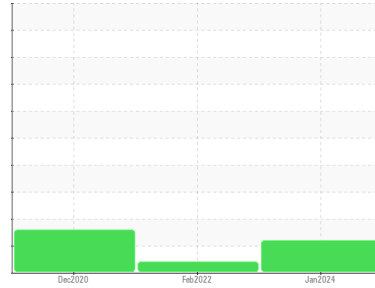

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		ST43827	ST36952	ST36953
Sample Date	Client Info		08 Jan 2024	05 Feb 2022	28 Dec 2020
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	3700	3100	4000
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	2	2	▲ 109
Chromium	ppm	ASTM D5185m >5	<1	0	<1
Nickel	ppm	ASTM D5185m >5	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	0	0	3
Aluminum	ppm	ASTM D5185m >7	2	0	<1
Lead	ppm	ASTM D5185m >12	0	<1	1
Copper	ppm	ASTM D5185m >30	<1	<1	1
Tin	ppm	ASTM D5185m >9	0	0	<1
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	5
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	<1	0	<1
Calcium	ppm	ASTM D5185m	60	135	133
Phosphorus	ppm	ASTM D5185m	381	495	502
Zinc	ppm	ASTM D5185m	529	723	729
Sulfur	ppm	ASTM D5185m	1195	7253	7387

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	1	2	4
Sodium	ppm	ASTM D5185m	0	<1	12
Potassium	ppm	ASTM D5185m >20	<1	<1	3
Water	%	ASTM D6304 >.1	0.007	0.010	0.008
ppm Water	ppm	ASTM D6304 >1000	71	101.1	81.5






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 14295	▲ 9096	▲ 16241
Particles >6µm	ASTM D7647	>1300	▲ 2647	692	▲ 1616
Particles >14µm	ASTM D7647	>160	59	21	102
Particles >21µm	ASTM D7647	>40	13	4	26
Particles >38µm	ASTM D7647	>10	1	0	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/13	▲ 20/17/12	▲ 21/18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.37	0.626	0.799


OIL ANALYSIS REPORT

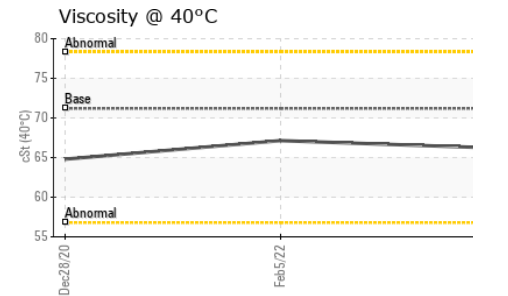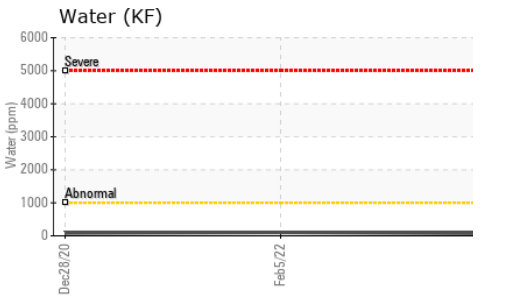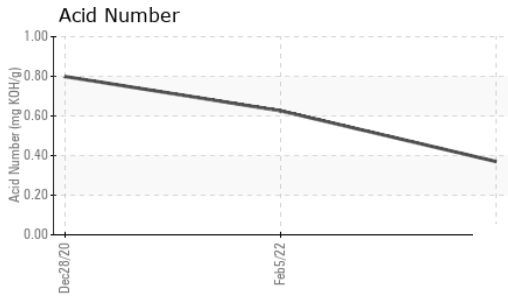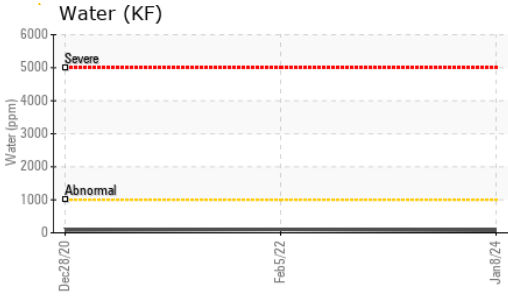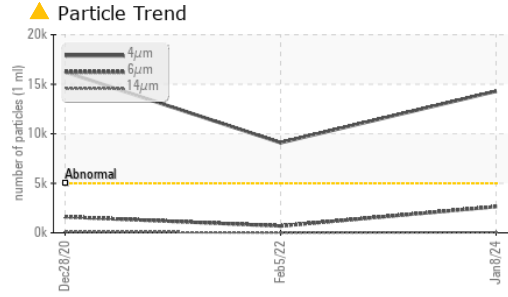






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	71.2	66.2	67.14

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

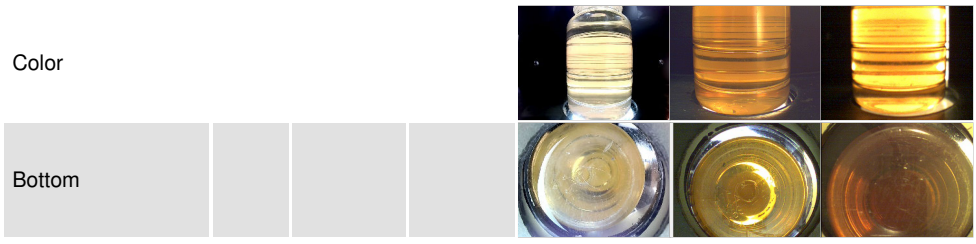

GRAPHS

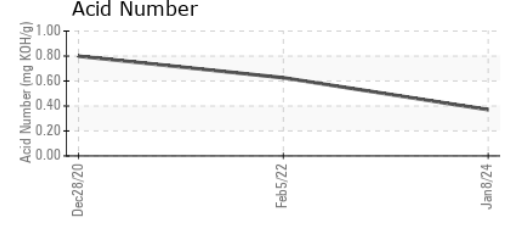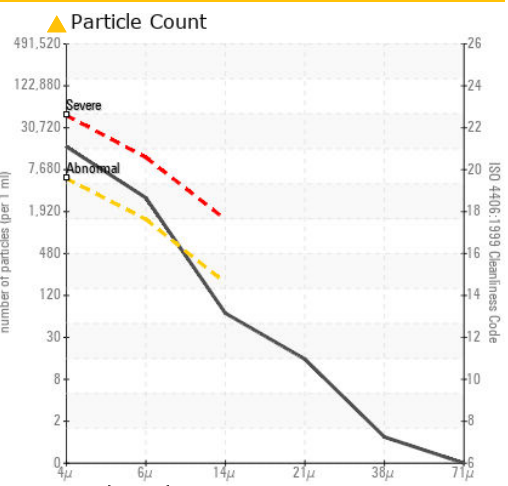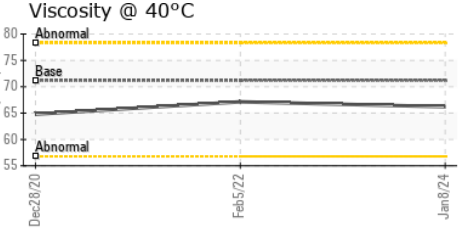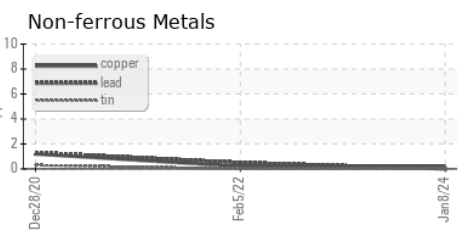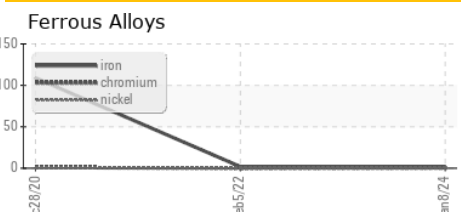

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : ST43827 **Received** : 12 Jan 2024
Lab Number : 06060232 **Diagnosed** : 16 Jan 2024
Unique Number : 10831614 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

WINDSHEAR - JACOBS
 1050 IVEY CLINE RD
 CONCORD, NC
 US 28027
 Contact: SAWSON SAMIMY
 sawson.samimy@jacobs.com
 T: (704)920-7647
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)