




Machine Id  
**CHILLER PUMP 1 (S/N A738F120-1)**

Component  
**Pump**  
 Fluid  
**MOBIL DTE 26 (40 Oz)**

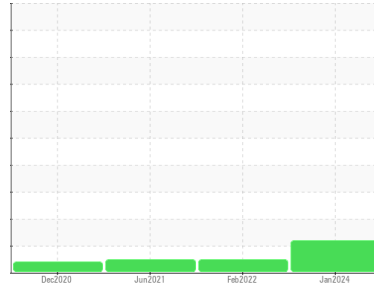

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>ST43828</b>	ST36951	ST39955
Sample Date	Client Info		<b>08 Jan 2024</b>	05 Feb 2022	01 Jun 2021
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>3700</b>	3100	2000
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>1</b>	<1	<1
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >7	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >12	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >30	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >9	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	6
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m	<b>60</b>	133	130
Phosphorus	ppm	ASTM D5185m	<b>381</b>	490	479
Zinc	ppm	ASTM D5185m	<b>523</b>	690	724
Sulfur	ppm	ASTM D5185m	<b>1303</b>	6730	7770

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	0
Water	%	ASTM D6304 >.1	<b>0.006</b>	0.010	0.013
ppm Water	ppm	ASTM D6304 >1000	<b>61</b>	106.3	136.7

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>▲ 9816</b>	1645	1639
Particles >6µm	ASTM D7647	>1300	<b>▲ 1486</b>	259	234
Particles >14µm	ASTM D7647	>160	<b>24</b>	13	18
Particles >21µm	ASTM D7647	>40	<b>7</b>	4	8
Particles >38µm	ASTM D7647	>10	<b>0</b>	0	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>▲ 20/18/12</b>	18/15/11	18/15/11

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.36</b>	0.690	0.811

# OIL ANALYSIS REPORT


### ▲ Particle Trend

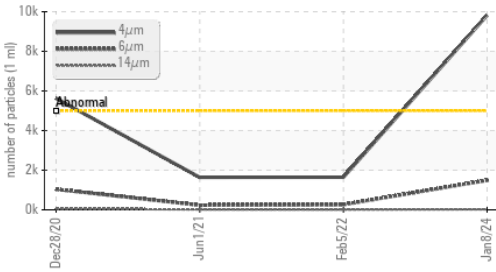


### Water (KF)

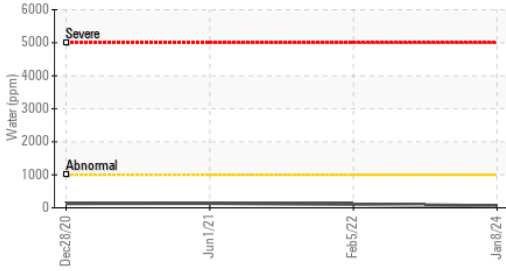


### Acid Number

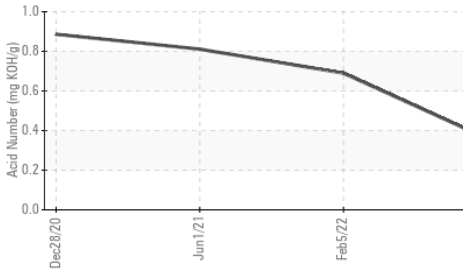

### Water (KF)

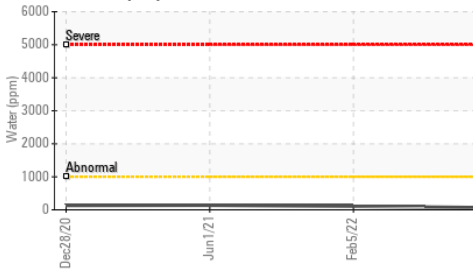

### Viscosity @ 40°C

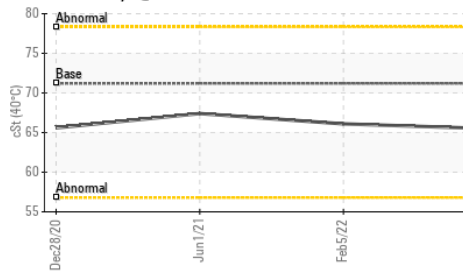


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 71.2	<b>65.5</b>	66.1	67.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




### GRAPHS


#### Ferrous Alloys

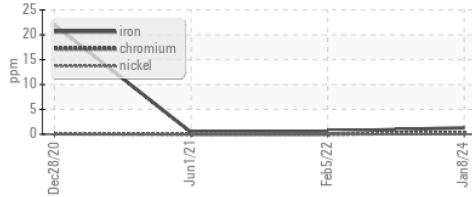


#### Non-ferrous Metals

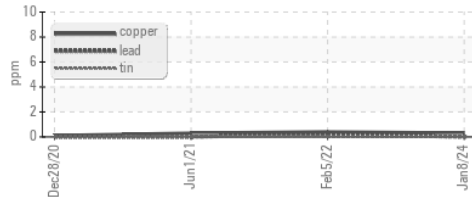


#### Viscosity @ 40°C

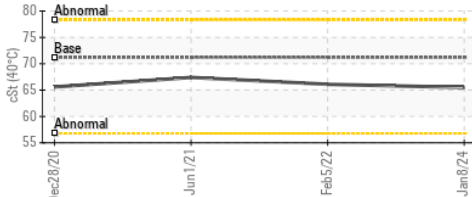

#### ▲ Particle Count

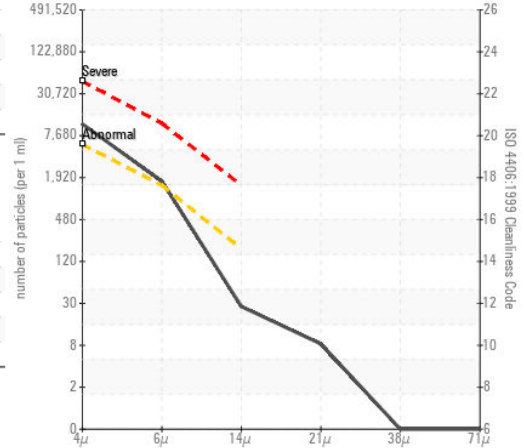

#### Acid Number

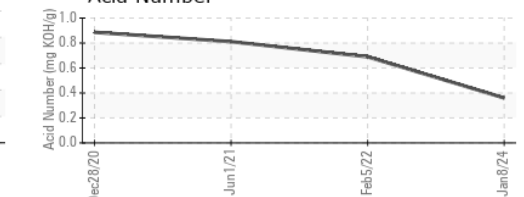

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : ST43828 **Received** : 12 Jan 2024  
**Lab Number** : 06060233 **Diagnosed** : 16 Jan 2024  
**Unique Number** : 10831615 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**WINDSHEAR - JACOBS**  
 1050 IVEY CLINE RD  
 CONCORD, NC  
 US 28027

Contact: SAWSON SAMIMY  
 sawson.samimy@jacobs.com

T: (704)920-7647

F: