


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

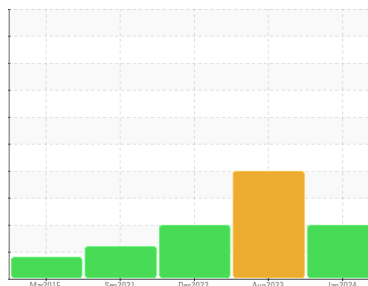

Machine Id  
**KAESER SK 15 4851069 (S/N 1532)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA006553</b>	KCPA004330	KCP52009
Sample Date	Client Info	<b>04 Jan 2024</b>	18 Aug 2023	02 Dec 2022
Machine Age	hrs	<b>36636</b>	35048	29386
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	Changed
Sample Status		<b>ABNORMAL</b>	SEVERE	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	3	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>6</b>	8	7
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	28
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>27</b>	<1	51
Calcium	ppm	ASTM D5185m 2	<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185m	<b>38</b>	2	8
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>20498</b>	20883	22185

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>7</b>	4	9
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	3
Water	%	ASTM D6304 >0.05	<b>0.016</b>	1.03	0.019
ppm Water	ppm	ASTM D6304 >500	<b>165</b>	10300	190.9






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>36431</b>	---	61942
Particles >6µm	ASTM D7647 >1300	<b>▲ 17189</b>	---	▲ 26586
Particles >14µm	ASTM D7647 >80	<b>▲ 4049</b>	---	▲ 3739
Particles >21µm	ASTM D7647 >20	<b>▲ 1174</b>	---	▲ 583
Particles >38µm	ASTM D7647 >4	<b>▲ 44</b>	---	▲ 21
Particles >71µm	ASTM D7647 >3	<b>2</b>	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 22/21/19</b>	---	▲ 23/22/19

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.37</b>	0.651	0.39


# OIL ANALYSIS REPORT

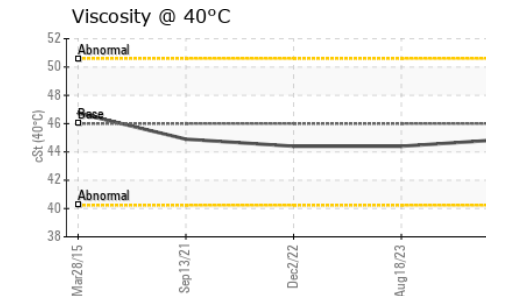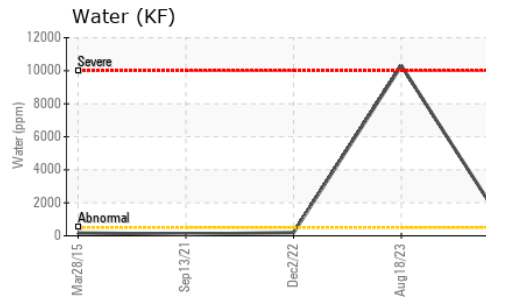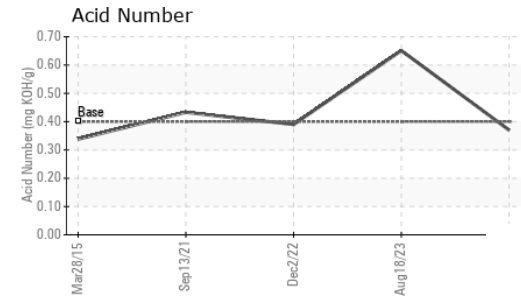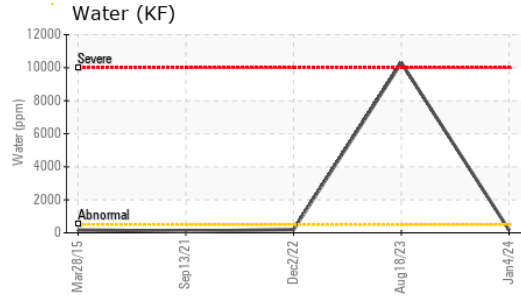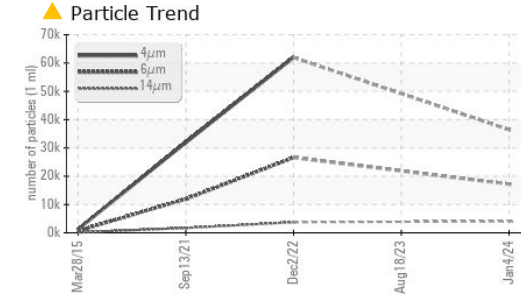






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ HEAVY	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445 46	44.9	44.4	44.4

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					

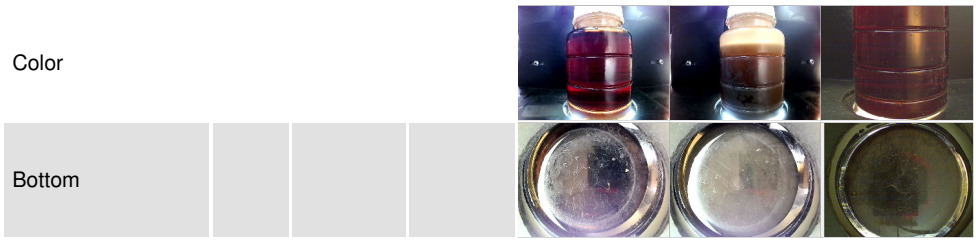

## GRAPHS

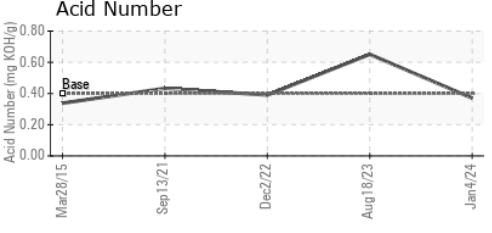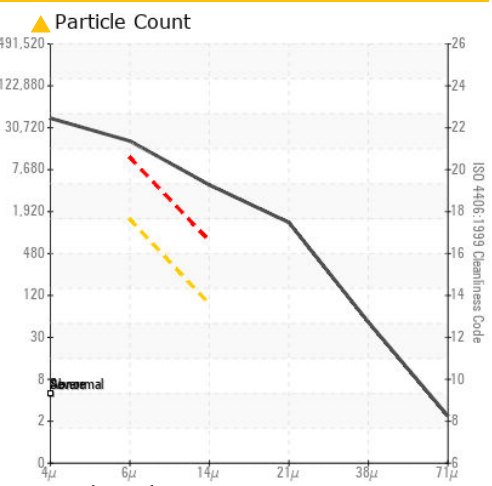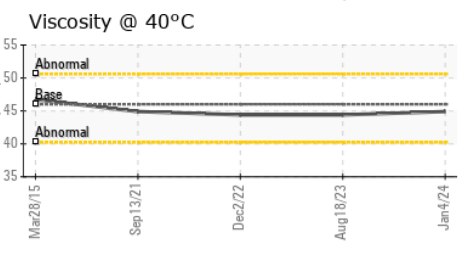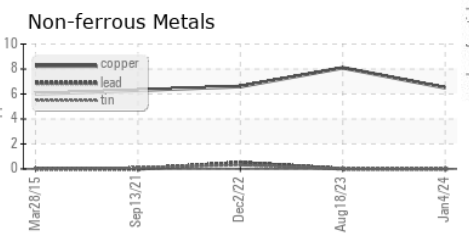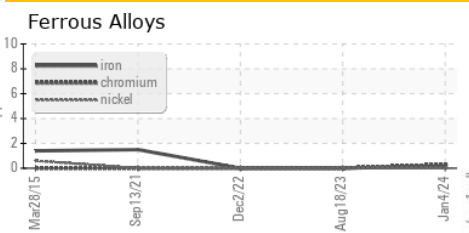

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006553 **Received** : 12 Jan 2024  
**Lab Number** : 06060285 **Diagnosed** : 16 Jan 2024  
**Unique Number** : 10831667 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ASSOCIATED FEED & SUPPLY**  
 5213 W MAIN ST  
 TURLOCK, CA  
 US 95380-9413  
 Contact: J. SARTIN  
 jsartin@associatedfeed.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)