




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

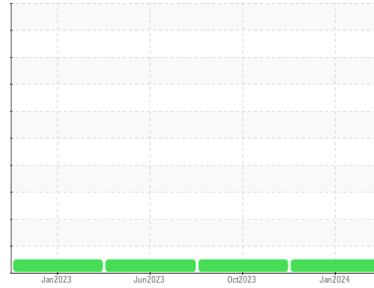

Machine Id  
**G60**

Component  
**Diesel Engine**  
Fluid

**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0874277</b>	WC0784027	WC0758915
Sample Date	Client Info		<b>06 Jan 2024</b>	05 Oct 2023	19 Jun 2023
Machine Age	hrs	Client Info	<b>12996</b>	113590	11784
Oil Age	hrs	Client Info	<b>537</b>	0	539
Oil Changed		Client Info	<b>N/A</b>	N/A	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >120	<b>8</b>	8	13
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	2	4
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m >330	<b>1</b>	2	15
Tin	ppm	ASTM D5185m >15	<b>1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>16</b>	10	47
Barium	ppm	ASTM D5185m 10	<b>0</b>	12	0
Molybdenum	ppm	ASTM D5185m 100	<b>65</b>	71	93
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 450	<b>859</b>	298	104
Calcium	ppm	ASTM D5185m 3000	<b>1246</b>	1780	2230
Phosphorus	ppm	ASTM D5185m 1150	<b>1094</b>	975	1030
Zinc	ppm	ASTM D5185m 1350	<b>1253</b>	1247	1283
Sulfur	ppm	ASTM D5185m 4250	<b>3105</b>	3155	3956

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>5</b>	6	9
Sodium	ppm	ASTM D5185m >158	<b>4</b>	6	2
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	4	4

## INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >4	<b>0.5</b>	0.6	0.8
Nitration	Abs/cm	*ASTM D7624 >20	<b>8.1</b>	9.0	9.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>18.7</b>	20.4	20.9

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>13.3</b>	15.3	15.9
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>6.8</b>	6.1	5.7







# OIL ANALYSIS REPORT

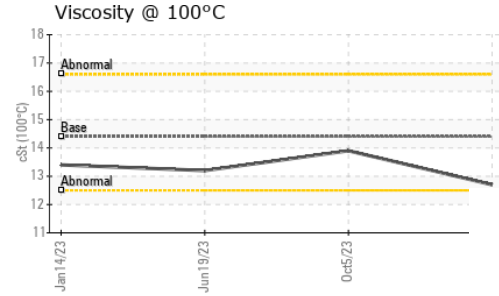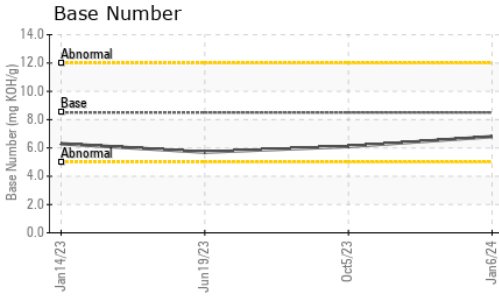

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.7</b>	13.9	13.2

### GRAPHS

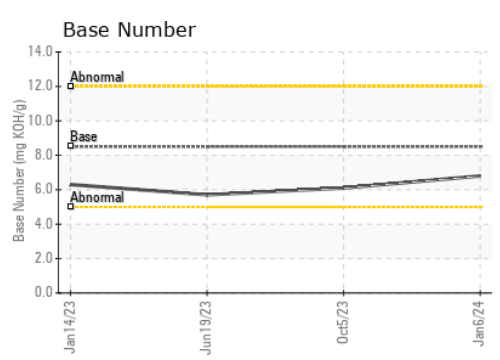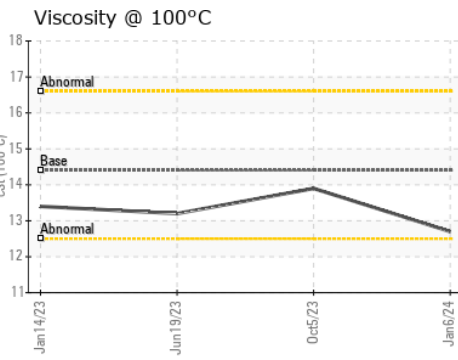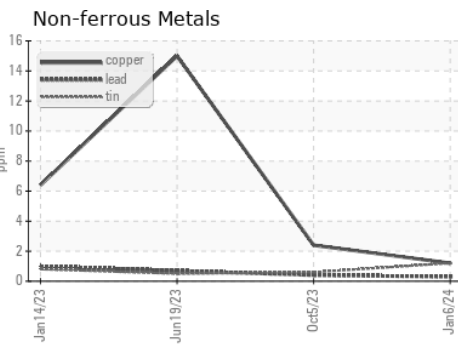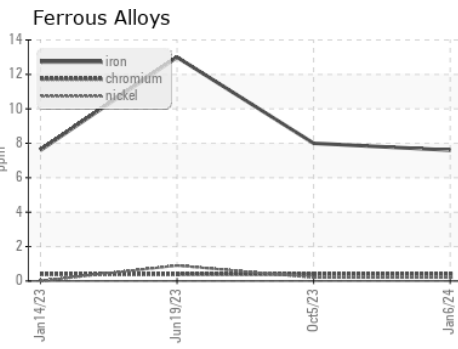

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0874277 **Received** : 16 Jan 2024  
**Lab Number** : **06060552** **Diagnosed** : 16 Jan 2024  
**Unique Number** : 10831934 **Diagnostician** : Wes Davis  
**Test Package** : CONST ( Additional Tests: TBN )

**Apple Valley Waste - EHT Location**  
 6626 Delilah Road  
 Egg Harbor Township, NJ  
 US 08234  
 Contact: Service Manager

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: