

OIL ANALYSIS REPORT

T

Sample Rating Trend

ISO

Machine Id

KAESER 3020068

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009166		
Sample Date		Client Info		29 Dec 2023		
Machine Age	hrs	Client Info		13819		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
- itanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
ead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
īn	ppm	ASTM D5185m	>10	1		
/anadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	10		
Nolybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
/lagnesium	ppm	ASTM D5185m	100	63		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	6		
Sulfur	ppm	ASTM D5185m	23500	19287		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		27		
Potassium	ppm	ASTM D5185m	>20	3		
Vater	%	ASTM D6304	>0.05	0.040		
ppm Water	ppm	ASTM D6304	>500	407		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		24974		
Particles >6µm		ASTM D7647	>1300	△ 7383		
Particles >14μm		ASTM D7647	>80	<u>▲</u> 377		

ASTM D7647 >20

ASTM D7647 >4

ASTM D7647 >3

ISO 4406 (c)

method

mg KOH/g ASTM D8045 1.0

72

2

0

0.37

22/20/16

current

>--/17/13

limit/base

Particles >21µm

Particles >38µm

Particles >71µm

Oil Cleanliness

Acid Number (AN)


FLUID DEGRADATION


history1

history2



OIL ANALYSIS REPORT

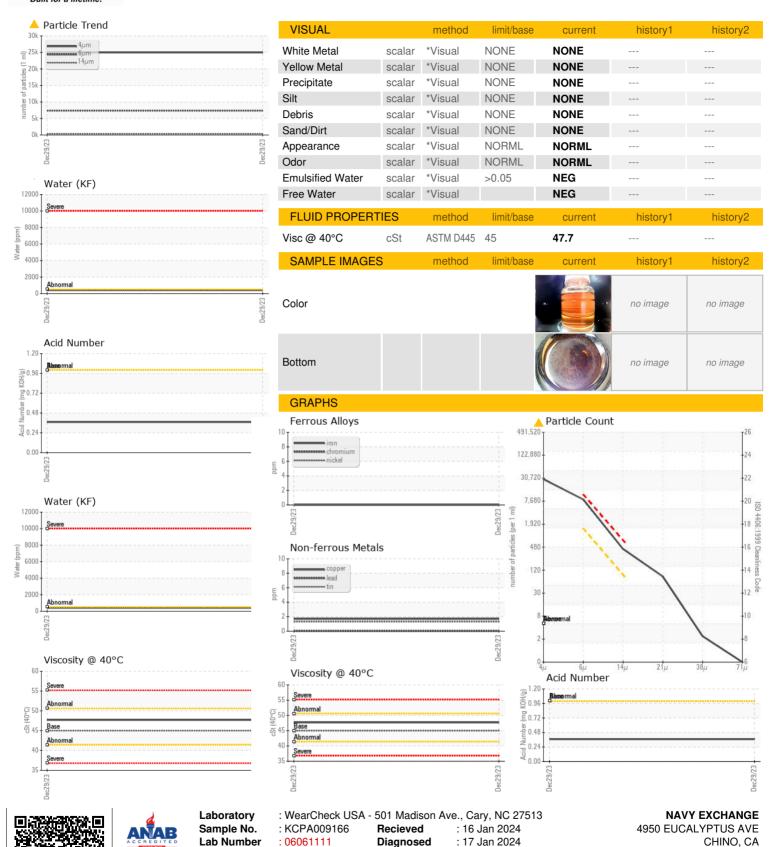



Certificate L2367

Unique Number

: 10832493

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Doug Bogart

US 91710

T: F:

Contact: Service Manager