




# OIL ANALYSIS REPORT

Sample Rating Trend

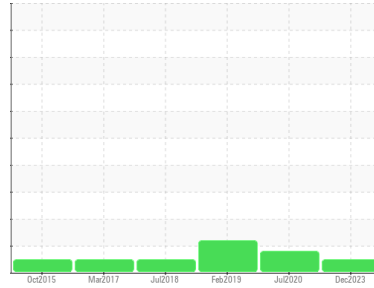

**NORMAL**



Machine Id  
**KAESER AS 20 5073950 (S/N 1029)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA011375</b>	KC86837	KC80448
Sample Date	Client Info			<b>07 Dec 2023</b>	06 Jul 2020	12 Feb 2019
Machine Age	hrs	Client Info		<b>0</b>	25918	19580
Oil Age	hrs	Client Info		<b>0</b>	0	2268
Oil Changed	Client Info			<b>N/A</b>	Changed	Not Chngd
Sample Status				<b>NORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>16</b>	15	7
Tin	ppm	ASTM D5185m	>10	<b>1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	0
Barium	ppm	ASTM D5185m	90	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>2</b>	<1	<1
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	9	<1
Zinc	ppm	ASTM D5185m		<b>0</b>	0	18
Sulfur	ppm	ASTM D5185m		<b>17472</b>	16141	15040

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	2	0
Sodium	ppm	ASTM D5185m		<b>2</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water	%	ASTM D6304	>0.05	<b>0.016</b>	0.006	0.006
ppm Water	ppm	ASTM D6304	>500	<b>160</b>	69.9	60

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>481</b>	2171	5403
Particles >6µm		ASTM D7647	>1300	<b>47</b>	937	▲ 1570
Particles >14µm		ASTM D7647	>80	<b>4</b>	▲ 232	▲ 152
Particles >21µm		ASTM D7647	>20	<b>3</b>	▲ 53	▲ 42
Particles >38µm		ASTM D7647	>4	<b>0</b>	2	3
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>16/13/9</b>	▲ 17/15	▲ 18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.432	0.396


# OIL ANALYSIS REPORT

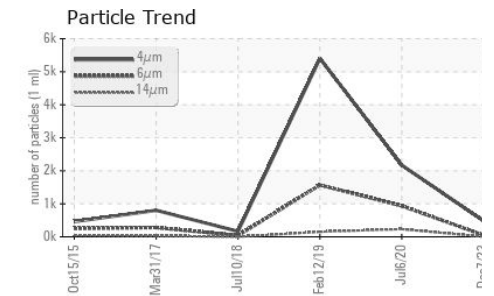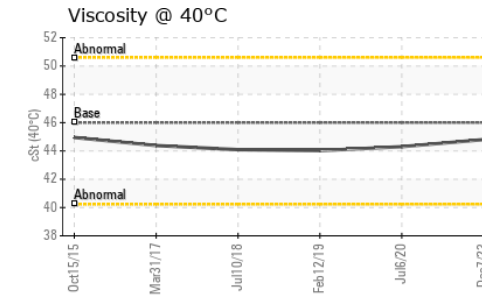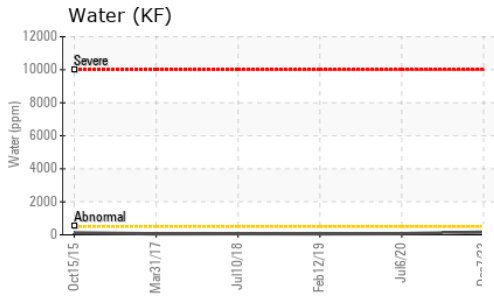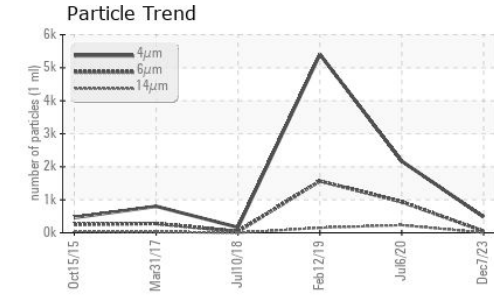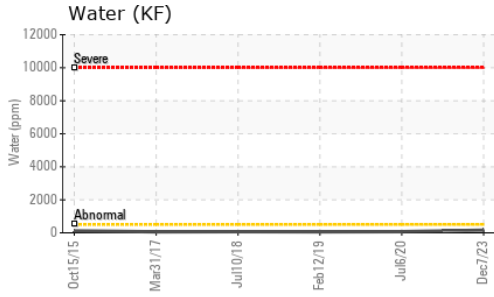






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.8	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

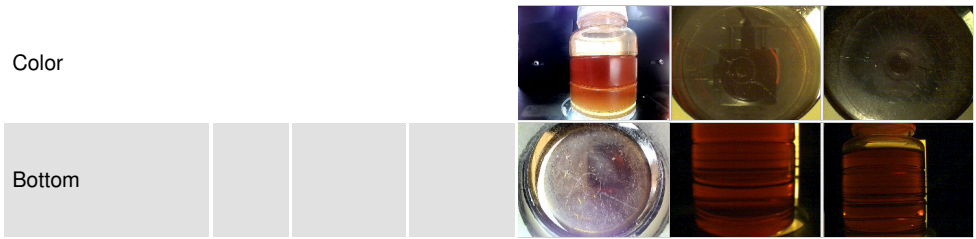

## GRAPHS

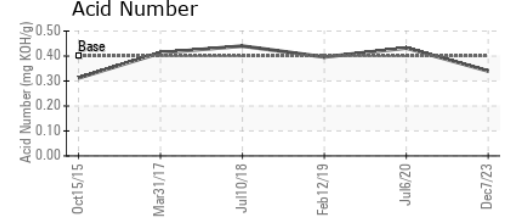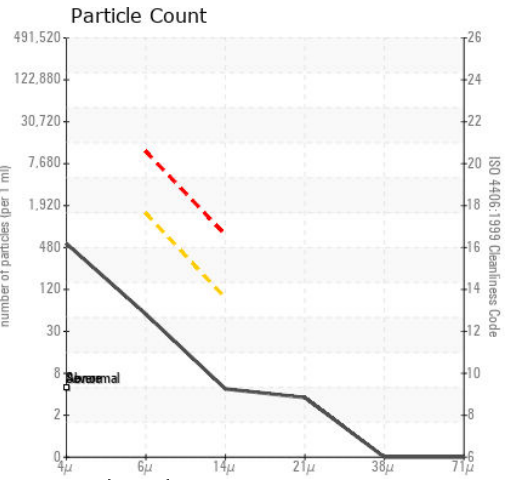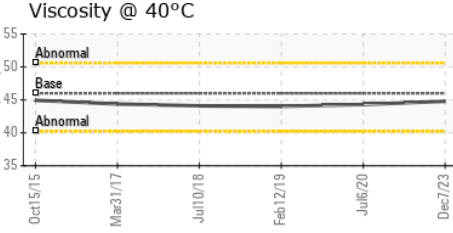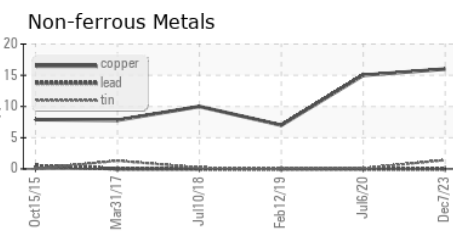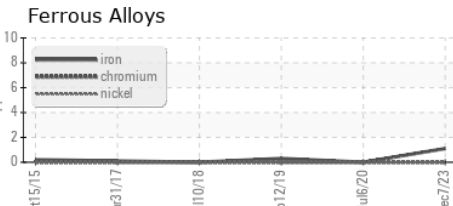

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA011375 **Received** : 16 Jan 2024  
**Lab Number** : 06061113 **Diagnosed** : 06 Feb 2024  
**Unique Number** : 10832495 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMERICAN DEBURRING INC**  
 20742 LINER LN  
 LAKE FOREST, CA  
 US 92630  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: