

## **OIL ANALYSIS REPORT**

Sample Rating Trend

WATER

# KAESER 6777755 (S/N 1461)

Compressor Fluid ISO 320N (--- GAL)

### DIAGNOSIS

#### Recommendation

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

#### Wear

All component wear rates are normal.

#### Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


Sample Number Sample Date		Client Info		KODOLOOL		
		Onoric milo		KCP31601		
		Client Info		26 Dec 2023		
Machine Age	hrs	Client Info		2781		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum		ASTM D5185m	>10	0 <1		
	ppm					
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		4		
Tin	ppm	ASTM D5185m	>10	2		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		1291		
Zinc	ppm	ASTM D5185m		<1		
Sulfur	ppm	ASTM D5185m		556		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	<b>0.051</b>		
opm Water	ppm	ASTM D6304		<b>5</b> 11		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2394		
Particles >6µm		ASTM D7647	>1300	715		
Particles >14µm		ASTM D7647	>80	58		
Particles >21µm		ASTM D7647	>20	19		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	0 18/17/13		
FLUID DEGRADA		method	limit/base	current	history1	history2
			- mill base	0.65	Thistory I	113(01)/2
Acid Number (AN)	mg KOH/g	ASTM D8045				




## **OIL ANALYSIS REPORT**





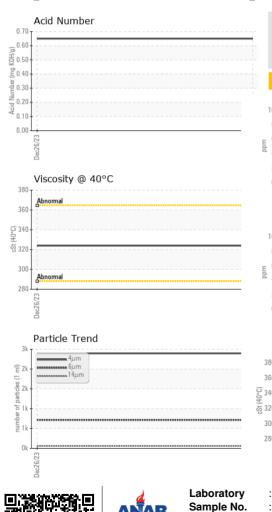

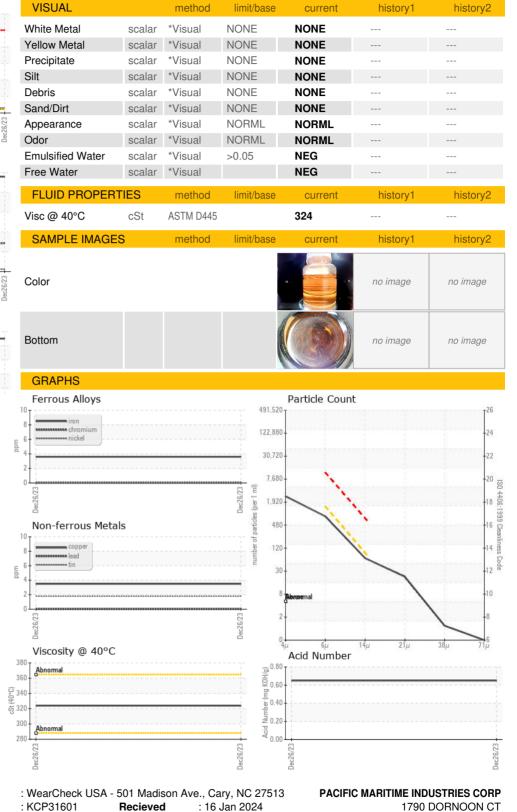

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Diagnosed

: 17 Jan 2024

Diagnostician : Doug Bogart

:06061119

: 10832501

Certificate L2367

Lab Number

Unique Number

SAN DIEGO, CA US 92173

Contact: Service Manager