


OIL ANALYSIS REPORT

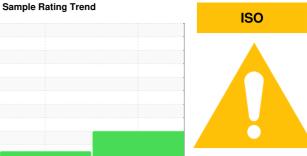

KAESER BSD60 6684649 (S/N 1482)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2022	Jan 2024		
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06061123	KC108371	
Sample Date		Client Info		04 Jan 2024	07 Dec 2022	
Machine Age	hrs	Client Info		42739	33347	
Oil Age	hrs	Client Info		0	6649	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	8	
Tin	ppm	ASTM D5185m	>10	1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	0	<1	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	3	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		2	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.010	0.015	
ppm Water	ppm	ASTM D6304	>500	104	152.7	
FLUID CLEANLINE	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		133694	962	
Particles >6µm		ASTM D7647	>1300	△ 52903	367	
Particles >14μm		ASTM D7647	>80	<u>^</u> 2031	55	
Particles >21µm		ASTM D7647	>20	443	15	
Particles >38μm		ASTM D7647	>4	<u> </u>	2	
Particles >71μm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>4</u> 24/23/18	17/16/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Aoid Number (ANI)	I/OLI/-	ACTM DOG45	0.4	0.40	0.41	

Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.41

0.40



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: 06061123

: KC06061123 : 10832505 : IND 2

: 16 Jan 2024 Recieved Diagnosed : 17 Jan 2024 Diagnostician

: Doug Bogart

Test Package To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Service Manager