


OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

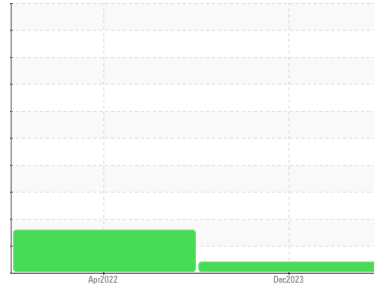

Machine Id
KAESER 4887028

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC06061126	KC104121	---
Sample Date	Client Info			03 Dec 2023	28 Apr 2022	---
Machine Age	hrs	Client Info		38433	32459	---
Oil Age	hrs	Client Info		0	4120	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	<1	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	29	41	---
Tin	ppm	ASTM D5185m	>10	1	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	90	0	0	---
Calcium	ppm	ASTM D5185m	2	0	0	---
Phosphorus	ppm	ASTM D5185m		0	0	---
Zinc	ppm	ASTM D5185m		0	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	---
Sodium	ppm	ASTM D5185m		<1	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.013	0.007	---
ppm Water	ppm	ASTM D6304	>500	138	75.7	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	73221	---
Particles >6µm		ASTM D7647	>1300	---	▲ 26551	---
Particles >14µm		ASTM D7647	>80	---	▲ 3165	---
Particles >21µm		ASTM D7647	>20	---	▲ 780	---
Particles >38µm		ASTM D7647	>4	---	▲ 56	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	▲ 22/19	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.35	---


OIL ANALYSIS REPORT

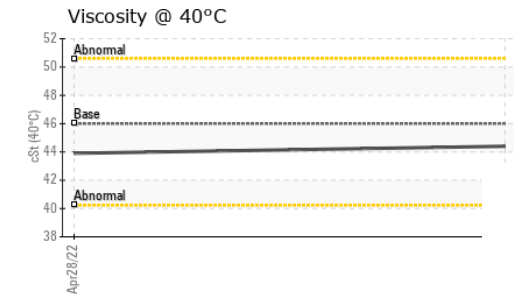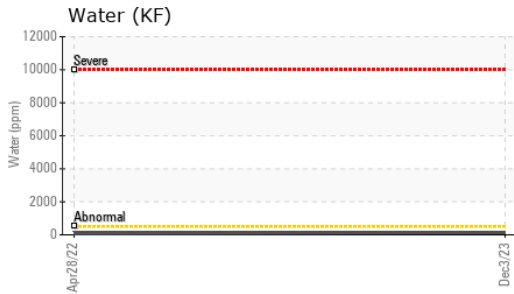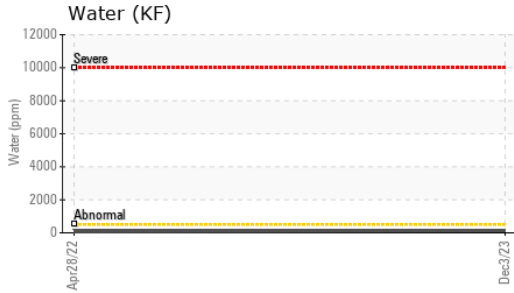





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	44.4	43.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

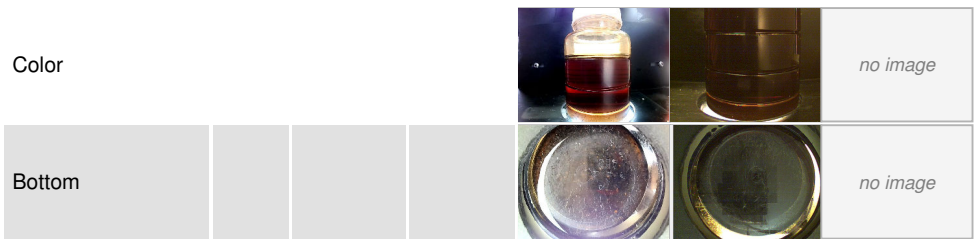

GRAPHS

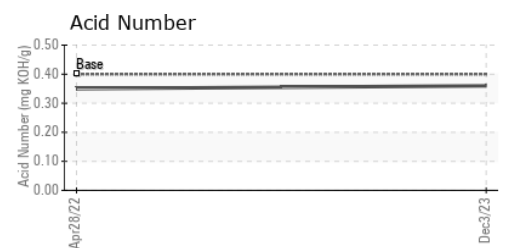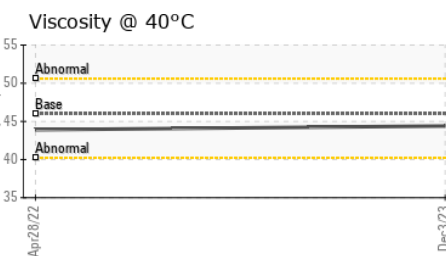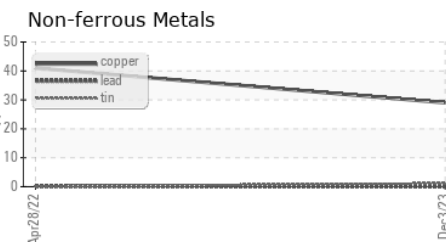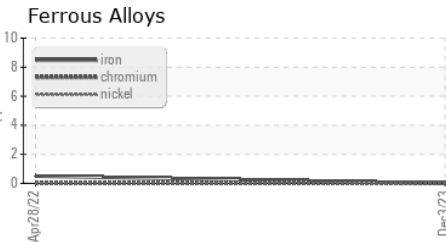

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06061126 **Recieved** : 16 Jan 2024
Lab Number : 06061126 **Diagnosed** : 17 Jan 2024
Unique Number : 10832508 **Diagnostician** : Doug Bogart
Test Package : IND 2

VA HOSPITAL - BILOXI
 400 VETERANS AVE, BLDG 31
 BILOXI, MS
 US 39531
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: