




# OIL ANALYSIS REPORT

Sample Rating Trend

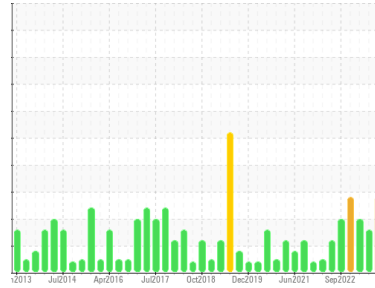

**WEAR**



Area  
**ER-1**  
 Machine Id  
**C-11 (S/N S0431TFMCTHAA03)**

Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #3 (130 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

The iron level is abnormal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0005040</b>	USP0001632	USP255243
Sample Date	Client Info		<b>02 Jan 2024</b>	26 Sep 2023	28 Jun 2023
Machine Age	hrs	Client Info	<b>29143</b>	27871	27871
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>▲ 89</b>	▲ 74	▲ 71
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >8	<b>4</b>	2	2
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>3</b>	17	16
Sulfur	ppm	ASTM D5185m	<b>25</b>	74	53

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>3</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304 >0.01	<b>0.003</b>	0.002	0.003
ppm Water	ppm	ASTM D6304 >100	<b>31</b>	25.0	34.2

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 197107</b>	▲ 15904	▲ 52598
Particles >6µm	ASTM D7647	>2500	<b>▲ 113368</b>	2407	▲ 10916
Particles >14µm	ASTM D7647	>320	<b>▲ 6019</b>	82	294
Particles >21µm	ASTM D7647	>80	<b>▲ 579</b>	15	33
Particles >38µm	ASTM D7647	>20	<b>5</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 25/24/20</b>	▲ 21/18/14	▲ 23/21/15

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.073</b>	0.069	0.014

# OIL ANALYSIS REPORT


### ▲ Particle Trend

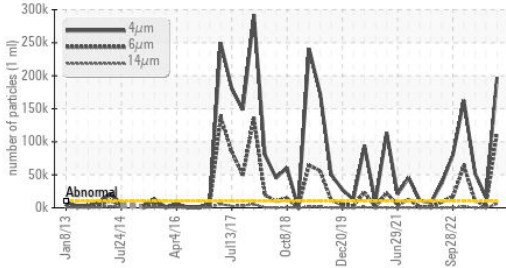


### Water (KF)

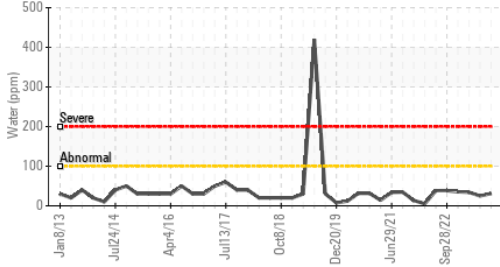


### ▲ Ferrous Alloys

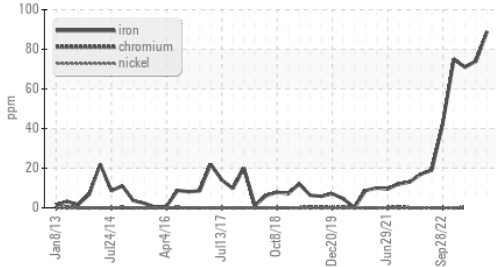

### Acid Number

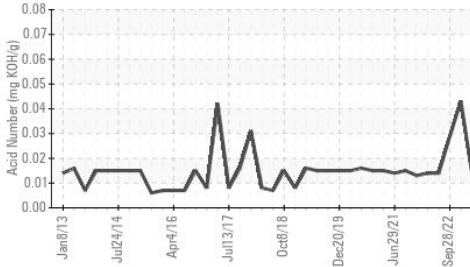


### Water (KF)

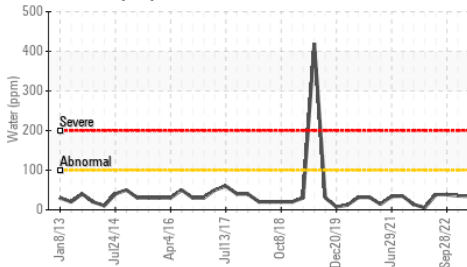

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	66.7	67.8	68.7

### SAMPLE IMAGES

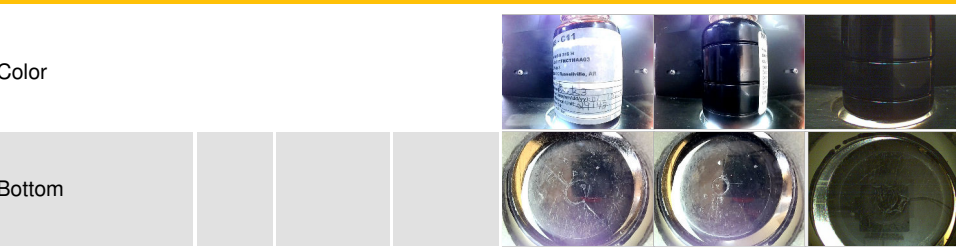


### GRAPHS


#### ▲ Ferrous Alloys

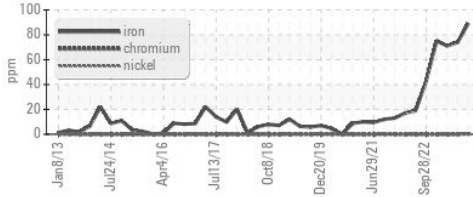


#### Non-ferrous Metals

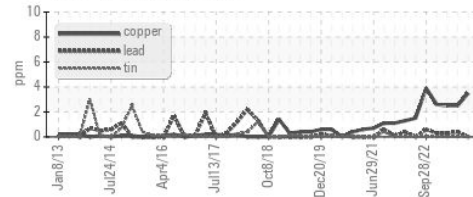


#### Viscosity @ 40°C

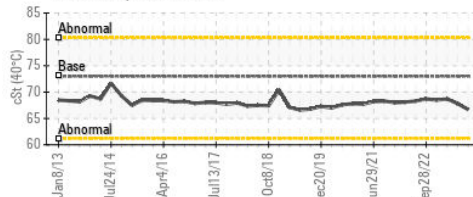

#### ▲ Particle Count

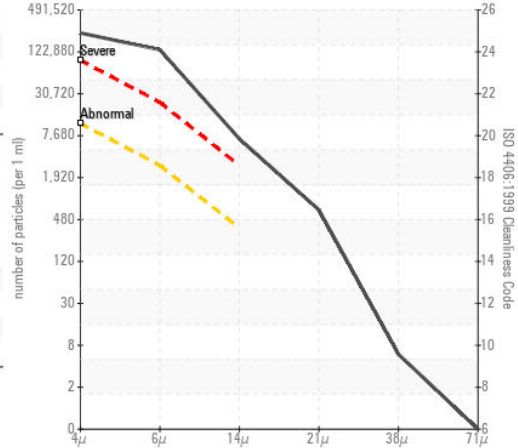

#### Acid Number

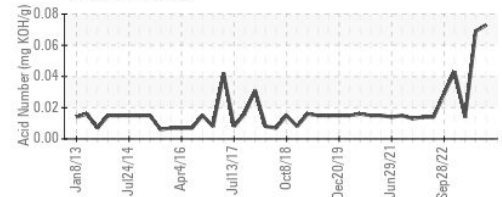

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0005040 **Received** : 16 Jan 2024  
**Lab Number** : 06061223 **Diagnosed** : 17 Jan 2024  
**Unique Number** : 10832605 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CONAGRA FROZEN FOODS CO**

RUSSELLVILLE, AR  
US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: