



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**WC-9250-0103-5 Chiller #3**  
 Component  
**Chiller**  
 Fluid  
**YORK TYPE K (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0836566</b>	---	---
Sample Date	Client Info		<b>09 Jan 2024</b>	---	---
Machine Age	hrs	Client Info	<b>10478</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >8	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 5	<b>32</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 10	<b>0</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>4</b>	---	---
Sodium	ppm	ASTM D5185m	<b>3</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	---	---
Water	%	ASTM D6304 >0.03	<b>0.028</b>	---	---
ppm Water	ppm	ASTM D6304 >300	<b>290</b>	---	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>295</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>59</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>6</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>2</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>15/13/10</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.03	<b>0.028</b>	---	---




# OIL ANALYSIS REPORT

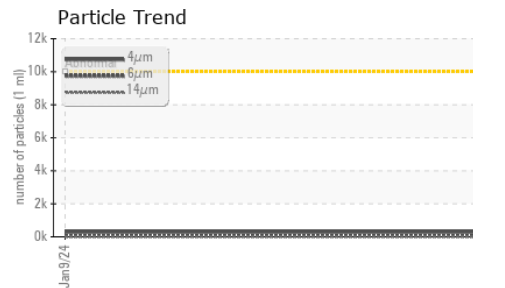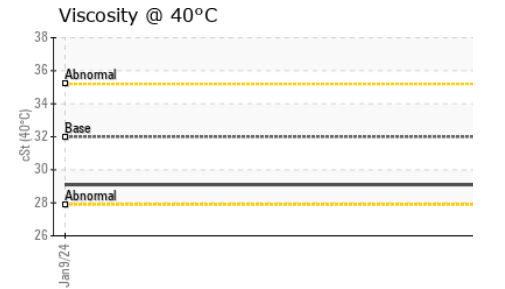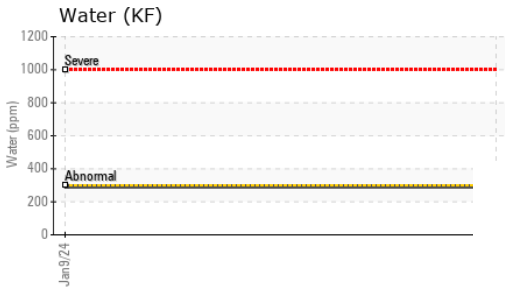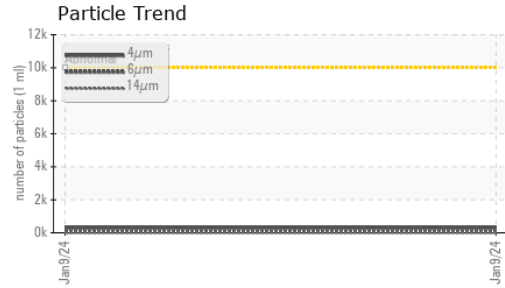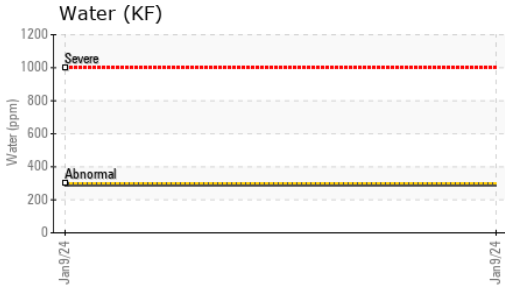





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.03	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.0	29.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

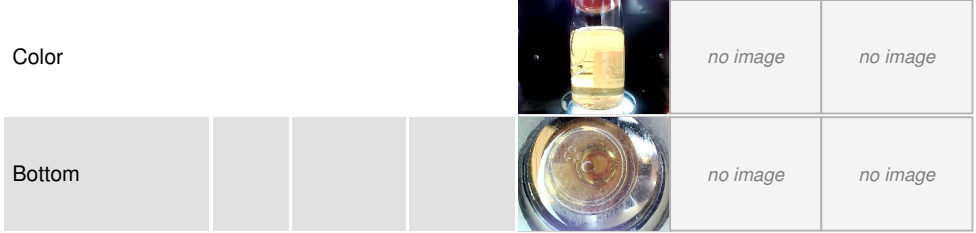

## GRAPHS

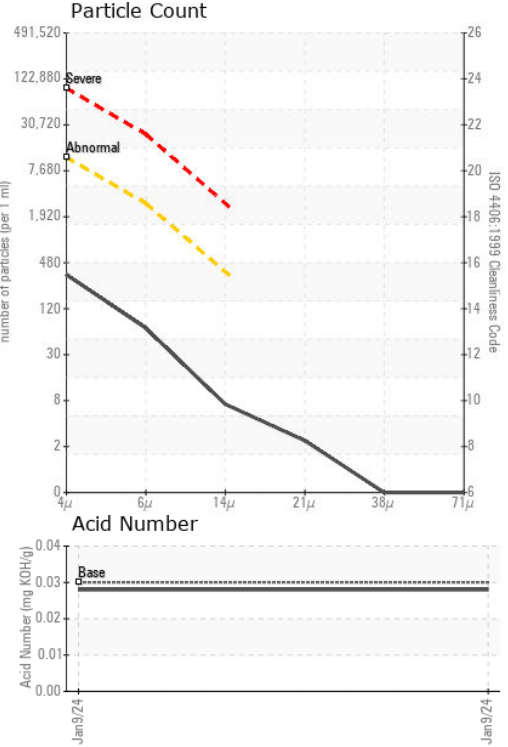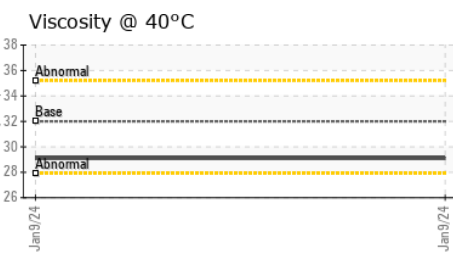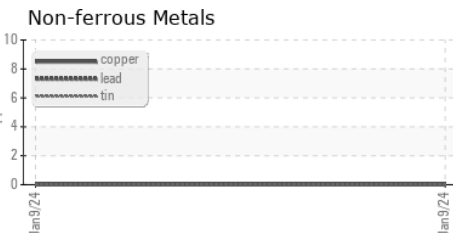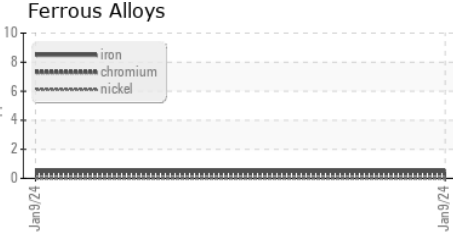

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0836566 **Received** : 16 Jan 2024  
**Lab Number** : 06061251 **Diagnosed** : 30 Jan 2024  
**Unique Number** : 10832633 **Diagnostician** : Doug Bogart  
**Test Package** : PLANT

**Chugach Consolidated Solutions - NSA**  
 10840 Guilford Road, Suites 406-407  
 Annapolis Junction, MD  
 US 20701  
 Contact: Susan Nord  
 susan.nord@chugachgov.com  
 T: (301)688-6363  
 F: (443)479-5666

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)