


PROBLEM SUMMARY

Sample Rating Trend



WATER



Machine Id
PHILADELPHIA BAKER POLY AGITATOR (B)
 Component
Gearbox
 Fluid
ROYAL PURPLE SYNERGY 90/150 (15 GAL)

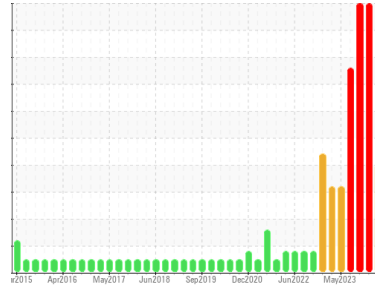

COMPONENT CONDITION SUMMARY

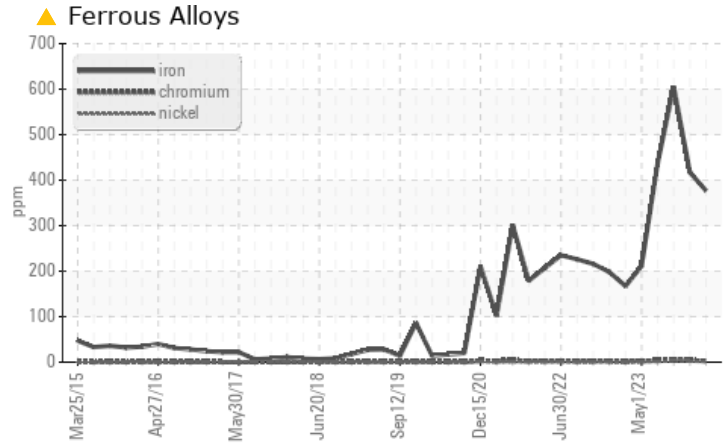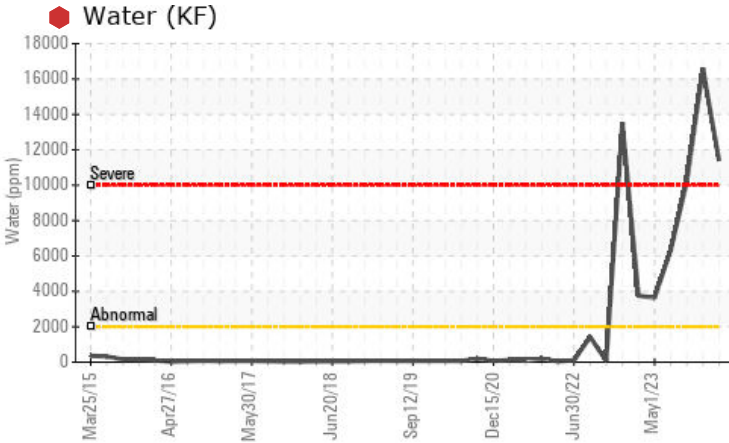

RECOMMENDATION

We advise that you check for the source of water entry. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	SEVERE	SEVERE
Iron	ppm	ASTM D5185m	>200	▲ 377	● 417	● 605
Water	%	ASTM D6304	>0.2	● 1.14	● 1.66	● 1.02
ppm Water	ppm	ASTM D6304	>2000	● 11400	● 16600	● 10200
Emulsified Water	scalar	*Visual	>0.2	● 0.2%	● 0.2%	● 0.2%

Customer Id: OXYDEE
 Sample No.: RP0035833
 Lab Number: 06061274
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Water Access	---	---	?	We advise that you check for the source of water entry.

HISTORICAL DIAGNOSIS

18 Dec 2023 Diag: Don Baldrige

WEAR



We advise that you check for the source of water entry. We recommend that you drain the oil from the component if this has not already been done. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. Gear wear is indicated. There is a high concentration of water present in the oil. Excessive free water present. The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.

view report



13 Dec 2023 Diag: Don Baldrige

WEAR



We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. Gear wear is indicated. Moderate concentration of visible dirt/debris present in the oil. There is a high concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



03 Oct 2023 Diag: Don Baldrige

WEAR



We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. Gear wear is indicated. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

WATER




Machine Id
PHILADELPHIA BAKER POLY AGITATOR (B)

Component

Gearbox

Fluid

ROYAL PURPLE SYNERGY 90/150 (15 GAL)

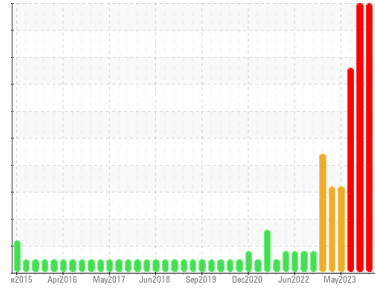

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

Gear wear is indicated.

Contamination

There is a high concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0035833	RP0035845	RP0035843
Sample Date	Client Info		02 Jan 2024	18 Dec 2023	13 Dec 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	377	417	605
Chromium	ppm	ASTM D5185m >15	3	4	6
Nickel	ppm	ASTM D5185m >15	<1	2	3
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	5	6	9
Lead	ppm	ASTM D5185m >100	<1	<1	1
Copper	ppm	ASTM D5185m >200	6	5	8
Tin	ppm	ASTM D5185m >25	0	<1	1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	2	<1	2
Manganese	ppm	ASTM D5185m	1	2	3
Magnesium	ppm	ASTM D5185m	2	6	6
Calcium	ppm	ASTM D5185m	6	21	16
Phosphorus	ppm	ASTM D5185m 200	501	454	488
Zinc	ppm	ASTM D5185m	0	21	34

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	28	29	37
Sodium	ppm	ASTM D5185m	0	2	2
Potassium	ppm	ASTM D5185m >20	2	2	3
Water	%	ASTM D6304 >0.2	1.14	1.66	1.02
ppm Water	ppm	ASTM D6304 >2000	11400	16600	10200





FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.61	0.71	0.80	0.95

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	MODER	MODER
Debris	scalar	*Visual NONE	NONE	NONE	MODER
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	HAZY
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual >0.2	0.2%	0.2%	0.2%
Free Water	scalar	*Visual	NEG	CHARLES LOVENE	OXYDEE

OIL ANALYSIS REPORT

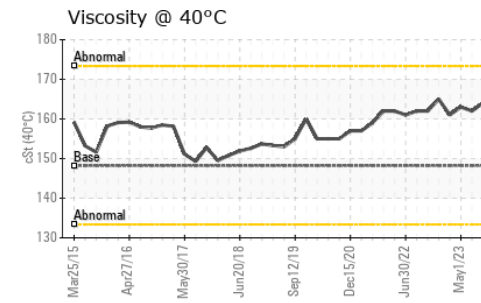
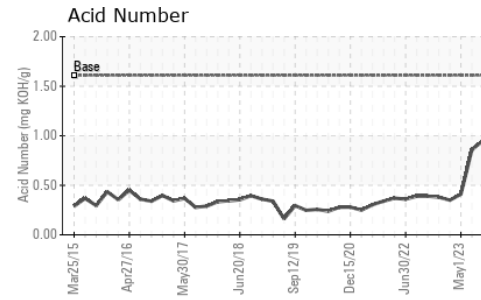
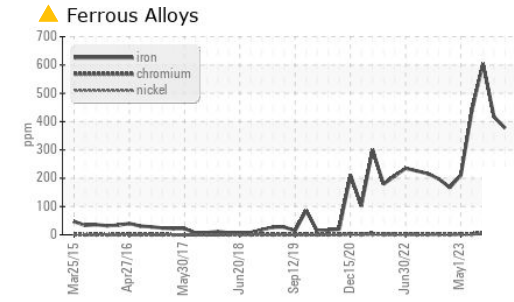
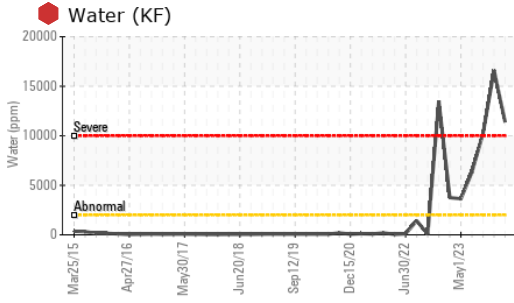


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	148.2	167	167	164

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

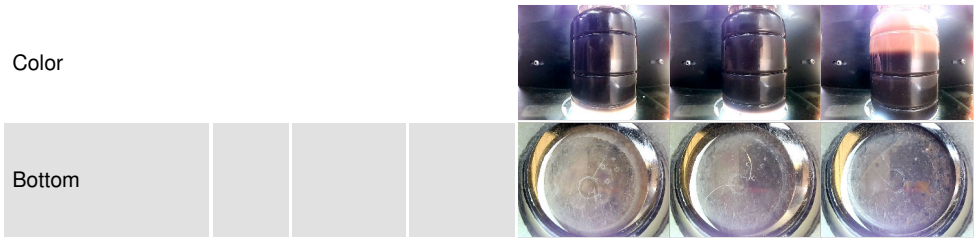

GRAPHS

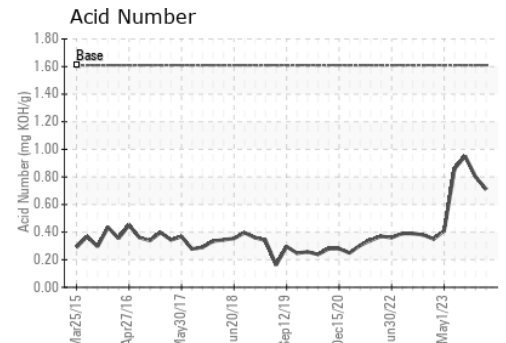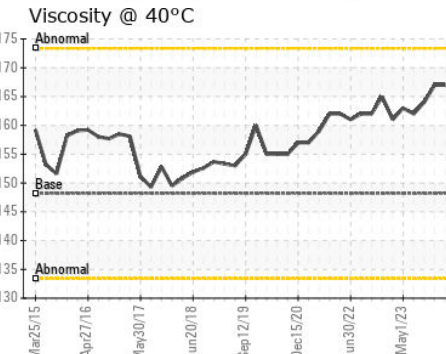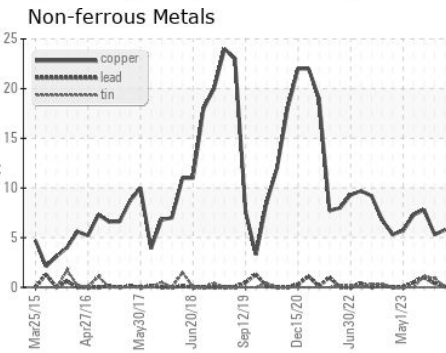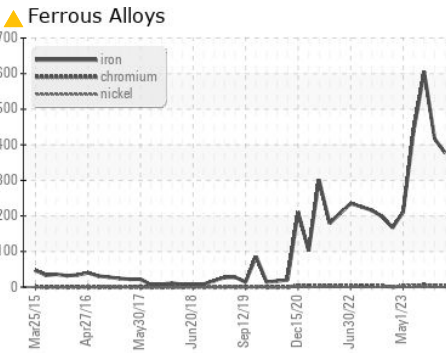

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0035833 **Received** : 16 Jan 2024
Lab Number : **06061274** **Diagnosed** : 18 Jan 2024
Unique Number : 10832656 **Diagnostician** : Jonathan Hester
Test Package : IND 2

OXY VINYLs DEER PARK PVC
 1000 TIDAL ROAD
 DEER PARK, TX
 US 77536
 Contact: CHARLES LOVE
 charles_love@oxy.com
 T: (281)476-2277
 F: (281)476-2604

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)