


Area
PAPER MACHINE
 Machine Id
701.0150 Refiner #6
 Component
Gearbox
 Fluid
SHELL MORLINA S4 B 220 (--- GAL)

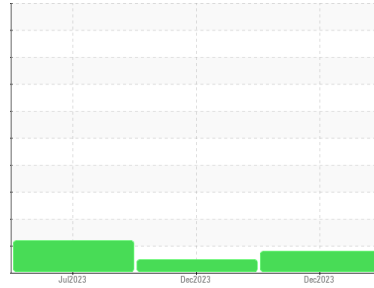

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: Regular sample location)

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PE0002923	PE0002922	PE0000933
Sample Date	Client Info	28 Dec 2023	28 Dec 2023	13 Jul 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	---	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184		16	15	20	
Iron	ppm	ASTM D5185m	>200	3	1	37
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	2	0
Lead	ppm	ASTM D5185m	>100	0	0	<1
Copper	ppm	ASTM D5185m	>200	1	<1	2
Tin	ppm	ASTM D5185m	>25	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	6	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	0	2
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		1	2	4
Phosphorus	ppm	ASTM D5185m		239	319	215
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		2600	3291	8850






CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	<1	<1	3
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	2

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>20000	▲ 45756	---	▲ 109985
Particles >6µm	ASTM D7647	>5000	4143	---	▲ 14545
Particles >14µm	ASTM D7647	>640	131	---	252
Particles >21µm	ASTM D7647	>160	33	---	32
Particles >38µm	ASTM D7647	>40	2	---	1
Particles >71µm	ASTM D7647	>10	0	---	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/19/14	---	▲ 24/21/15

OIL ANALYSIS REPORT

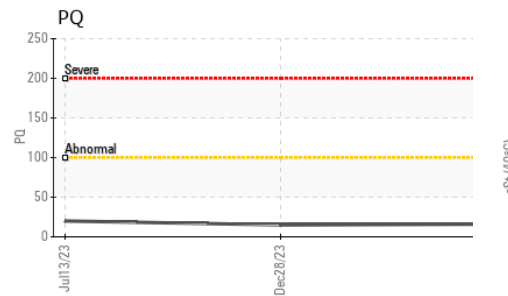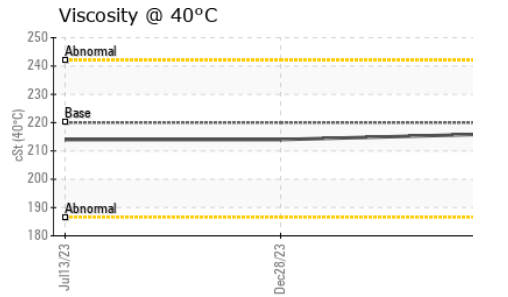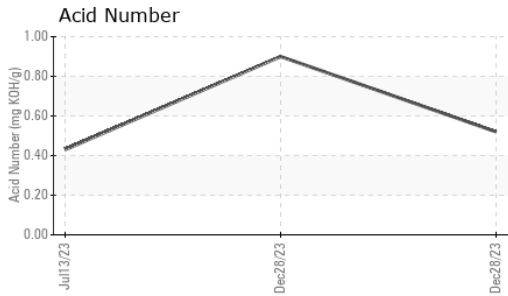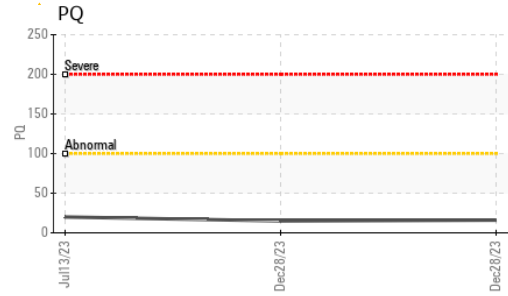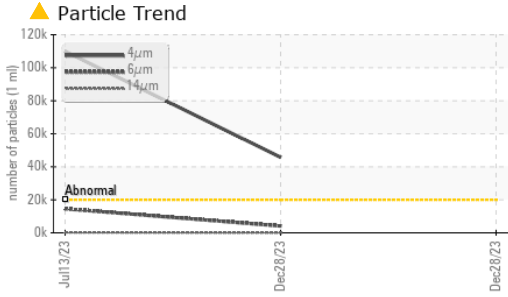


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.52	0.90	0.43




VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	216	214	214

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

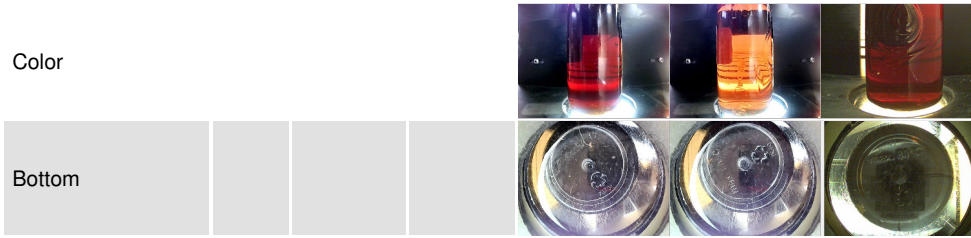

GRAPHS

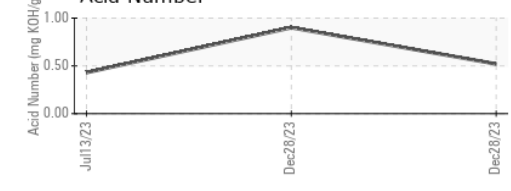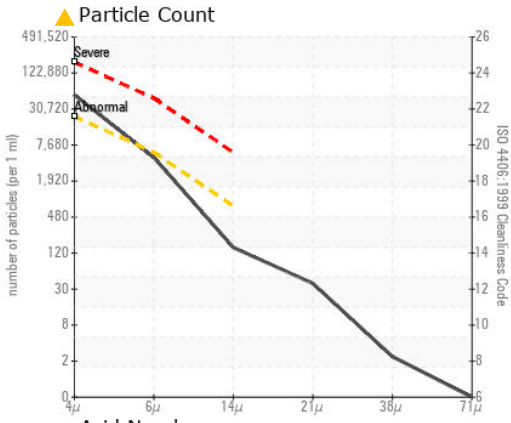

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PE0002923 **Received** : 16 Jan 2024
Lab Number : **06061887** **Diagnosed** : 18 Jan 2024
Unique Number : 10833269 **Diagnostician** : Jonathan Hester
Test Package : PLANT (Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN)

Port Townsend Paper Corporation
 100 Mill Rd
 Port Townsend, WA
 US 98368
 Contact: LONNIE LOREE
 lonnie.loree@ptpc.com
 T: (907)738-6506
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)